

\\ctarino2\Eng\Projects\2024\24-0055-001-01 1501 West Atlantic - Truck Wash\24-0055 WSD.dwg [C-10] Feb 28, 2025 3:52pm CEDWARDS

PVC HORIZONTAL BENDS AND VERTICAL UP BENDS				
PIPE SIZE (IN.)	RESTRAINED JOINT LENGTH L (MINIMUM DISTANCE IN FEET FROM FITTING - EACH WAY)			
	BENDS			CROSSES WITH PLUG, DEAD END, TEE, WYE
	90°	45°	22.5°	11.25°
6	26	11	6	3
8	33	14	7	4
12	46	19	10	5

PVC VERTICAL DOWN BEND				
PIPE SIZE (IN.)	RESTRAINED JOINT LENGTH L (MINIMUM DISTANCE IN FEET FROM FITTING - EACH WAY)			
	BENDS			CROSSES WITH PLUG, DEAD END, TEE, WYE
	90°	45°	22.5°	11.25°
6	26	11	6	3
8	33	14	7	4
12	46	19	10	5

DIP HORIZONTAL BENDS AND VERTICAL UP BENDS				
PIPE SIZE (IN.)	RESTRAINED JOINT LENGTH L (MINIMUM DISTANCE IN FEET FROM FITTING - EACH WAY)			
	BENDS			CROSSES WITH PLUG, DEAD END, TEE, WYE
	90°	45°	22.5°	11.25°
12"	68	28	14	7
24"	119	49	24	12

DIP VERTICAL DOWN BEND				
PIPE SIZE (IN.)	RESTRAINED JOINT LENGTH L (MINIMUM DISTANCE IN FEET FROM FITTING - EACH WAY)			
	BENDS			CROSSES WITH PLUG, DEAD END, TEE, WYE
	90°	45°	22.5°	11.25°
12"	144	60	29	14
24"	258	107	51	25

RESTRAINED JOINT INFORMATION


ENGINEERING STANDARDS 2022			
REVISIONS		ENGINEERING DIVISION CITY OF POMPAÑO BEACH	RESTRAINED JOINT INFORMATION
BY	DATE		
		SCALE: N.T.S.	DATE: MAY 2022 DWG. NO.
			118-2

MIN. LENGTH OF PIPE (FEET) TO BE RESTRAINED (SOURCES: EBAA IRON RESTRAINT LENGTH CALCULATION PROGRAM FOR PVC PIPE, RELEASE 3.1, AND DIPRA THRUST RESTRAINT FOR DUCTILE IRON PIPE, RELEASE 3.2)														
FITTING TYPE	PIPE SIZE													
	4"	6"	8"	10"	12"	16"	20"	24"	30"	36"	42"	48"	60"	200psi
90° HORIZ. BEND	14	20	25	30	35	45	54	62	70	113	124	135		
45° HORIZ. BEND	6	8	11	13	15	19	22	26	31	46	51	56		
22.5° HORIZ. BEND	3	4	5	6	7	9	11	12	14	22	25	27		
11.25° HORIZ. BEND	1	2	3	3	4	4	5	6	10	11	12	13		
90° VERT. OFFSET	29	41	53	64	74	95	115	134	214	246	276	304		
45° VERT. OFFSET	7	10	13	16	19	23	30	35	57	66	74	83		
22.5° VERT. OFFSET	3	4	6	7	8	10	12	15	23	27	31	34		
11.25° VERT. OFFSET	1	2	4	4	4	5	8	7	11	13	15	16		
PLUG (DEAD END)	32	45	56	70	83	107	129	151	244	288	326	364		
IN-LINE VALVE	32	45	45	45	45	55	60	80	110	125	140	155		
TEE (BRANCH RESTRAINT)	6" Ø	23	-	-	-	-	-	-	-	-	-	-		
	8" Ø	18	34	47	-	-	-	-	-	-	-	-		
	10" Ø	16	32	46	58	-	-	-	-	-	-	-		
	12" Ø	13	30	44	57	69	-	-	-	-	-	-		
	16" Ø	7	28	41	55	67	80	-	-	-	-	-		
	20" Ø	4	21	28	36	45	56	68	106	-	-	-		
	24" Ø	1	16	24	33	42	52	65	108	125	-	-		
	30" Ø	1	6	28	44	58	63	106	127	206	-	-		
	36" Ø	1	1	22	39	54	80	103	124	206	240	-		
	42" Ø	1	1	15	33	46	77	105	128	205	238	270		
	48" Ø	1	1	7	37	44	73	67	120	203	236	269	298	
REDUCER (LARGER PIPE RESTRAINT)	6" Ø	23	-	-	-	-	-	-	-	-	-	-		
	8" Ø	38	23	-	-	-	-	-	-	-	-	-		
	10" Ø	67	43	23	-	-	-	-	-	-	-	-		
	12" Ø	72	63	44	41	-	-	-	-	-	-	-		
	16" Ø	89	80	78	75	45	-	-	-	-	-	-		
	20" Ø	123	116	107	105	81	45	-	-	-	-	-		
	24" Ø	146	140	132	131	101	65	45	-	-	-	-		
	30" Ø	208	204	187	186	177	153	75	75	-	-	-		
	36" Ø	243	238	233	236	217	196	165	130	74	-	-		
	42" Ø	273	270	265	259	233	234	211	163	133	75	-		
	48" Ø	301	298	294	289	263	268	248	226	163	131	71	-	

- NOTES:
1. THE DATA IN THE ABOVE TABLE ARE BASED UPON THE FOLLOWING INSTALLATION CONDITIONS:
SOIL TYPE-SAND TEST PRESSURE-150 PSI/200 PSI DEPTH OF BURY-3' TRENCH TYPE-3 SAFETY FACTOR-1.5
MINIMUM PIPE LENGTH ALONG TEE RUN-5'
 2. THE RESTRAINED PIPE LENGTHS APPLY TO DUCTILE IRON AND PVC PIPE.
 3. ALL JOINTS BETWEEN UPPER AND LOWER BENDS SHALL BE RESTRAINED.
 4. RESTRAINED PIPE LENGTHS APPLY TO PIPE ON BOTH SIDES OF VALVES AND FITTINGS.

RESTRAINED JOINT INFORMATION

ENGINEERING STANDARDS 2022			
REVISIONS		ENGINEERING DIVISION CITY OF POMPAÑO BEACH	RESTRAINED JOINT INFORMATION
BY	DATE		
		SCALE: N.T.S.	DATE: MAY 2022 DWG. NO.
			118-3

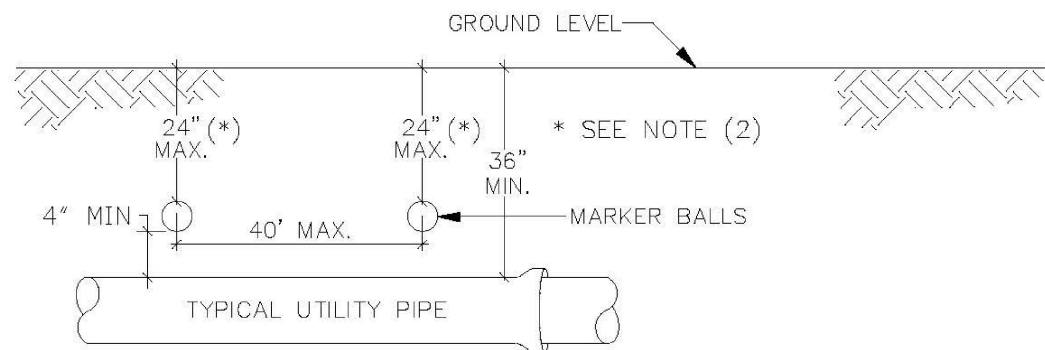

GENERAL NOTES:


1. ALL UTILITY PIPE SHALL BE INSTALLED WITH 4"Ø MARKING BALLS PLACED EVERY 40' AND AT EVERY FITTING, FOR IDENTIFICATION AND WARNING PURPOSES, BURIED ABOVE THE PIPE AT A MAXIMUM DEPTH OF 24 INCHES OR AS APPROVED BY THE OWNER. IT SHALL BE COLOR CODED AND WORDED AS FOLLOWS:
POTABLE WATER:
A. COLOR: BLUE PER 62-555.320(21)(b)(3) F.A.C.
B. LETTERING: WATER
C. FREQUENCY OF MARKER BALLS SHALL BE 145.7 Khz.
D. THE MARKER BALLS CAN BE BURIED IN ANY ORIENTATION.

THE MARKER BALLS SHALL BE DETECTABLE BY STANDARD METAL DETECTION EQUIPMENT AND SHALL BE MANUFACTURED BY TEMPO OR 3M LOCATOR SYSTEM OR EQUIVALENT (FREQUENCY 145.7 Khz)


2. FOR LARGE DIAMETER PIPE INSTALLED AT DEPTHS BELOW 4'-0" MARKER BALLS SHALL BE PLACED AT A MAXIMUM DEPTH OF 4'-0" BELOW GRADE .

WATER PIPE IDENTIFICATION


ENGINEERING STANDARDS 2022			
REVISIONS		ENGINEERING DIVISION CITY OF POMPAÑO BEACH	WATER PIPE IDENTIFICATION
BY	DATE		
S.S.	01/12	SCALE: N.T.S.	DATE: JAN. 2022 DWG. NO.
S.S.	06/16		119-1

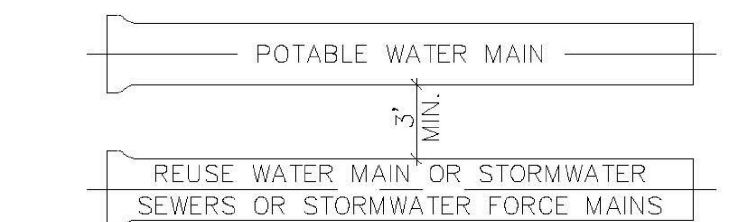

A MINIMUM HORIZONTAL SEPARATION .3' (OUTSIDE TO OUTSIDE), SHALL BE MAINTAINED BETWEEN POTABLE WATER MAINS AND STORMWATER SEWERS, STORMWATER FORCE MAINS AND REGULATED REUSE WATER MAINS.

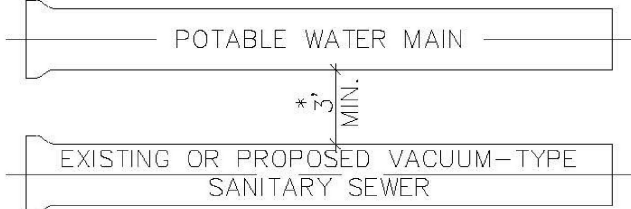


A MINIMUM HORIZONTAL SEPARATION .3' (OUTSIDE TO OUTSIDE), SHALL BE MAINTAINED BETWEEN EXISTING OR PROPOSED VACUUM-TYPE SANITARY SEWER. * SEE NOTE D(1)(B).

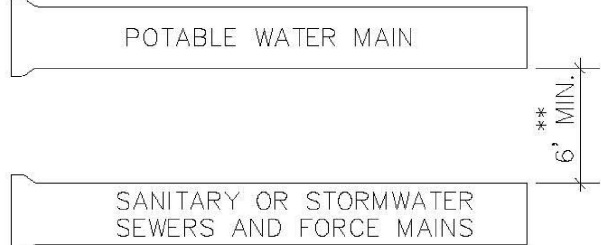

A MINIMUM HORIZONTAL SEPARATION OF 6' (OUTSIDE TO OUTSIDE), SHALL BE MAINTAINED BETWEEN POTABLE WATER MAINS AND EXISTING OR PROPOSED GRAVITY-OR PRESSURE TYPE SANITARY SEWER, WASTEWATER FORCE MAIN OR NOT REGULATED REUSE WATER MAIN. ** SEE NOTE D(1)(C).


MINIMUM HORIZONTAL SEPARATION REQUIREMENTS FOR POTABLE WATER, REUSE, STORMWATER AND SEWER LINES

ENGINEERING STANDARDS 2022			
REVISIONS		ENGINEERING DIVISION CITY OF POMPAÑO BEACH	MIN. HORIZONTAL SEPARATION FOR POTABLE WATER
BY	DATE		
S.S.	01/12	SCALE: N.T.S.	DATE: JAN. 2022 DWG. NO.
			121-1

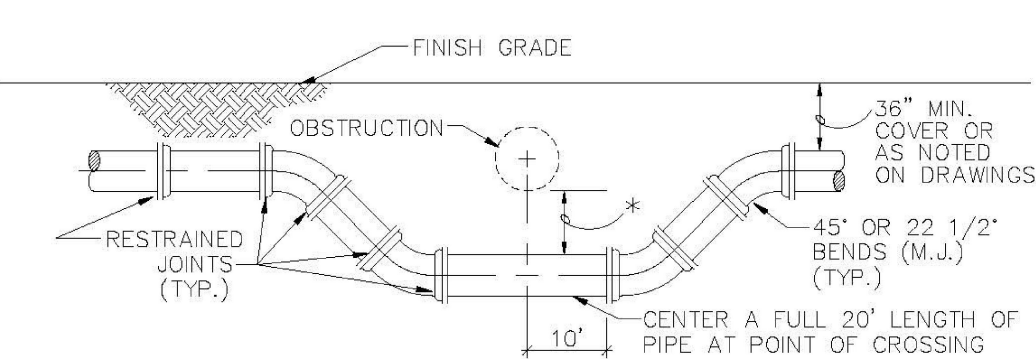

* 12" MINIMUM CLEARANCE REQUIRED FOR PRESSURE TYPE SANITARY SEWER, WASTEWATER OR STORMWATER FORCE MAIN OR REUSE WATER MAIN CROSSINGS, IF MINIMUM CLEARANCE CANNOT BE OBTAINED, REFER TO "PROTECTION OF POTABLE WATER SUPPLY" FOR WATER MAIN CROSSINGS. SEE NOTE 2(B), ON STANDARD NO. 122-3

6" MINIMUM CLEARANCE REQUIRED FOR WATER AND STORMWATER, SEWER MAIN CROSSINGS. SEE NOTE 2(A), ON STANDARD NO. 122-3.

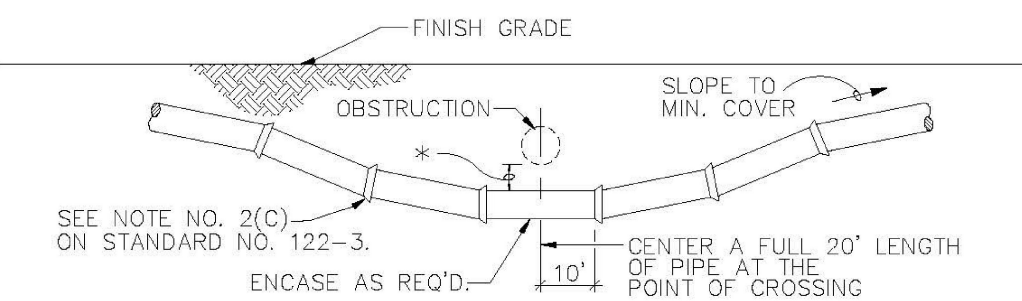

NOTES:

1. THE DEFLECTION TYPE CROSSING SHALL BE USED WHEREVER POSSIBLE. ONLY UNDER SPECIFIC ORDERS BY THE ENGINEER SHALL THE FITTING TYPE CROSSING BE ALLOWED.
2. CONSTRUCT STANDARD CROSSING USING NO MORE THAN 75% OF MANUFACTURER'S MAXIMUM JOINT DEFLECTION.
3. FOR POTABLE WATER MAINS, REFER TO "PROTECTION OF POTABLE WATER SUPPLY".

UTILITY CROSSINGS

ENGINEERING STANDARDS 2022			
REVISIONS		ENGINEERING DIVISION CITY OF POMPAÑO BEACH	UTILITY CROSSINGS
BY	DATE		
S.S.	01/12	SCALE: N.T.S.	DATE: JAN. 2022 DWG. NO.
			122-1

PROTECTION OF POTABLE WATER SUPPLY NOTES

A. GENERAL

IN ADDITION TO THESE REQUIREMENTS, ALL POTABLE WATER MAINS CONSTRUCTED IN THE MONITY OF STORM SEWERS, SANITARY SEWERS OR FORCE MAINS SHALL COMPLY WITH THE APPLICABLE PROVISIONS OF FLORIDA ADMINISTRATIVE CODE CHAPTER 62-555, GREAT LAKES-UPPER MISSISSIPPI RIVER BOARD OF STATE SANITARY ENGINEERS (GLUMRB) "RECOMMENDED STANDARDS FOR WATER WORKS", AND GLUMRB "RECOMMENDED STANDARDS FOR WASTEWATER FACILITIES".

B. DEFINITIONS

FOR THE PURPOSES OF THIS SPECIFICATION, THE WORDS "OTHER PIPE" OR "OTHER PIPES" SHALL MEAN SANITARY SEWER MAIN, SEWAGE FORCE MAIN, STORMWATER MAIN OR ANY COMBINATION THEREOF.

C. CROSS CONNECTIONS PROHIBITED

THERE SHALL BE NO PHYSICAL CONNECTIONS BETWEEN A PUBLIC OR PRIVATE POTABLE WATER SUPPLY SYSTEM AND ANY OTHER PIPE OR APPURTENANCE THERETO WHICH WOULD PERMIT THE PASSAGE OF ANY WASTEWATER, POLLUTED WATER, OR ANY OTHER WATER INTO THE POTABLE SUPPLY. NO WATER PIPE SHALL PASS THROUGH OR COME INTO CONTACT WITH ANY PART OF A SANITARY SEWER MANHOLE OR STORMWATER MANHOLE.

D. RELATION OF OTHER PIPES TO POTABLE WATER MAINS


1. HORIZONTAL SEPARATION

A. NEW OR RELOCATED, UNDERGROUND WATER MAINS SHALL BE LAID TO PROVIDE A HORIZONTAL DISTANCE OF AT LEAST THREE FEET BETWEEN THE OUTSIDE OF THE WATER MAIN AND THE OUTSIDE OF ANY EXISTING OR PROPOSED STORM WATER, STORM WATER FORCE MAIN, OR PIPELINE CONVEYING REUSE WATER NOT REGULATED UNDER PART III OF CHAPTER 62-610, F.A.C.

B. NEW OR RELOCATED, UNDERGROUND WATER MAINS SHALL BE LAID TO PROVIDE A HORIZONTAL DISTANCE OF AT LEAST THREE FEET, AND PREFERABLY TEN FEET, BETWEEN THE OUTSIDE OF THE WATER MAIN AND THE OUTSIDE OF ANY EXISTING OR PROPOSED VACUUM-TYPE SANITARY SEWER.

C. NEW OR RELOCATED, UNDERGROUND WATER MAINS SHALL BE LAID TO PROVIDE A HORIZONTAL DISTANCE OF AT LEAST SIX FEET, AND PREFERABLY TEN FEET, BETWEEN THE OUTSIDE OF THE WATER MAIN AND THE OUTSIDE OF ANY EXISTING OR PROPOSED GRAVITY-OR PRESSURE-TYPE SANITARY SEWER, WASTEWATER FORCE MAIN, OR PIPELINE CONVEYING REUSE WATER NOT REGULATED UNDER CHAPTER 62-610, F.A.C. THE MINIMUM HORIZONTAL SEPARATION DISTANCE BETWEEN WATER MAINS AND GRAVITY TYPE SEWERS SHALL BE REDUCED TO THREE FEET WHERE THE BOTTOM OF THE WATER IS LAID AT LEAST SIX INCHES ABOVE THE TOP OF THE SEWER.

ENGINEERING STANDARDS 2022			
REVISIONS		ENGINEERING DIVISION CITY OF POMPAÑO BEACH	POTABLE WATER SUPPLY NOTES
BY	DATE		
S.S.	01/12	SCALE: N.T.S.	DATE: JAN. 2022 DWG. NO.
			122-2

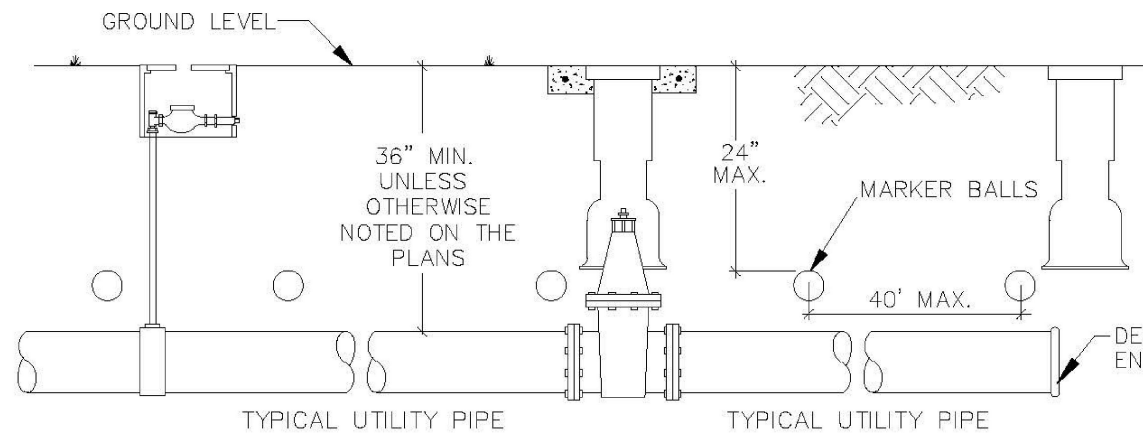

GENERAL NOTES:

1. ALL NONMETALLIC PIPE SHALL BE INSTALLED WITH 12 THHN SOLID COPPER TRACING WIRE.
2. THE MARKER BALLS MUST BE INSTALLED DIRECTLY ABOVE THE PIPE.
3. MARKER BALLS SHALL BE INSTALLED AT 40' O.C.
4. BALL COLOR CODING:
POTABLE WATER SYSTEM: BLUE PER 62-555.320(21)(b)(3) F.A.C.

UTILITY PIPE AND MARKER BALLS LOCATION

ENGINEERING STANDARDS 2022			
REVISIONS		ENGINEERING DIVISION CITY OF POMPAÑO BEACH	UTILITY PIPE AND MARKER BALLS LOCATION
BY	DATE		
S.S.	01/12	SCALE: N.T.S.	DATE: JAN. 2022 DWG. NO.
S.S.	06/16		120-1

D. NEW OR RELOCATED, UNDERGROUND WATER MAINS SHALL BE LAID TO PROVIDE A HORIZONTAL DISTANCE OF AT LEAST TEN FEET BETWEEN THE OUTSIDE OF THE WATER MAIN AND ALL PARTS OF ANY EXISTING OR PROPOSED "ON-SITE SEWAGE TREATMENT AND DISPOSAL SYSTEM".

2. VERTICAL SEPARATION

A. NEW OR RELOCATED, UNDERGROUND WATER MAINS CROSSING ANY EXISTING OR PROPOSED GRAVITY-OR VACUUM-TYPE SANITARY SEWER OR STORM SEWER SHALL BE LAID SO THE OUTSIDE OF THE WATER MAIN IS AT LEAST SIX INCHES, AND PREFERABLY 12 INCHES, ABOVE OR AT LEAST 12 INCHES BELOW THE OUTSIDE OF THE OTHER PIPELINE. HOWEVER, IT IS PREFERABLE TO LAY THE WATER MAIN ABOVE THE OTHER PIPELINE.


B. NEW OR RELOCATED, UNDERGROUND WATER MAINS CROSSING ANY EXISTING OR PROPOSED PRESSURE-TYPE SANITARY SEWER, WASTEWATER DR STORM WATER FORCE MAIN, OR PIPELINE CONVEYING REUSE WATER SHALL BE LAID SO THE OUTSIDE OF THE WATER MAIN IS AT LEAST 12 INCHES, ABOVE OR BELOW THE OUTSIDE THE OTHER PIPELINE. HOWEVER, IT IS PREFERABLE TO LAY THE WATER MAIN ABOVE THE OTHER PIPELINE.

C. AT THE UTILITY CROSSINGS DESCRIBED IN PARAGRAPHS (A) AND (B) ABOVE, ONE FULL LENGTH OF WATER MAIN PIPE SHALL BE CENTERED ABOVE OR BELOW THE OTHER PIPELINE SO THE WATER MAIN JOINTS WILL BE AS FAR AS POSSIBLE FROM THE OTHER PIPELINE. ALTERNATIVELY, AT SUCH CROSSINGS, THE PIPES SHALL BE ARRANGED SO THAT ALL WATER MAIN JOINTS ARE AT LEAST THREE FEET FROM ALL JOINTS IN VACUUM-TYPE SANITARY SEWERS, STORM SEWERS, STORM WATER FORCE MAINS, OR PIPELINES CONVEYING REUSE WATER REGULATED UNDER PART III OF CHAPTER 62-610, F.A.C. AND AT LEAST SIX FEET FROM ALL JOINTS IN GRAVITY- OR PRESSURE-TYPE SANITARY SEWERS, WASTEWATER FORCE MAINS, OR PIPELINES CONVEYING REUSE WATER NOT REGULATED UNDER PART III OF CHAPTER 62-610, F.A.C.

WHERE THE HORIZONTAL CAN BEING LOCATED LESS THAN THE REQUIRED MINIMUM DISTANCES FROM JOINTS IN THE OTHER PIPELINE OR THE HORIZONTAL IS LESS THAN THREE FEET FROM ANOTHER PIPELINE OR THE UNDER GROUND WATER MAIN IS CROSSING ANOTHER PIPELINE AND IS LESS THAN THE REQUIRED MINIMUM VERTICAL DISTANCE FROM THE OTHER PIPELINE, THE CONTRACTOR SHALL CONTACT THE ENGINEER IMMEDIATELY FOR RECOMMENDED SOLUTIONS TO MEET THE FLORIDA OF DEPARTMENT OF ENVIRONMENTAL PROTECTION REQUIREMENTS PER CHAPTER 62-555, F.A.C.

PROTECTION OF POTABLE WATER SUPPLY NOTES

ENGINEERING STANDARDS 2022			
REVISIONS		ENGINEERING DIVISION CITY OF POMPAÑO BEACH	POTABLE WATER SUPPLY NOTES
BY	DATE		
S.S.	01/12	SCALE: N.T.S.	DATE: JAN. 2022 DWG. NO.
			122-3

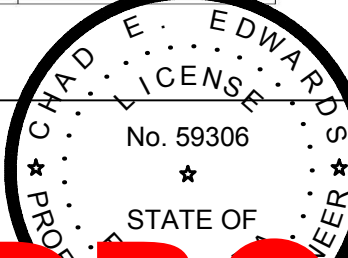

This document has been digitally signed and sealed by Chad Edwards, P.E. as indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

PZ24-1288826

04.02.2025

CRAVEN · THOMPSON AND ASSOCIATES, INC.
ENGINEERS · PLANNERS · SURVEYORS
35651 N.W. 53RD STREET, FORT LAUDERDALE, FLORIDA 33309
FAX: (954) 739-6409 TEL: (954) 739-6400
FLORIDA LICENSED ENGINEERS, SURVEYORS & PLANNERS BUSINESS NO. 271
FLORIDA LICENSED LANDSCAPE ARCHITECTURE BUSINESS NO. C000