



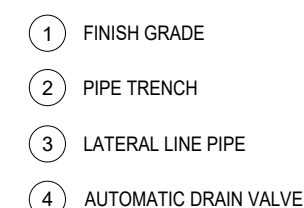




- 1 PAVEMENT SURFACE
- 2 FINISH GRADE
- 3 TRENCH BACKFILL
- 4 LOCATOR WIRE (WIBURED CAUTION TAPE)
- 5 PVC IRRIGATION LATERAL
- 6 SAND BACKFILL
- 7 SCH 40 PVC LATERAL SLEEVE - SEE PLANS FOR SIZE
- 8 SCH 40 PVC WIRE SLEEVE FOR CONTROL WIRES, MIN. 2" DIA
- 9 SCH 40 PVC MAINLINE SLEEVE - SEE PLANS FOR SIZE
- 10 PVC IRRIGATION MAINLINE
- 11 CONTROL WIRES - TAPE TO MAINLINE AT 10' INTERVALS
- 12 PVC CAP. SOLVENT WELDED



- 1 CITY MAINLINE
- 2 TAP
- 3 SERVICE LINE
- 4 WATER METER
- 5 ISOLATION VALVE (PER PLAN)
- 6 MANUAL DRAIN VALVE (BALL VALVE)
- 7 BLOW OFF VALVE (BOV)
- 8 BACKFLOW DEVICE (WHERE SHOWN)



- WINTERIZATION PROCEDURE:**
1. TURN OFF EITHER THE METER AND ISOLATION VALVE (DEDICATED IRRIGATION METER) OR ISOLATION VALVE (DOMESTIC TAP).
  2. OPEN ONE CONTROL VALVE TO RELIEVE PRESSURE
  3. SLOWLY OPEN MANUAL DRAIN VALVE
  4. REPEAT PROCEDURE FOR ALL MANUAL DRAIN VALVES ALONG IRRIGATION MAINLINE.
  5. CLOSE MANUAL DRAIN VALVES AND BLOW OUT REMAINING WATER FROM THE BLOWOUT VALVE. SLOWLY INCREASE AIR PRESSURE. NOT TO EXCEED 80 PSI. DO NOT BLOWOUT SYSTEM FROM BACKFLOW. BLOWOUT SYSTEM TWICE BUT NOT TO EXCEED AT MORE THAN 2 MIN. INTERVALS.

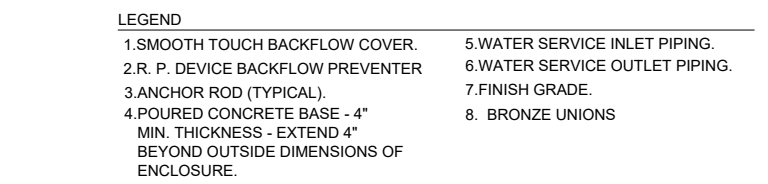

	Date	Comment
1	07/16/25	DRC COMMENTS

Project Number	
Date	07/16/2025
Drawn By	RNK
Checked By	MNB