


WATER FLOW TEST SUMMARY SHEET

| Hyd. No. | Outlet I.D. inches | Pitot Press. psi | Flow gpm | Residual psi | Date: 12/01/21 Time: 24 HOURS Job #: 21EB-0365 |
|------------|--------------------|------------------|----------|--------------|--|
| 1 | 2.5" | — | 1,250 | 73 | Job Name: HIDDEN HARBOUR, LLC. |
| 2 | — | — | — | — | Address: 2315 N.E. 15 STREET |
| 3 | — | — | — | — | Test Done By: PHILLIPS FIRE SPRINKLERS, INC. |
| Total Flow | | | 1,250 | 73 | Static Press: 79 psi Flow @ 20 psi >2,000 gpm |

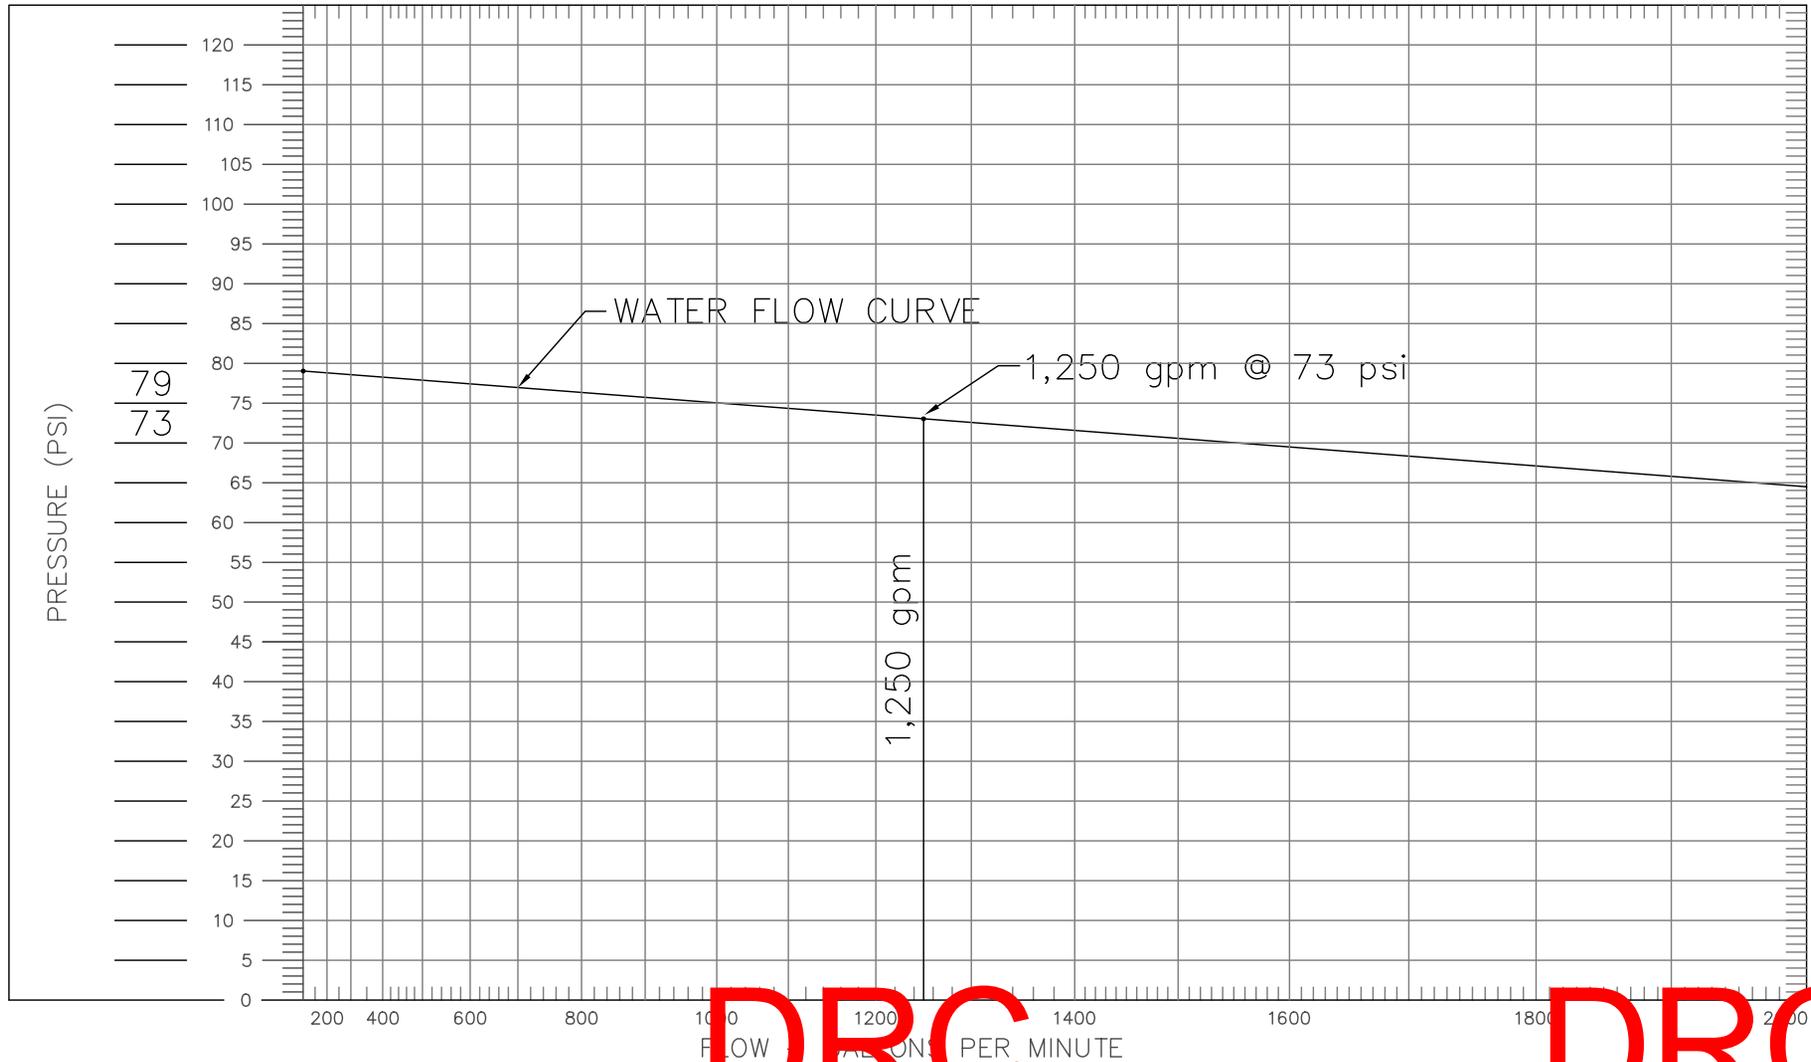

DRC

PZ21-12000040
2/16/2022

DRC

PZ21-12000040
1/05/2022