



GATE OR PLUG VALVE SETTING


ALL D.I.P. TO BE PAINTED
BLUE ON TOP HALF OF PIPE

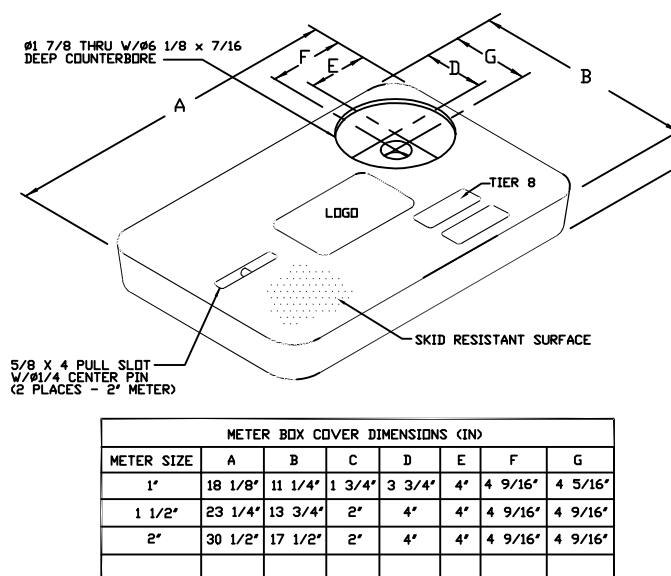

POTABLE WATER METER BOX COVER

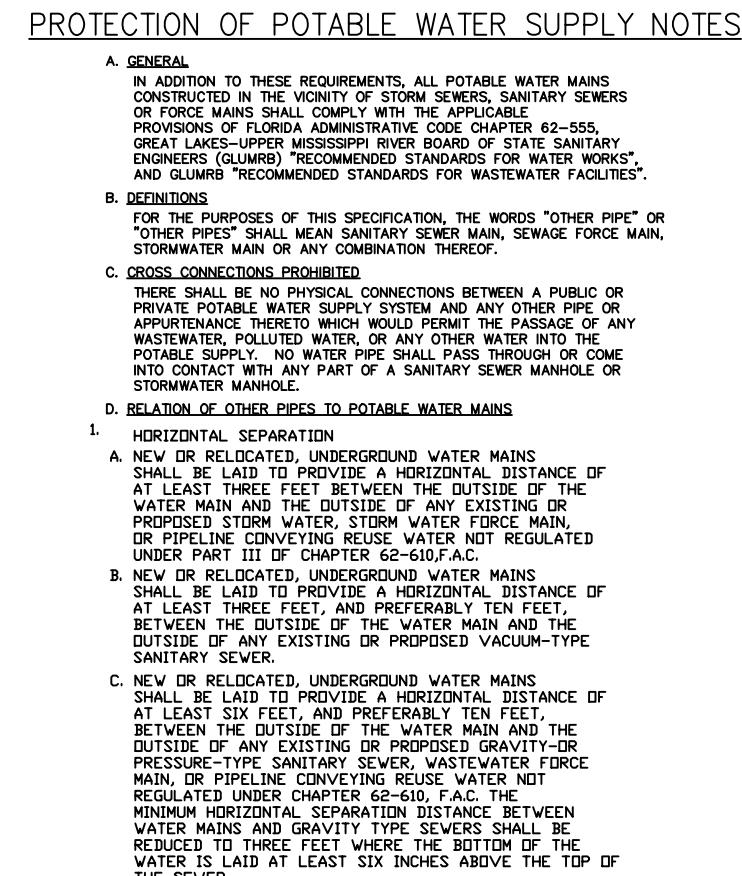


ENGINEERING STANDARDS 2018			
REVISIONS		ENGINEERING DIVISION CITY OF POMPANO BEACH	POTABLE WATER SUPPLY NOTES
BY	DATE		
S.S.	01/12		
SCALE: N.T.S.		DATE: JAN. 2012 DWG. NO. 122-2	

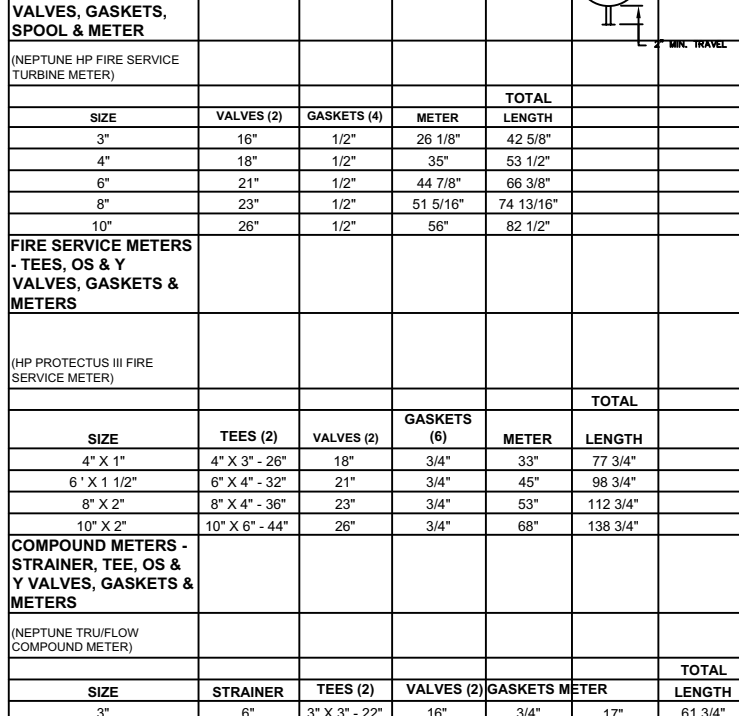


TYPICAL METER BANK

USE MEGALUGS AT ALL PIPE JOINTS

ALL D.I.P. TO BE PAINTED BLUE
ON THE TOP HALF OF PIPE.

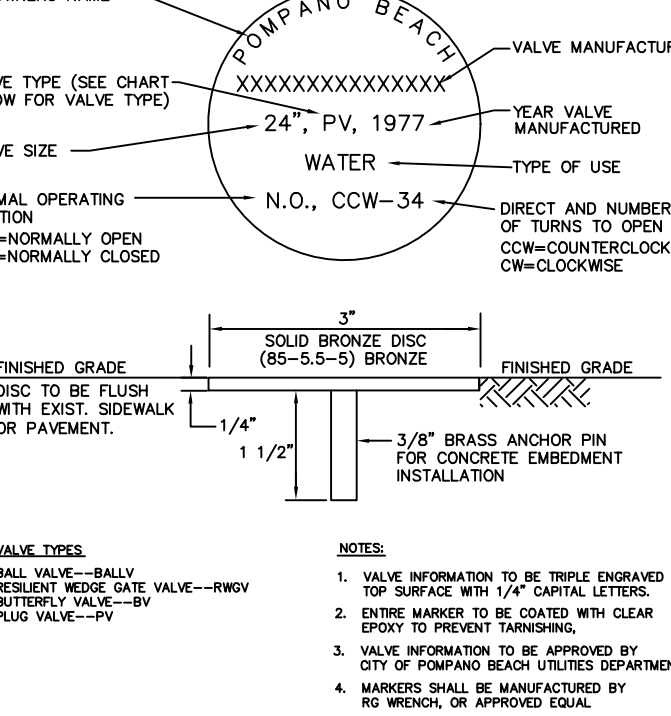


UNDERGROUND VALVE IDENTIFICATION MARKER

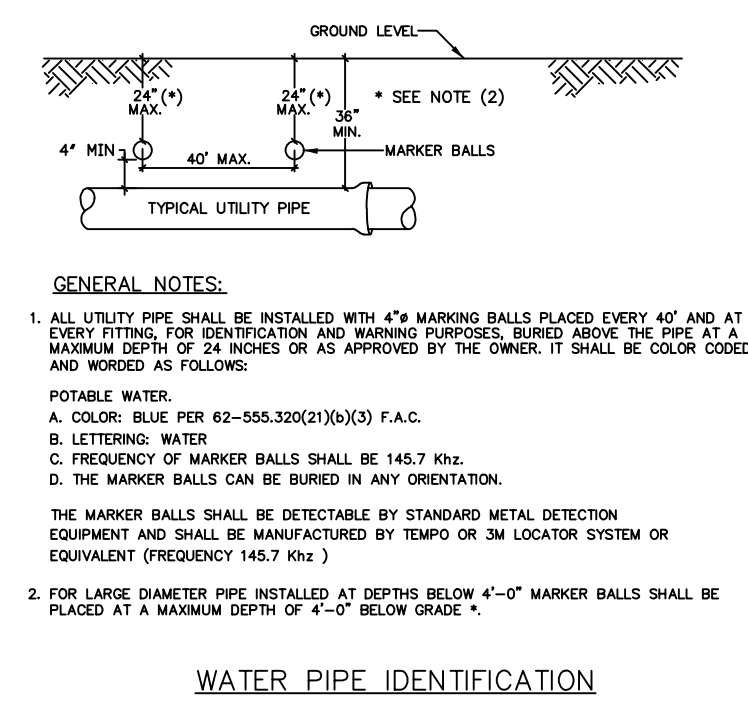


WATER PIPE IDENTIFICATION

ENGINEERING STANDARDS 2018			
REVISIONS		ENGINEERING DIVISION CITY OF POMPANO BEACH	POTABLE WATER SUPPLY NOTES
BY	DATE		
S.S.	01/12		
SCALE: N.T.S.			DATE: JAN. 2012 DWG. NO. 122-3

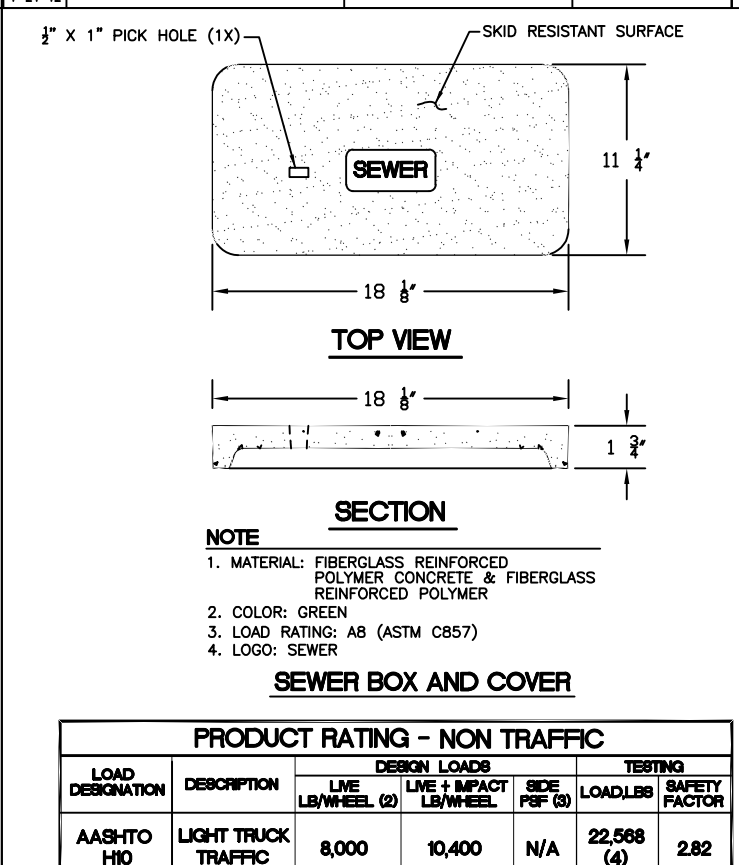


SERVICE LATERALS WITH RISERS

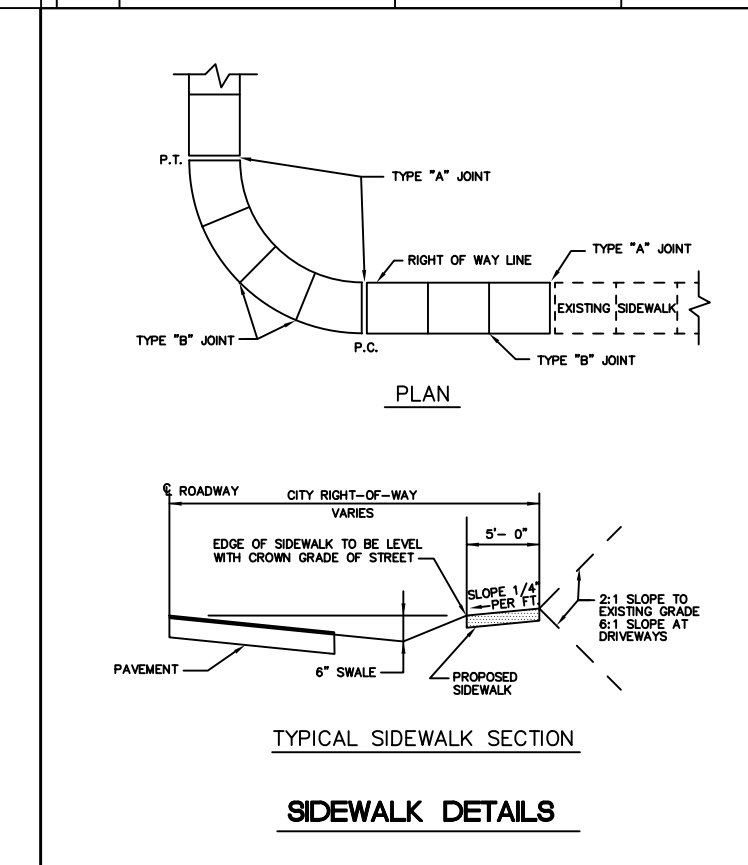

SIDEWALK DETAILS


TABLE OF SIDEWALK JOINTS	
TYPE	LOCATION
"A"	JOINT SHALL BE PLACED AT P.C. AND P.T. OF CURVES, JUNCTION OF EXISTING SIDEWALKS, EVERY 60' ON NEW SIDEWALKS AND MIXED SIDEWALKS AND PRECAST CONCRETE CURBS, DRIVEWAYS AND SIMILAR STRUCTURES.
"B"	JOINT SHALL BE PLACED 5'-0" CENTER
"C"	JOINT SHALL BE PLACED AT 20' INTERVALS



1/8" 1/2"

1/2" RADIUS


TYPE "A" JOINT



1/8" 1/2"

1/2" RADIUS

TYPE "B" JOINT



1/8" 1/2"

1/2" RADIUS

TYPE "C" JOINT

NOTE: SIDEWALK SHALL BE 4" THICK EXCEPT IN DRIVEWAYS WHERE THE THICKNESS SHALL BE 6".

SIDEWALK DETAILS

SIDEWALK DETAILS

ENGINEERING STANDARDS 2018			
REVISONS		ENGINEERING DIVISION CITY OF POMPANO BEACH	SIDEWALK DETAILS
BY	DATE		
SCALE: N.T.S.			DATE: JUNE 2007 DWG. NO. 301-2