

DRC

PZ25-12000001

05/06/2025

AMERICAN EAGLE FIRE PROTECTION, INC.

4711 North Dixie Highway – Boca Raton, FL 33431

Telephone: 561-750-3698 – Fax: 561-750-8496

LIC # 33490800012003


FLOW TEST B

STATIC PRESSURE (psi)	RESIDUALPRESSURE (psi)	PITOT PRESSURE (psi)	PITOT FLOW (gpm)	OUTLET SIZE
80	78	38	1016	2"

Address: 2400 E. Atlantic Boulevard, Pompano Beach

Flow Test Date: Wednesday, January 22nd 2025 at 8:30a.m. – Thursday, January 23rd, 2025 at 8:30 a.m.

Sketch of Test Location

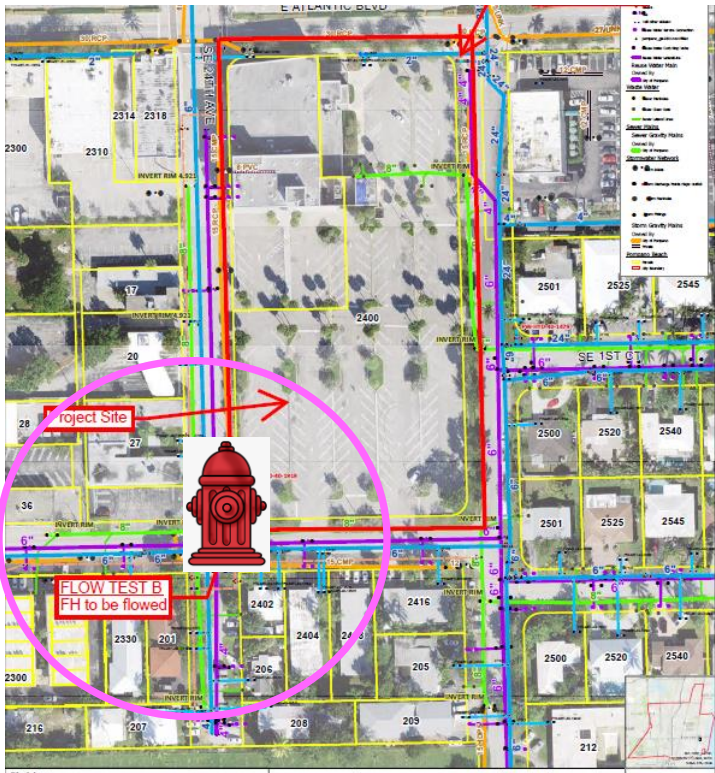

X *Dario Cimetta*

American Eagle Technician

1-23-25

Date

DRC

DRC

PZ25-12000001

05/21/2025

PZ25-12000001

04/02/2025