



SECTION A-A

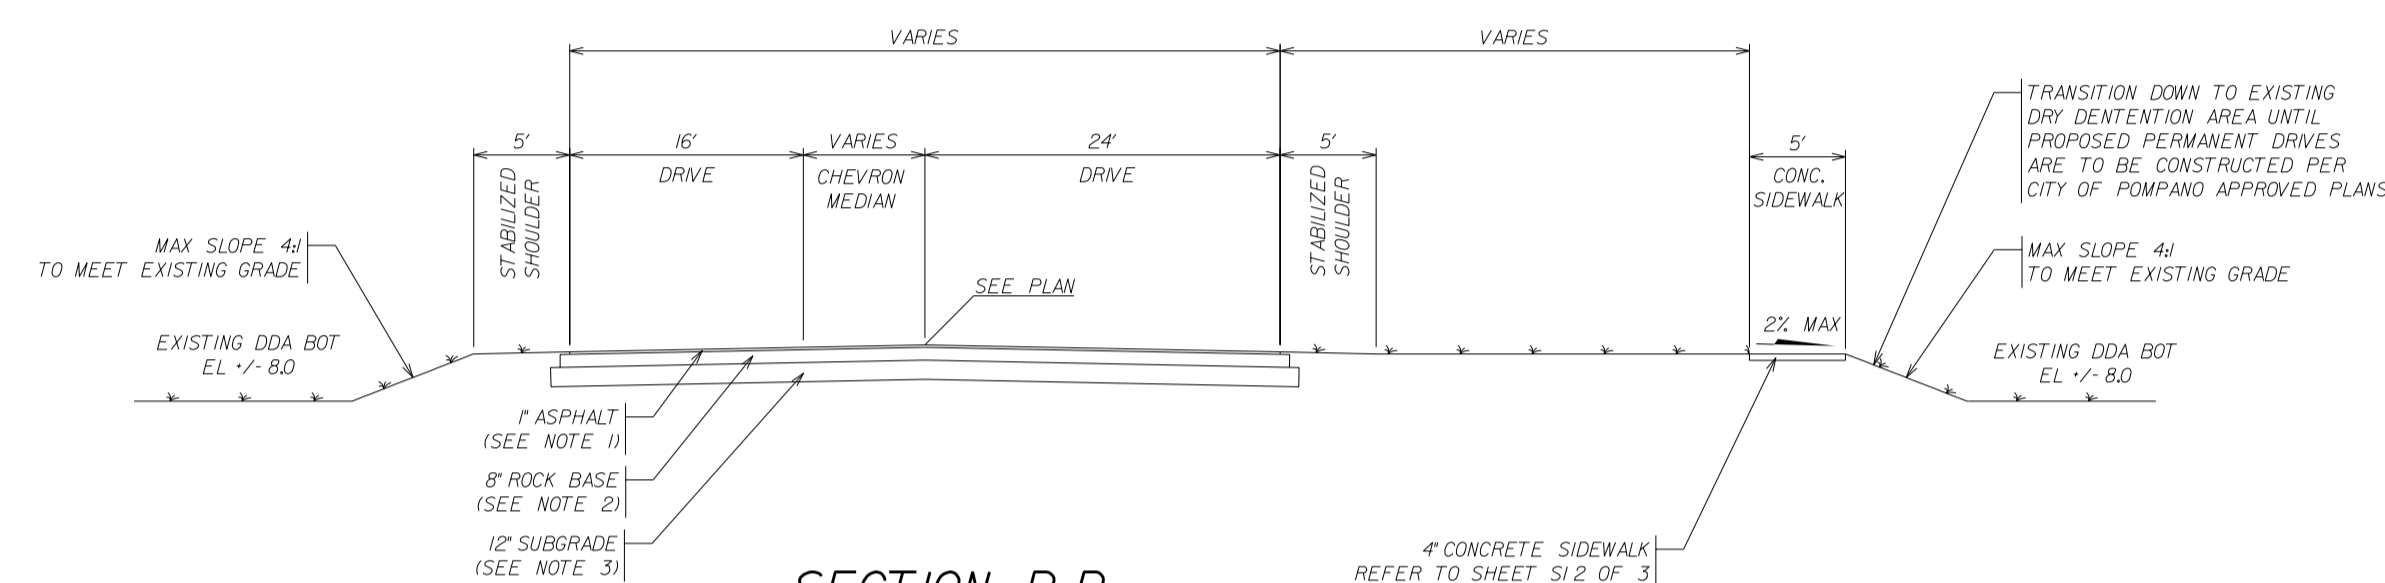


SECTION B-B

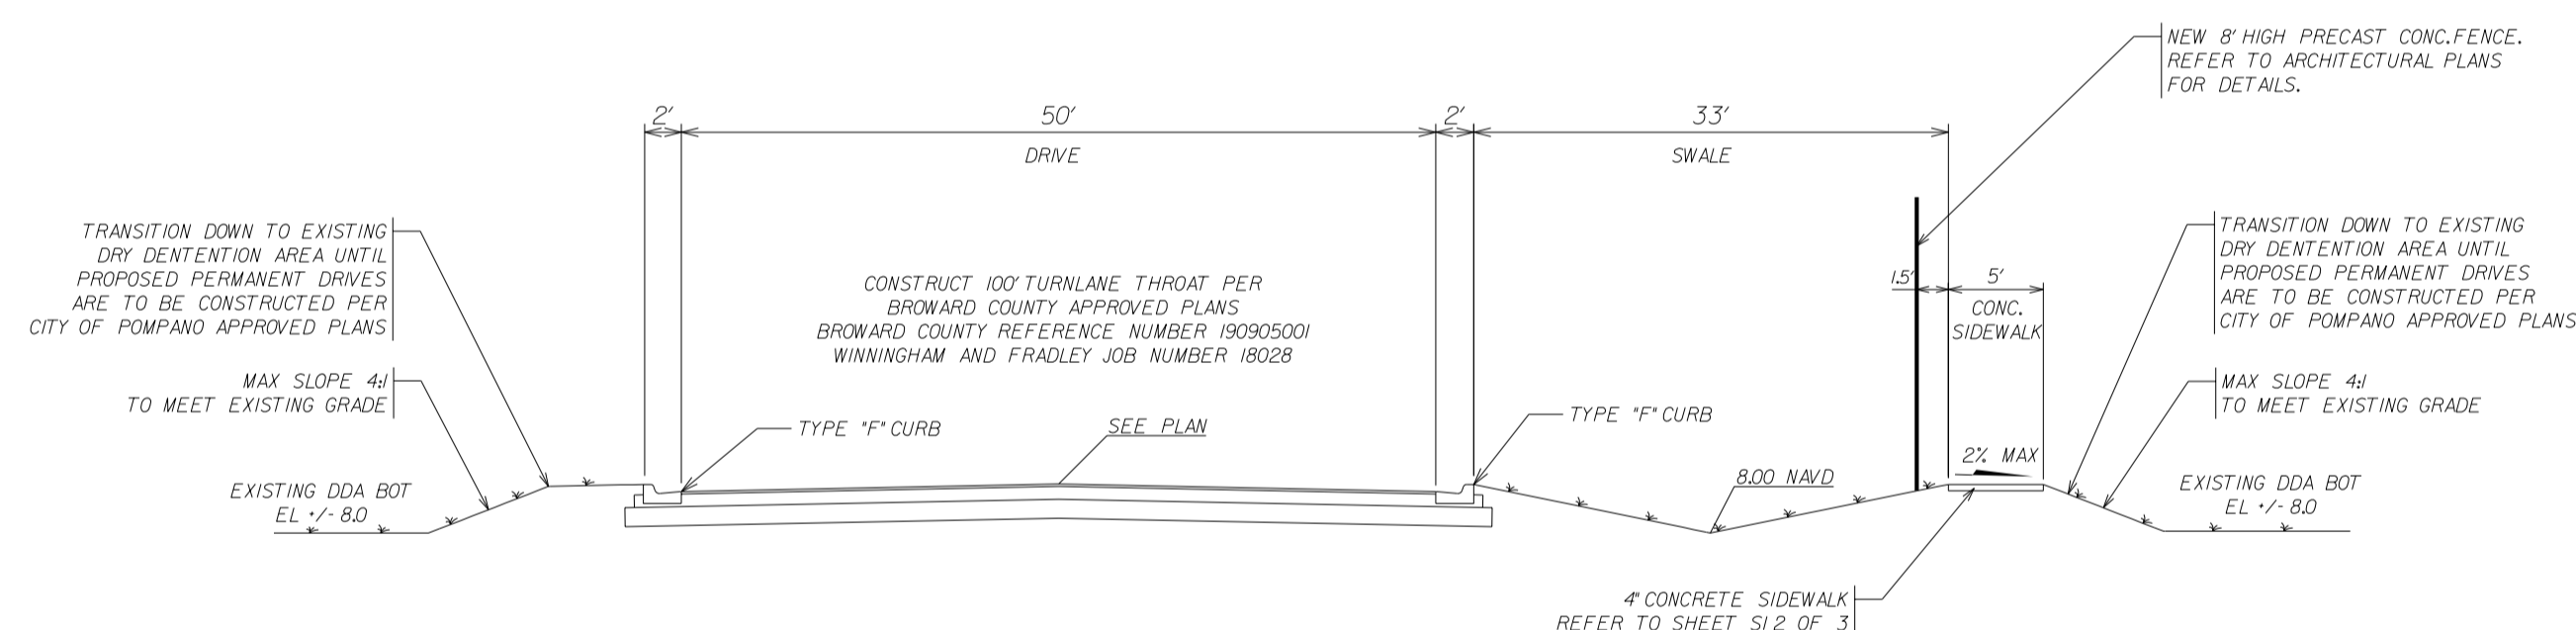


SECTION C-C

NOTES:

1. PA/EMENT SHALL BE 4" THICK (MIN), LAD IN ONE COURSE TYPE SP-95 ASPHALTIC CONCRETE SURFACE COURSE WITH TACK COAT.
2. 8" LIME ROCK BASE SHALL BE PLACED IN TWO 4 INCH LIFTS. THE BOTTOM TWO LIFTS SHALL BE DOT-DRAPEED BASE ROCK WITH A MINIMUM LBER OF 100 LB/ SQ YD. BASE ROCK SHALL BE PRIMED IN ACCORDANCE WITH SECTION 300 OF THE FDOT STANDARD SPECIFICATION. THE REMAINING TWO LIFTS SHALL BE PLACED TO THE MINIMUM LBER OF 100 LB/ SQ YD. THE REMAINING TWO LIFTS SHALL BE COMPACTED TO NOT LESS THAN 98% MAXIMUM DRY DENSITY AS DETERMINED BY AASHTO D1-100.
3. SUBGRADE MATERIAL SHALL BE IN ACCORDANCE WITH SECTION 160 OF THE FDOT, STANDARD SPECIFICATIONS. ALL SUBGRADE SHALL HAVE A MINIMUM LBER OF 40 AND SHALL BE COMPACTED TO NOT LESS THAN 100% MAXIMUM DRY DENSITY AS DETERMINED BY AASHTO D1-100.
4. BASE AND SUBGRADE DENSITY TESTS SHALL BE CONDUCTED FOR A MAXIMUM 7000 SQUARE FEET OF FINISHED PAVEMENT OR @ 300 INTERVALS MAX.
5. PRIME COAT SHALL BE APPLIED AT A RATE OF 0.25 GALONS PER SQUARE YARD. PRIME AND TACK COAT FOR BASE SHALL CONFORM TO THE REQUIREMENTS AND SPECIFICATIONS OF SECTION 3001 THROUGH 3007 OF FDOT, STANDARDS SPECIFICATION.
6. PROCTOR SHALL BE PERFORMED ON ALL MATERIAL SUBGRADE AND BASE AND SUBSEQUENT CHANGES IN MATERIAL. LIME ROCK BEARING RATIO, SIEVE ANALYSIS AND DENSITIES REQUIRED BY THE CONTRACT DOCUMENTS SHALL BE SUBMITTED TO BROWARD COUNTY AND THE CITY OF FORT LAUDERDALE.
7. ALL REPAIRS TO EXISTING PAVEMENT SHALL RECEIVE SAW CUT EDGES PRIOR TO SEALING ASPHALT.
8. MINIMUM LONGITUDINAL SLOPE OF PAVEMENT SHALL BE 0.30%.
9. DEMOLITION IF ANY SHALL BE IN ACCORDANCE WITH BROWARD COUNTY MINIMUM STANDARDS OR AS DIRECTED BY GEOTECHNICAL ENGINEER.
10. EMANKMENT MATERIAL MINIMUM LBER 40 COMPACTED IN 8" LIFTS TO 100% MAXIMUM DRY DENSITY. EMANKMENT SHALL BE PLACED IN 4" LIFTS AND SHALL NOT CONTAIN ANY ORGANIC MATERIAL SUCH AS ROOTS, GRASS, ETC.

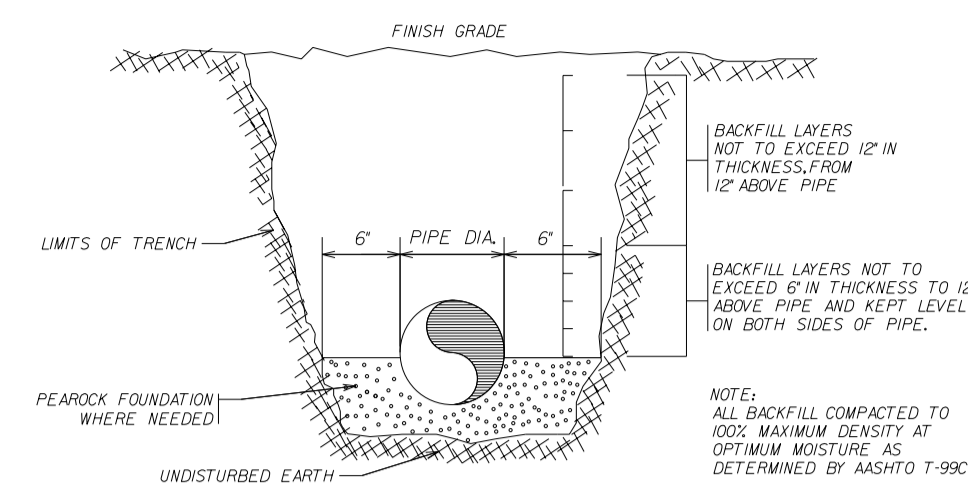


PIPE BEDDING DETAIL

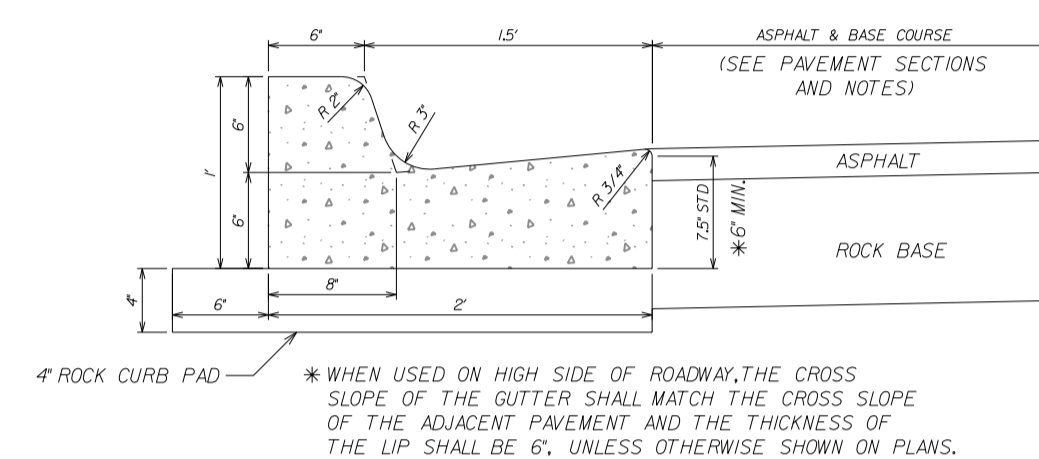

TYPE "F" CURB & GUTTER

NOTE:
CONCRETE SHALL BE 3000 psi AT 28 DAYS

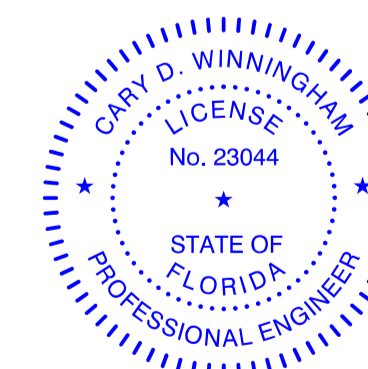

This item has been electronically signed
and sealed with a Digital Signature by:
Cary D Winningham
2023.06.01 12:34:41 -04'00'
Printed copies of this document are not
considered signed and sealed and must
be verified on any electronic copies.

<h2 style="margin: 0;">SITE IMPROVEMENTS</h2> <h2 style="margin: 0;">SECTIONS & DETAILS</h2> <h3 style="margin: 0;">BONSAL POMPANO</h3> <h3 style="margin: 0;">OLDCASTLE COASTAL</h3>			
<div style="display: flex; justify-content: space-between; align-items: center;"> <div style="text-align: left;"> <p>WINNINGHAM & ERADLEY INC. ENGLAND, FL 32045 101 N.E. 44th STREET, OAKLAND PARK, FL 33066 TEL: 772-7440 FAX: 772-7441 WWW.WEINC.COM</p> </div> <div style="text-align: right;"> <p>DATE: 08/20/2023 DRAWN: AMF CHECKED: WTV PUBLISHED: 6/1/2023, 11/4/23</p> </div> </div>			
DESIGNED: CJD/GSSB DATE: 08/20/2023		APPROVED: _____ DATE: 08/20/2023 PROJECT: 18-08 SHEET: 3	
DRAWING: AMF DATE: 08/20/2023		EB-000299 LB-000299	