




TO THE BEST OF MY KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AND THE APPLICABLE FIRE-SAFETY STANDARDS AS DETERMINED BY THE LOCAL AUTHORITY IN ACCORDANCE WITH THIS SECTION AND 633 FLORIDA STATUTES.

STEPHANE L'ECUYER
AR 93637

ISSUE FOR:

AAC SUBMITTAL

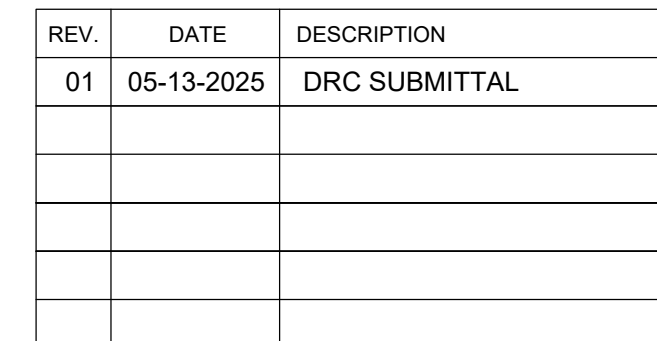

ALL MEASUREMENTS MUST BE VERIFIED BEFORE
BEGINNING THE WORKS. NO MEASUREMENTS ARE TO
BE SCALED DIRECTLY FROM THIS DRAWING.

Key section

Luminaire Schedule									
Symbol	Qty	Label	Arrangement	Description	LLF	Luminaire Lumens	Luminaire Watts	Total Watts	
	2	WA	Single	Xtra Light VNM-20000L-40K-DIM-3M-N-XX-XX-HSS	0.900	14972	152	304	
	2	SB	Back-Back	Xtra Light VNM-20000L-40K-DIM-3M-N-XX-XX-HSS	0.900	29945	304	608	
	1	SA	Single	Xtra Light VNM-20000L-40K-DIM-3M-N-XX-XX-HSS	0.900	14972	152	152	
	11	G2E	Single	SLG Lighting PG L8100 G3 FSK (32W) (Connected to Generator)	0.900	4480	48	480	
	10	G2	Single	SLG Lighting PG L8100 G3 FSK (32W)	0.900	4480	48	480	
	10	G1E	Single	SLG Lighting PG L5100 G3 FSK (48W) (Connected to Generator)	0.900	6380	48	480	
	10	G1	Single	SLG Lighting PG L5100 G3 FSK (48W)	0.900	6380	48	480	
	10	G1	Single	SLG Lighting PG L5100 G3 FSK (48W)	0.900	6380	48	480	
	10	G1	Single	SLG Lighting PG L5100 G3 FSK (48W)	0.900	6380	48	480	
	10	G1	Single	SLG Lighting PG L5100 G3 FSK (48W)	0.900	6380	48	480	

Calculation Summary							
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
Loading Dock	Illuminance		2.18	4.5	0.3	7.27	15.00
New Parking Garage	Illuminance		3.352	9.3	0.3	11.73	31.00
Rat+140_she08	Illuminance		2.47	6.5	0.3	8.27	24.00