DRC
PZ23-12000054
08/06/2025

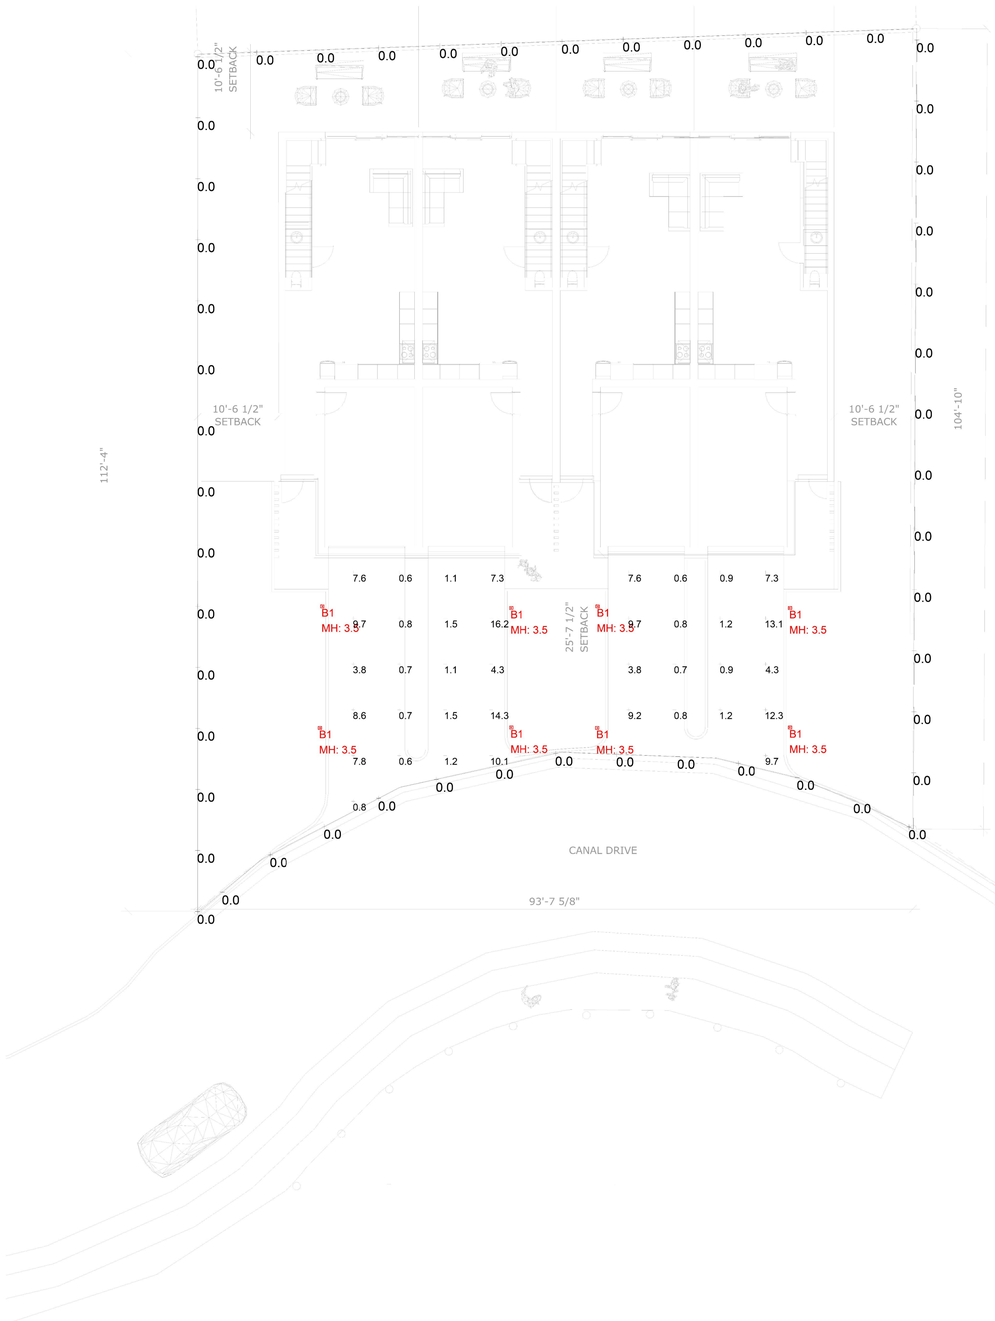

Photometrics Calculation Software Generated Luminaire Schedule

Symbol	Qty	Label	Arrangement	Lum. Lumens	Arr. Lum. Lumens	LLF	Lum. Watts	Arr. Watts
	6	B1	Single	1277	1277	0.900	15.5	15.5

Calculation Summary

Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
DRIVEWAY	Illuminance	Fc	4.85	16.2	0.6	8.08	27.00
PROPERTY LINE @ 5' AFG	Illuminance	Fc	0.00	0.0	0.0	N.A.	N.A.

Canal Drive Pompano

POMPANO BEACH, FL

LIGHTING FIXTURE SCHEDULE

TYPE	PHOTO/LINK	DESCRIPTION	MFR	CATALOG NUMBER	VOLTS	COLOR TEMP	INPUT WATTS	FINISH	DIMMING	MOUNTING	NOTES
S1		BOLLARD SITE	LUMIERE	303-B1-LEDB2-4000-UNV-T4-DIM10-FINISH-42	UNV	4000	15.5W	TBD	0-10V	GROUND	

LIGHTING SCHEDULE NOTES:

NOTE 1:

1. FOR QUESTIONS PERTAINING TO THIS FIXTURE SCHEDULE PLEASE CONTACT QUOTATIONS@LIGHTINGDYNAMICS.COM, (954) 944-0286

2. SPECIFIC LIGHTING FIXTURES, SELECTED BY TYPE, PHOTOMETRIC PERFORMANCE, LIGHTING PATTERN, AND LUMEN OUTPUT, WERE USED IN THE ILLUMINATION DESIGN TO PRODUCE THE REQUIRED EFFECT AND ILLUMINATION. SUBSTITUTION OF THE LIGHT FIXTURES WILL RESULT IN DIFFERENT

3. THE ABOVE FIXTURE SCHEDULE IS PREDICATED ON PERFORMANCE, SIZE LIMITATIONS, AND IS DESIGNED TO MEET CERTAIN AESTHETIC CRITERIA. ANY ALTERNATIVE SELECTIONS MUST SUBMIT THE FOLLOWING TO THE ARCHITECT FOR APPROVAL FIFTEEN (15) DAYS PRIOR TO BID DATE....

3. IF THERE IS A DISCREPENCY BETWEEN A FIXTURE DESCRIPTION AND GENERAL NOTES, AND THE CATALOG NUMBER LISTED, THE FIXTURE DESCRIPTION AND GENERAL NOTES SHAL DICTATE.

4. IT IS THE CONTRACTORS RESPONSIBILITY TO VERIFY ACTUAL CEILING CONSTRUCTION TYPE AS DEFINED ON THE ARCHITECTURAL DRAWINGS AND FURNISH ALL LUMINAIRES WITH THE CORRECT MOUNTING DEVICES WHETHER OR NOT SUCH VARIATIONS ARE INDICATED IN THE LUMINAIRE CATALOG

5. ALL LUMINAIRES SHALL BEAR THE UL LISTING NUMBERS FROM A NATIONALLY RECOGNIZED TESTING LABORATORY

LIGHTING DYNAMICS INCORPORATED

LIGHTING DYNAMICS INCORPORATED

Based on the information provided, all dimensions and luminaire locations shown represent recommended positions. The engineer and/or architect must determine applicability of the layout to existing or future field conditions. This lighting pattern represents illumination levels calculated from laboratory data taken under controlled conditions utilizing current industry standard lamp ratings in accordance with Illuminating Engineering Society approved methods. Actual performance of any manufacturer's luminaire may vary due to variation in electrical voltage, tolerance in lamps and other variable field conditions.

NOTES:

No.	Revision/Issue	Date
1	PHOTOMETRIC STUDY	02/09/24

LIGHTING DYNAMICS, INC.
7835 West Commercial Blvd.
Tamarac, FL 33351
(954) 944-0286
www.lightingdynamics.com

Project Name and Address

Canal Drive Pompano Site

Pompano Beach, FL

FILE P:\PROJECTS\2024\JAN
CLIENT IDEA

Project	Sheet
Canal Drive Pompano	L0
Date 02/09/2024	
Scale 1/8" = 1'	DRAWN BY IG

idea Architect
absolute-idea.com
ENG. CA No. 28787 ARCH LICENSE NBR AA26001856
CANAL PARK
3323 NE 163rd Street, Suite 200 North Miami Beach, FL 33160
305.792.0015 305.931.0279 info@absolute-idea.com

SEAL

TO THE BEST OF MY KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AND THE APPLICABLE FIRE-SAFETY STANDARDS AS DETERMINED BY THE LOCAL AUTHORITY IN ACCORDANCE WITH THIS SECTION AND 633 FLORIDA STATUES.

STEPHANE L'ECUYER
AR 93637

STATE OF FLORIDA · STEPHANE L'ECUYER · AR93637 · REGISTERED ARCHITECT

Digitally signed by Stephane L'Ecuyer
Date: 2024.07.30 16:49:04-04'00'

#	Date	Description
1	02.13.24	MINOR SPA (DRC) REV-01

Notes

SITE PLAN APPROVAL

Not for construction

Professionals

CLIENT
SERGE MICHAUD
3018 NE 20TH CT
FORT LAUDERDALE FL 33305

ARCHITECT
IDEA ARCHITECT
3323 NE 163RD STREET, SUITE 200
NORTH MIAMI BEACH, FL 33160

CIVIL
THE BETAJONES GROUP
801 BRICKELL AVE STE 900,
MIAMI, FL 33131

LANDSCAPE
TONNING & ASSOCIATES
4855 NW 92ND TER,
CORAL SPRINGS, FL 33067

CANAL DRIVE POMPANO
3233 - 3237 CANAL DRIVE POMPANO BEACH
FLORIDA 33062

Title

PHOTOMETRIC STUDY

Drawn	Field
IDEA Team	Architecture
Verified Alexander Baramily	*Scale*
Approved Stéphane L'Écuyer	*Date* 07/02/24
Project Manager Alexander Baramily	*Dwg. no. Page* A-910
Project 22-824	

DRC
PZ23-12000054
03/05/2025

Autodesk Docs://Townhomes Canal Drive Pompano/22-824 Townhomes Canal Drive Pompano R24.rvt 3:09:00 PM

All dimensions must be taken and checked before starting work. No dimension should be measured on printed plans. The content of this document is an intellectual property of IDEA Architects. No total or partial use can be made without the written permission of its author.