



Luminaire Schedule									
Symbol	Qty	Label	Arrangement	Lum. Lumens	LLF	Luminaire Watts	Total Watts	Description	
	1	A	Single	19848	0.900	136.2	136.2	OPF-S-A07-730-T5W	
	1	A1	Single	20142	0.900	136.2	136.2	OPF-S-A07-730-T4M	

PZ25- 12000035
12/03/2025



Calculation Summary									
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min	Grid Z	
GROUND	Illuminance	Fc	1.11	11.1	0.0	N.A.	N.A.	0	
PARKING	Illuminance	Fc	3.88	16.4	1.0	3.88	16.40	0	
PROPERTY LINE	Illuminance	Fc	0.13	1.7	0.0	N.A.	N.A.	N.A.	

NOTES:
- WHEN THE LLF IS NOT .9 OR 1.0 THE WATTAGE INFORMATION WILL NOT BE CORRECT
- LUMINAIRES AND MOUNTING HEIGHTS ASSUMED
- LUMINAIRES PLACED IN PROPOSED LOCATIONS AT LEAST 15' FROM TREE TRUNKS
- LUMINAIRE SYMBOLS MAGNIFIED FOR CLARITY

TARGETING:

PARKING: 1 FC MIN AT 0.0' A.F.G.

PROPERTY LINE: 3 FC MAX AT 5' A.F.G.

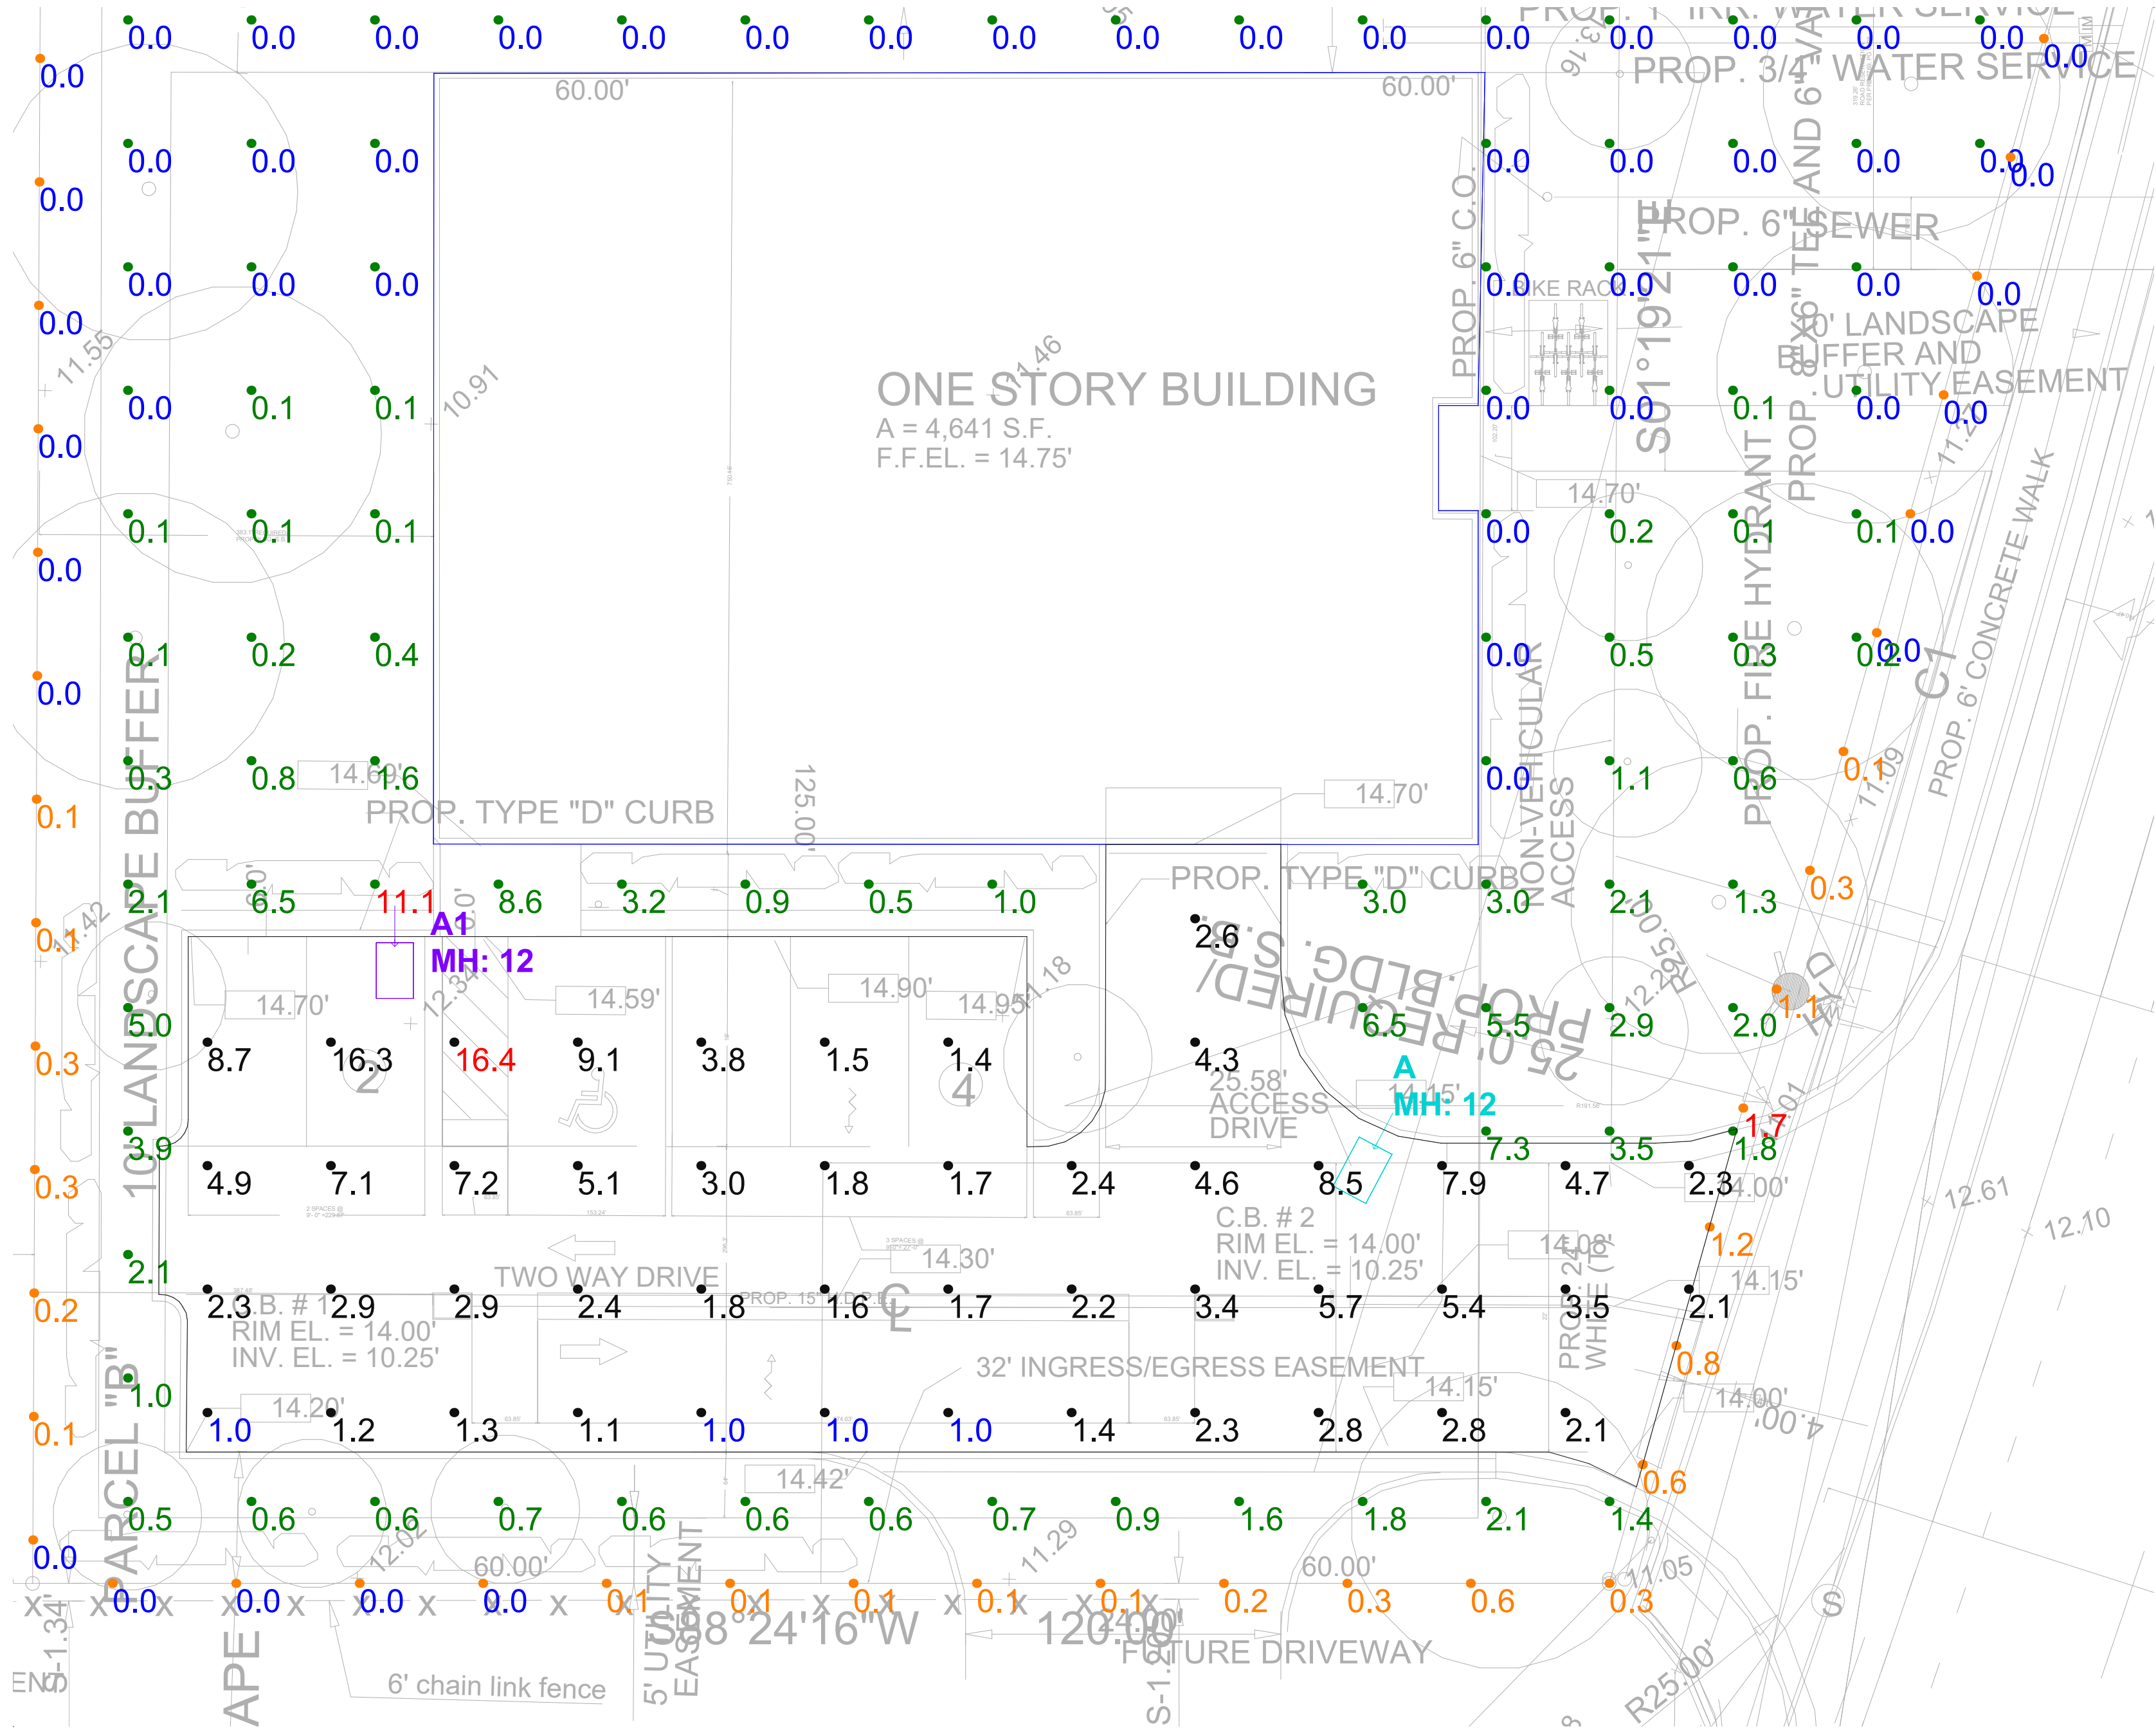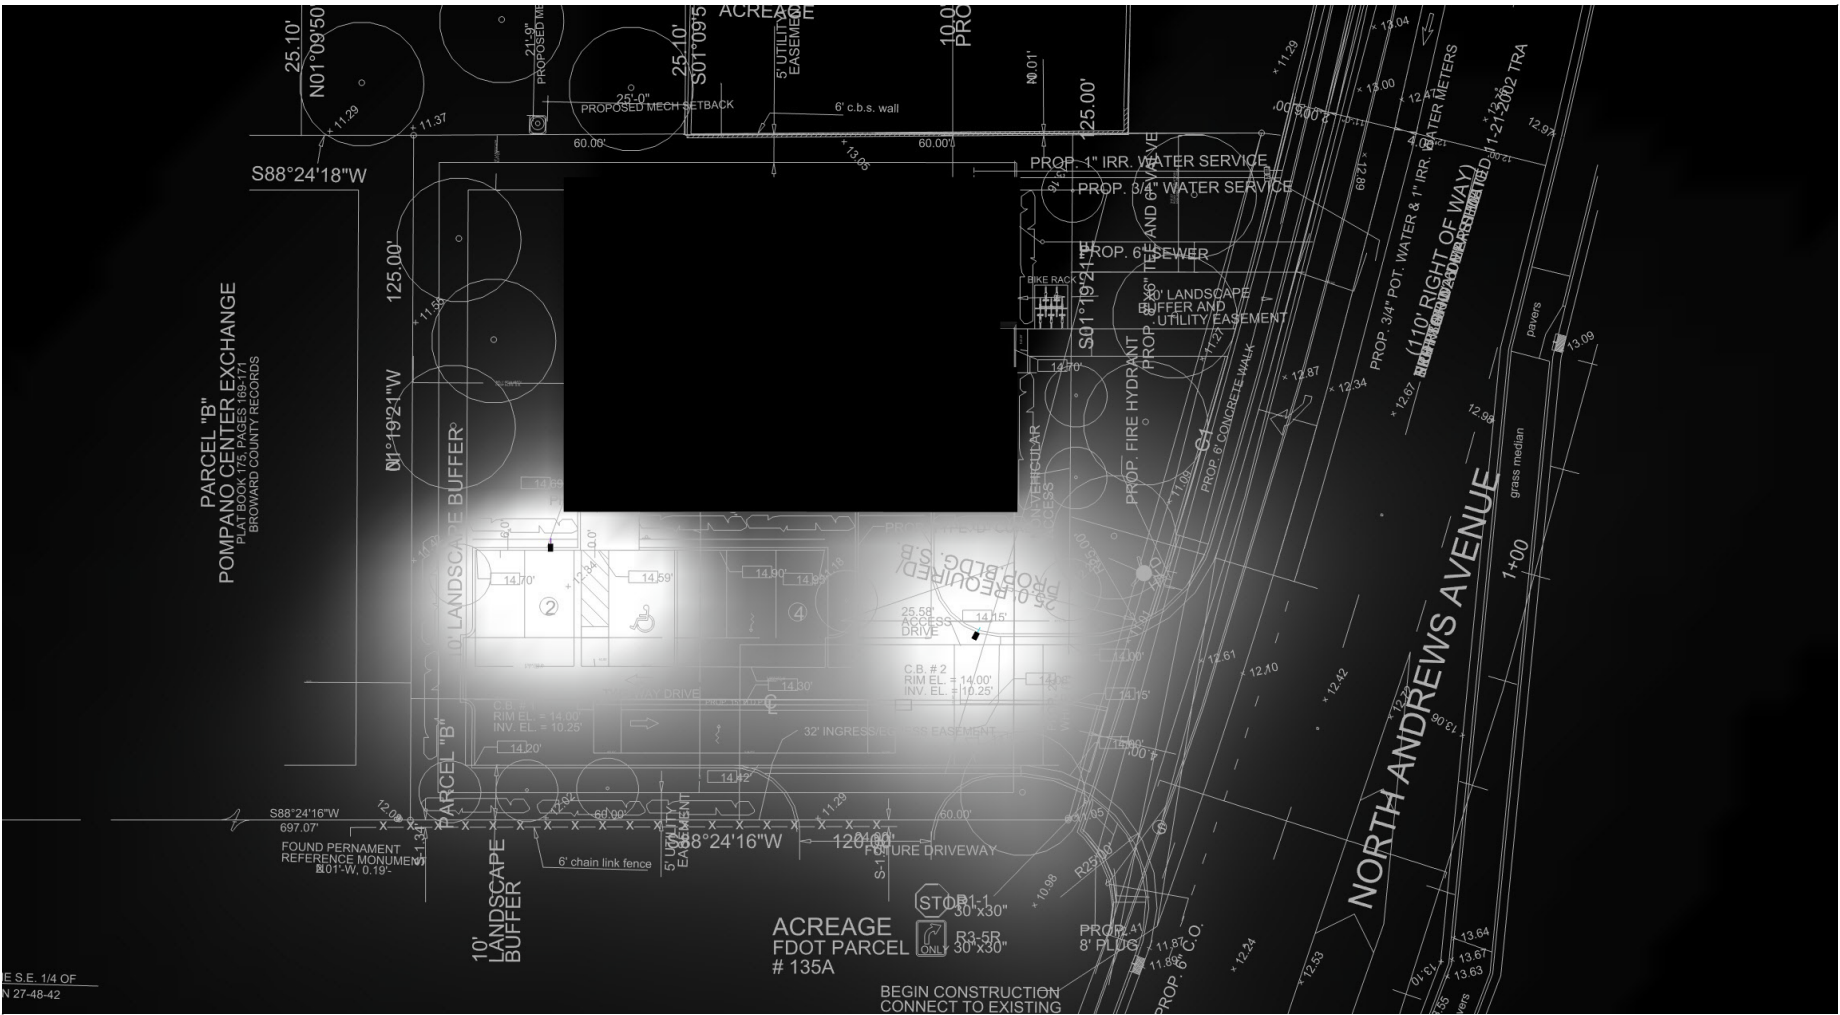

View_1:SITE
Scale: 1 inch= 10 Ft.

Disclaimer:
SESCO Lighting provides this photometric report for purposes of comparison within the SESCO Lighting product line only. The information provided is based on standardized industry procedures.
This laboratory performance will always differ from that observed in the field due to a great number of variables, both known and unknown (installation methods, power quality, lamping, recoverable and non-recoverable light loss factors, etc.)
In general, SESCO Lighting considers numerical studies to be predictive in that they cannot characterize the visual performance of any luminaire, or grouped. As such, specification decisions must be thoroughly based upon experience, consultation with the manufacturer, and, above all, common sense.

Sales Rep: JOHN MARINO

Office: FT LAUDERDALE

Contact No: (954) 474-9888

Processed By: A. CORNELIUS

Filename: 05-09-2024 AUTO PARTS FACILITY_SITE.AGI

AUTO PARTS FACILITY
SITE