
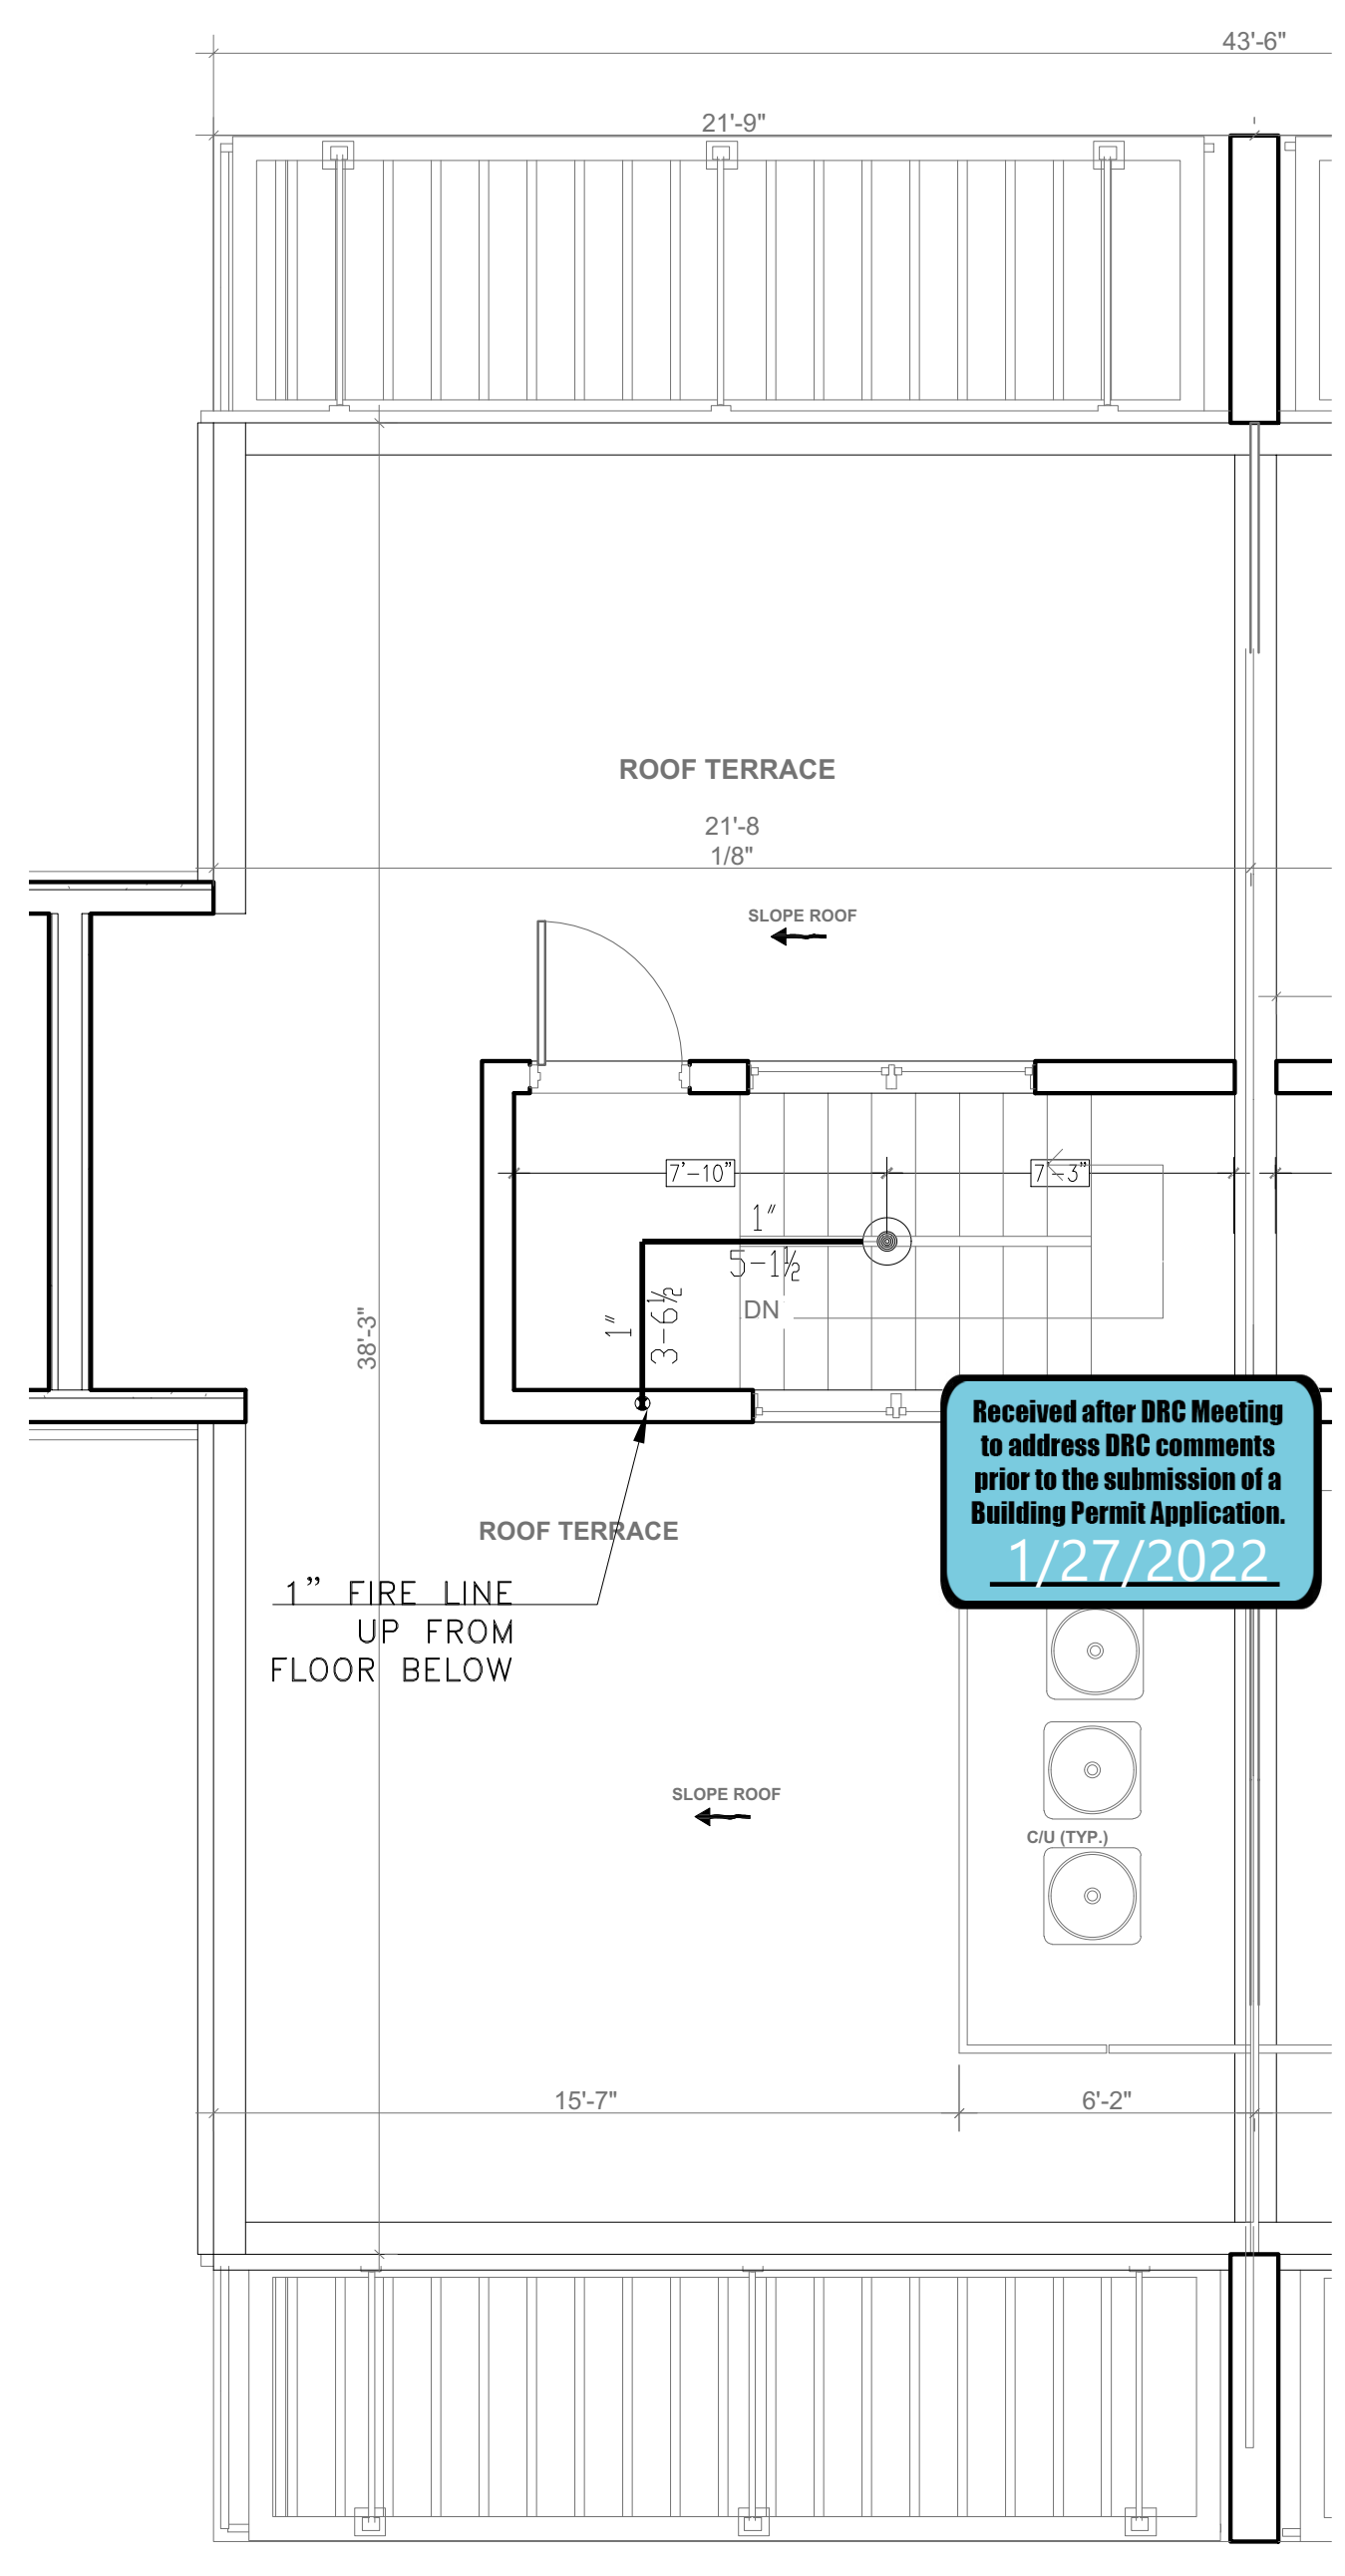
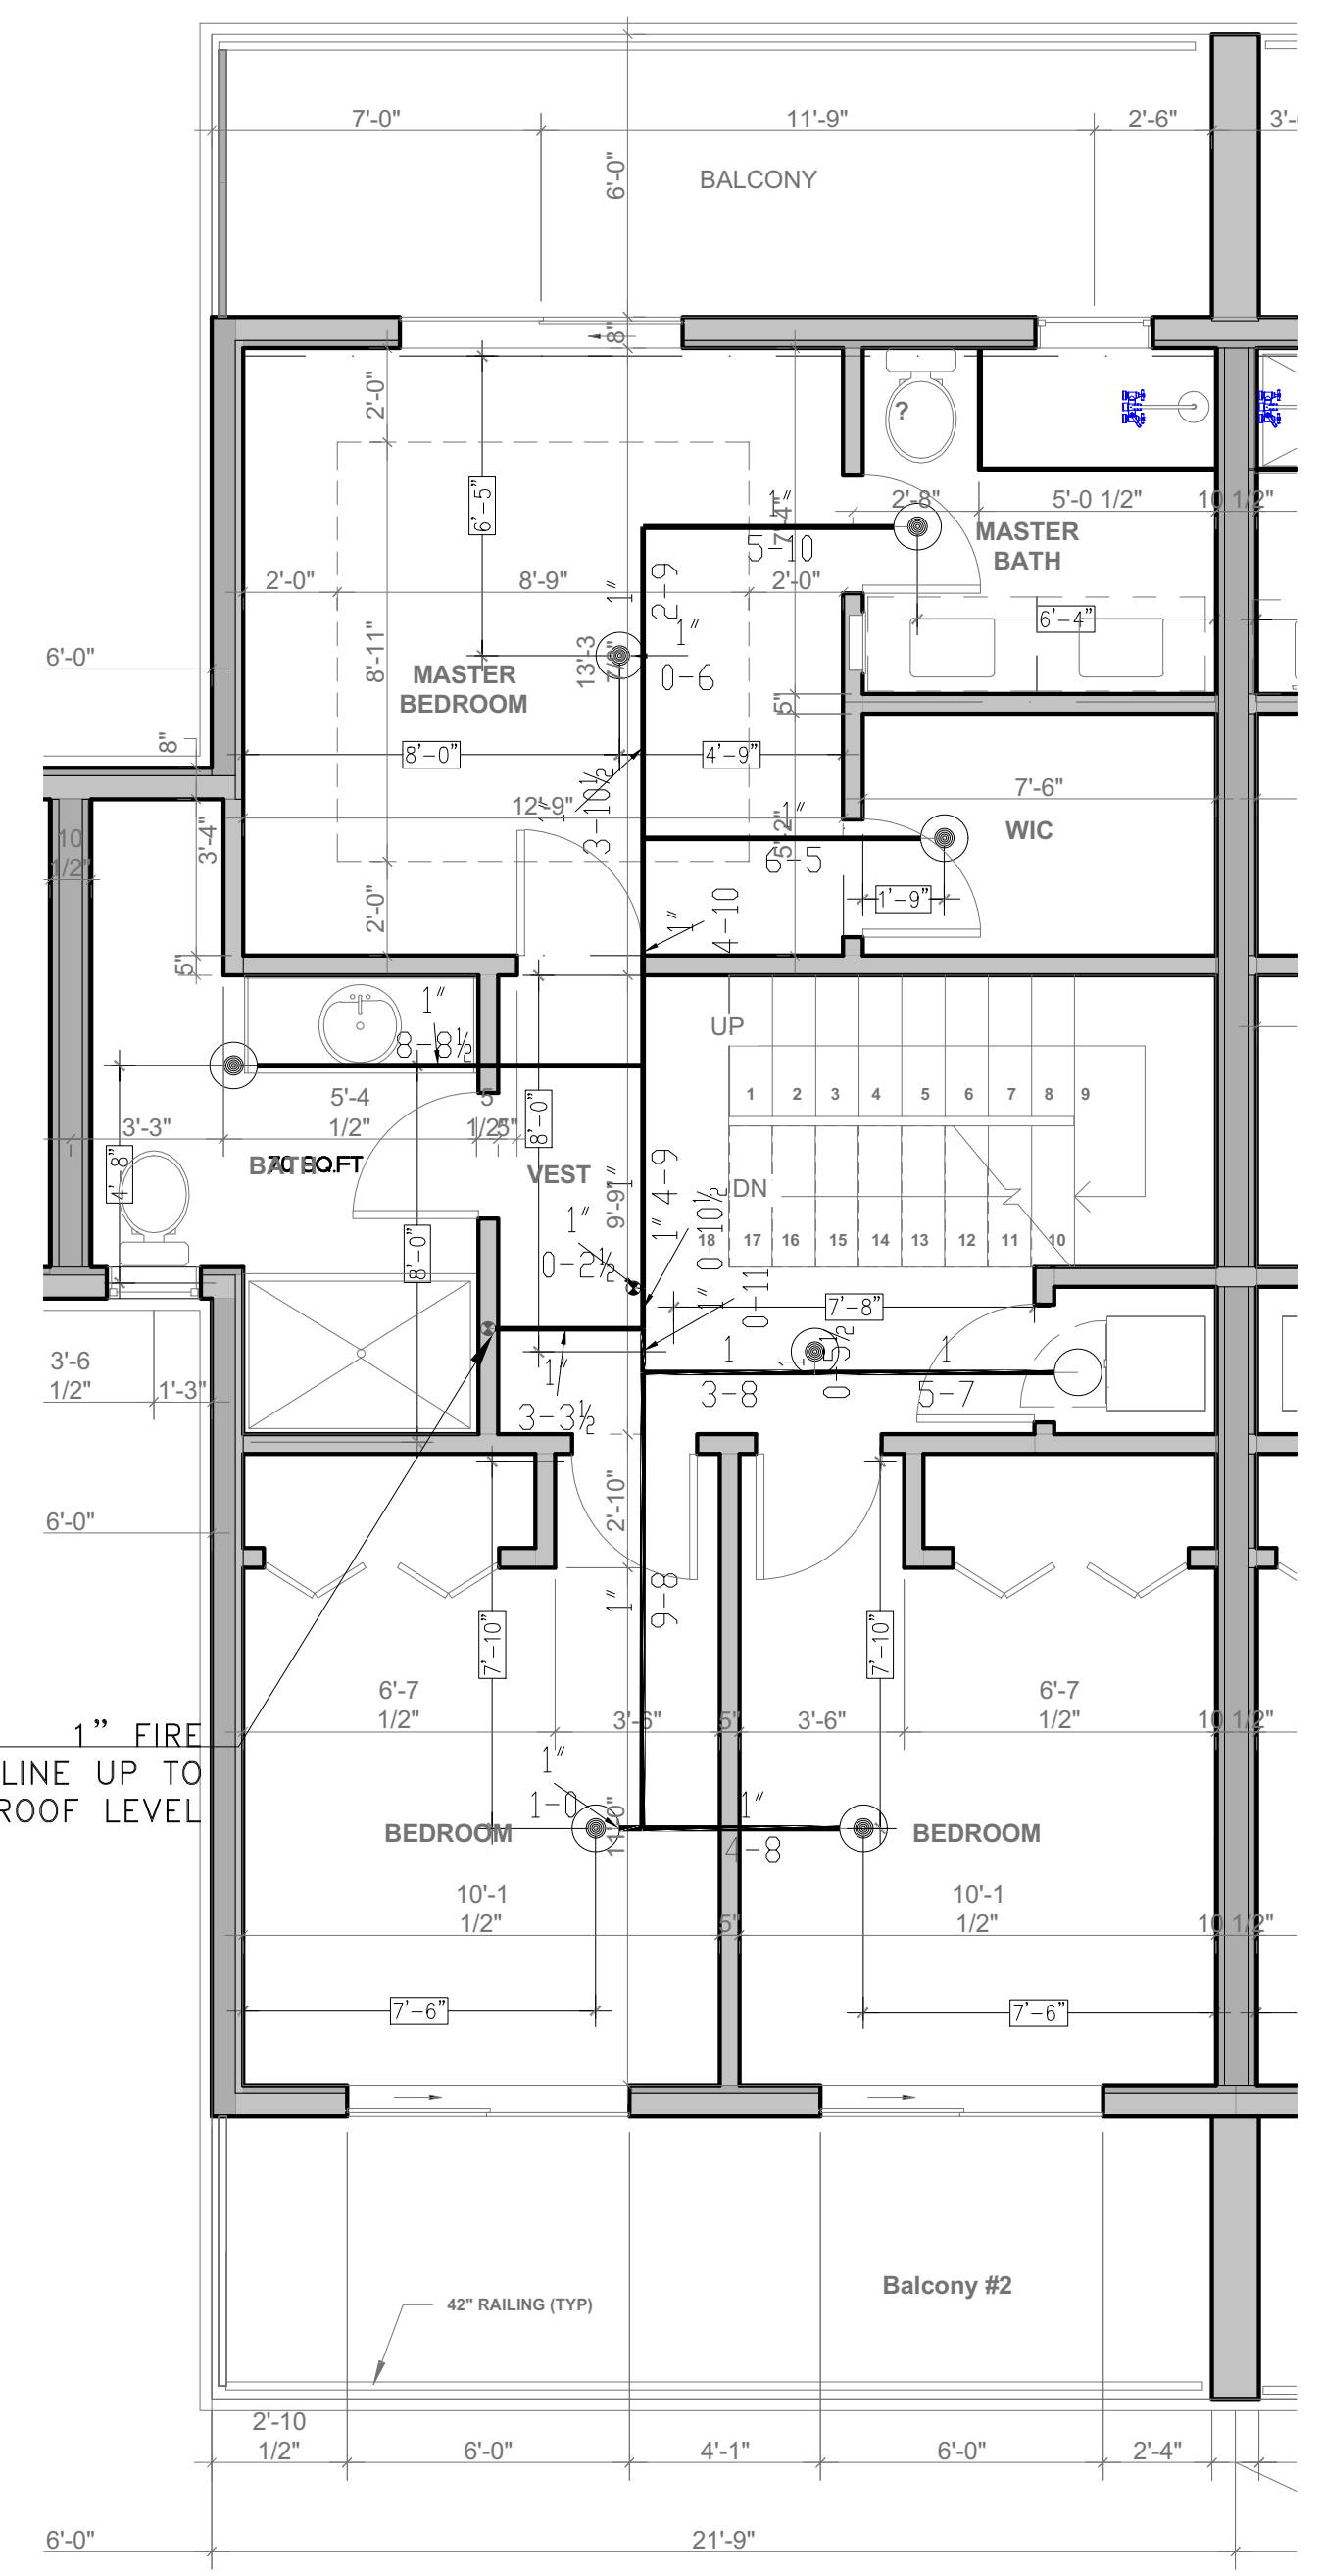
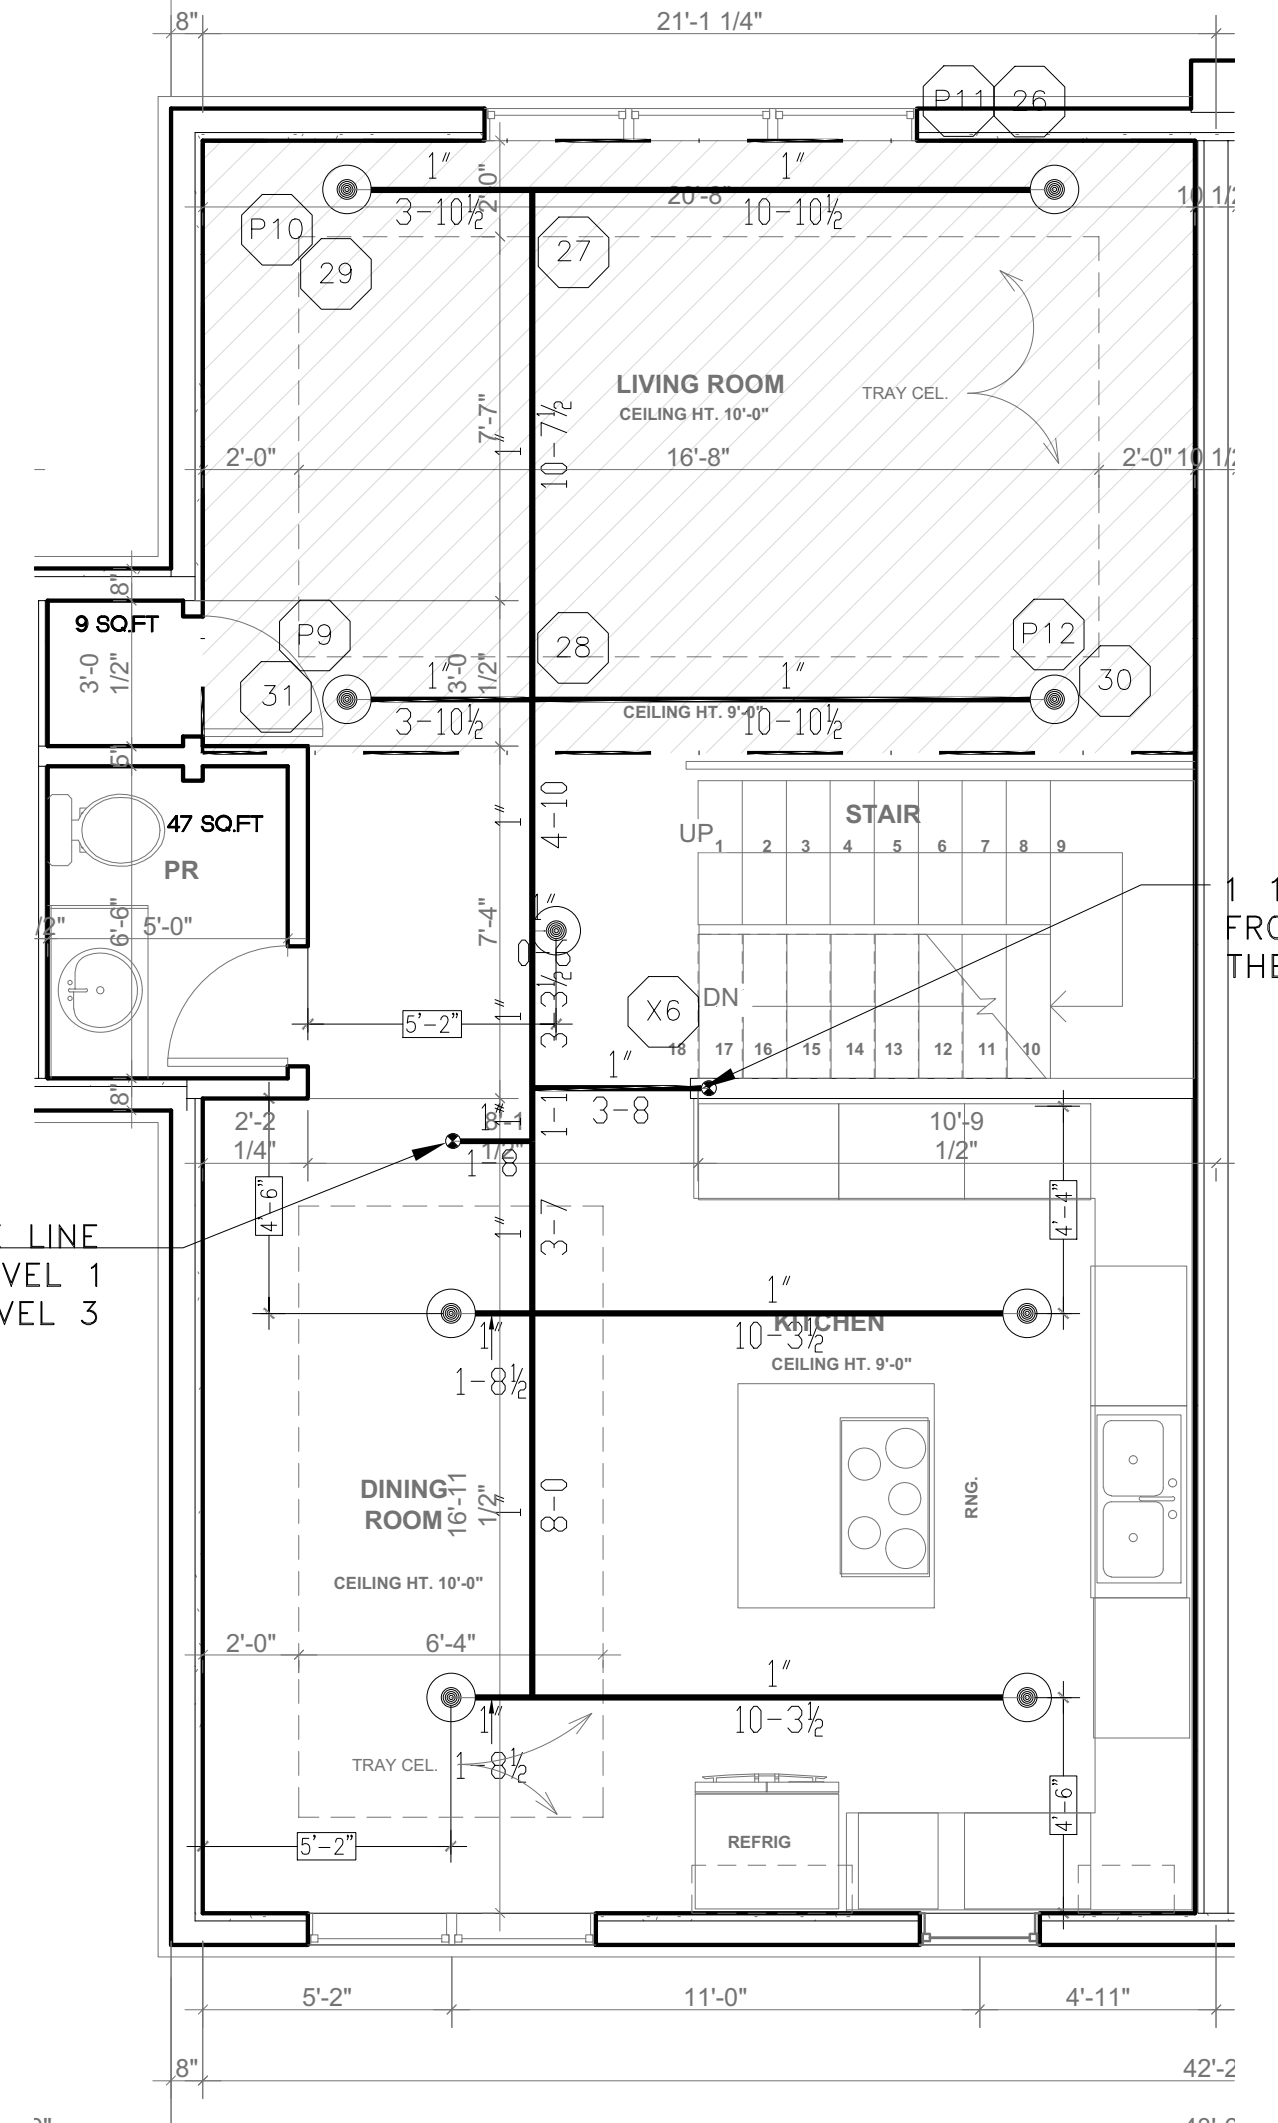


Design Area No. 1C - 13R
Density .05 Area 4 HEADS
Flow 64.90 gpm @ 65.472 psi
Includes +5 gpm Hose allowance

Design Area No. 1C - 13R
Density .05 Area 4 HEADS
Flow 59.26 gpm @ 23.58 psi
Includes +5 gpm Hose allowance

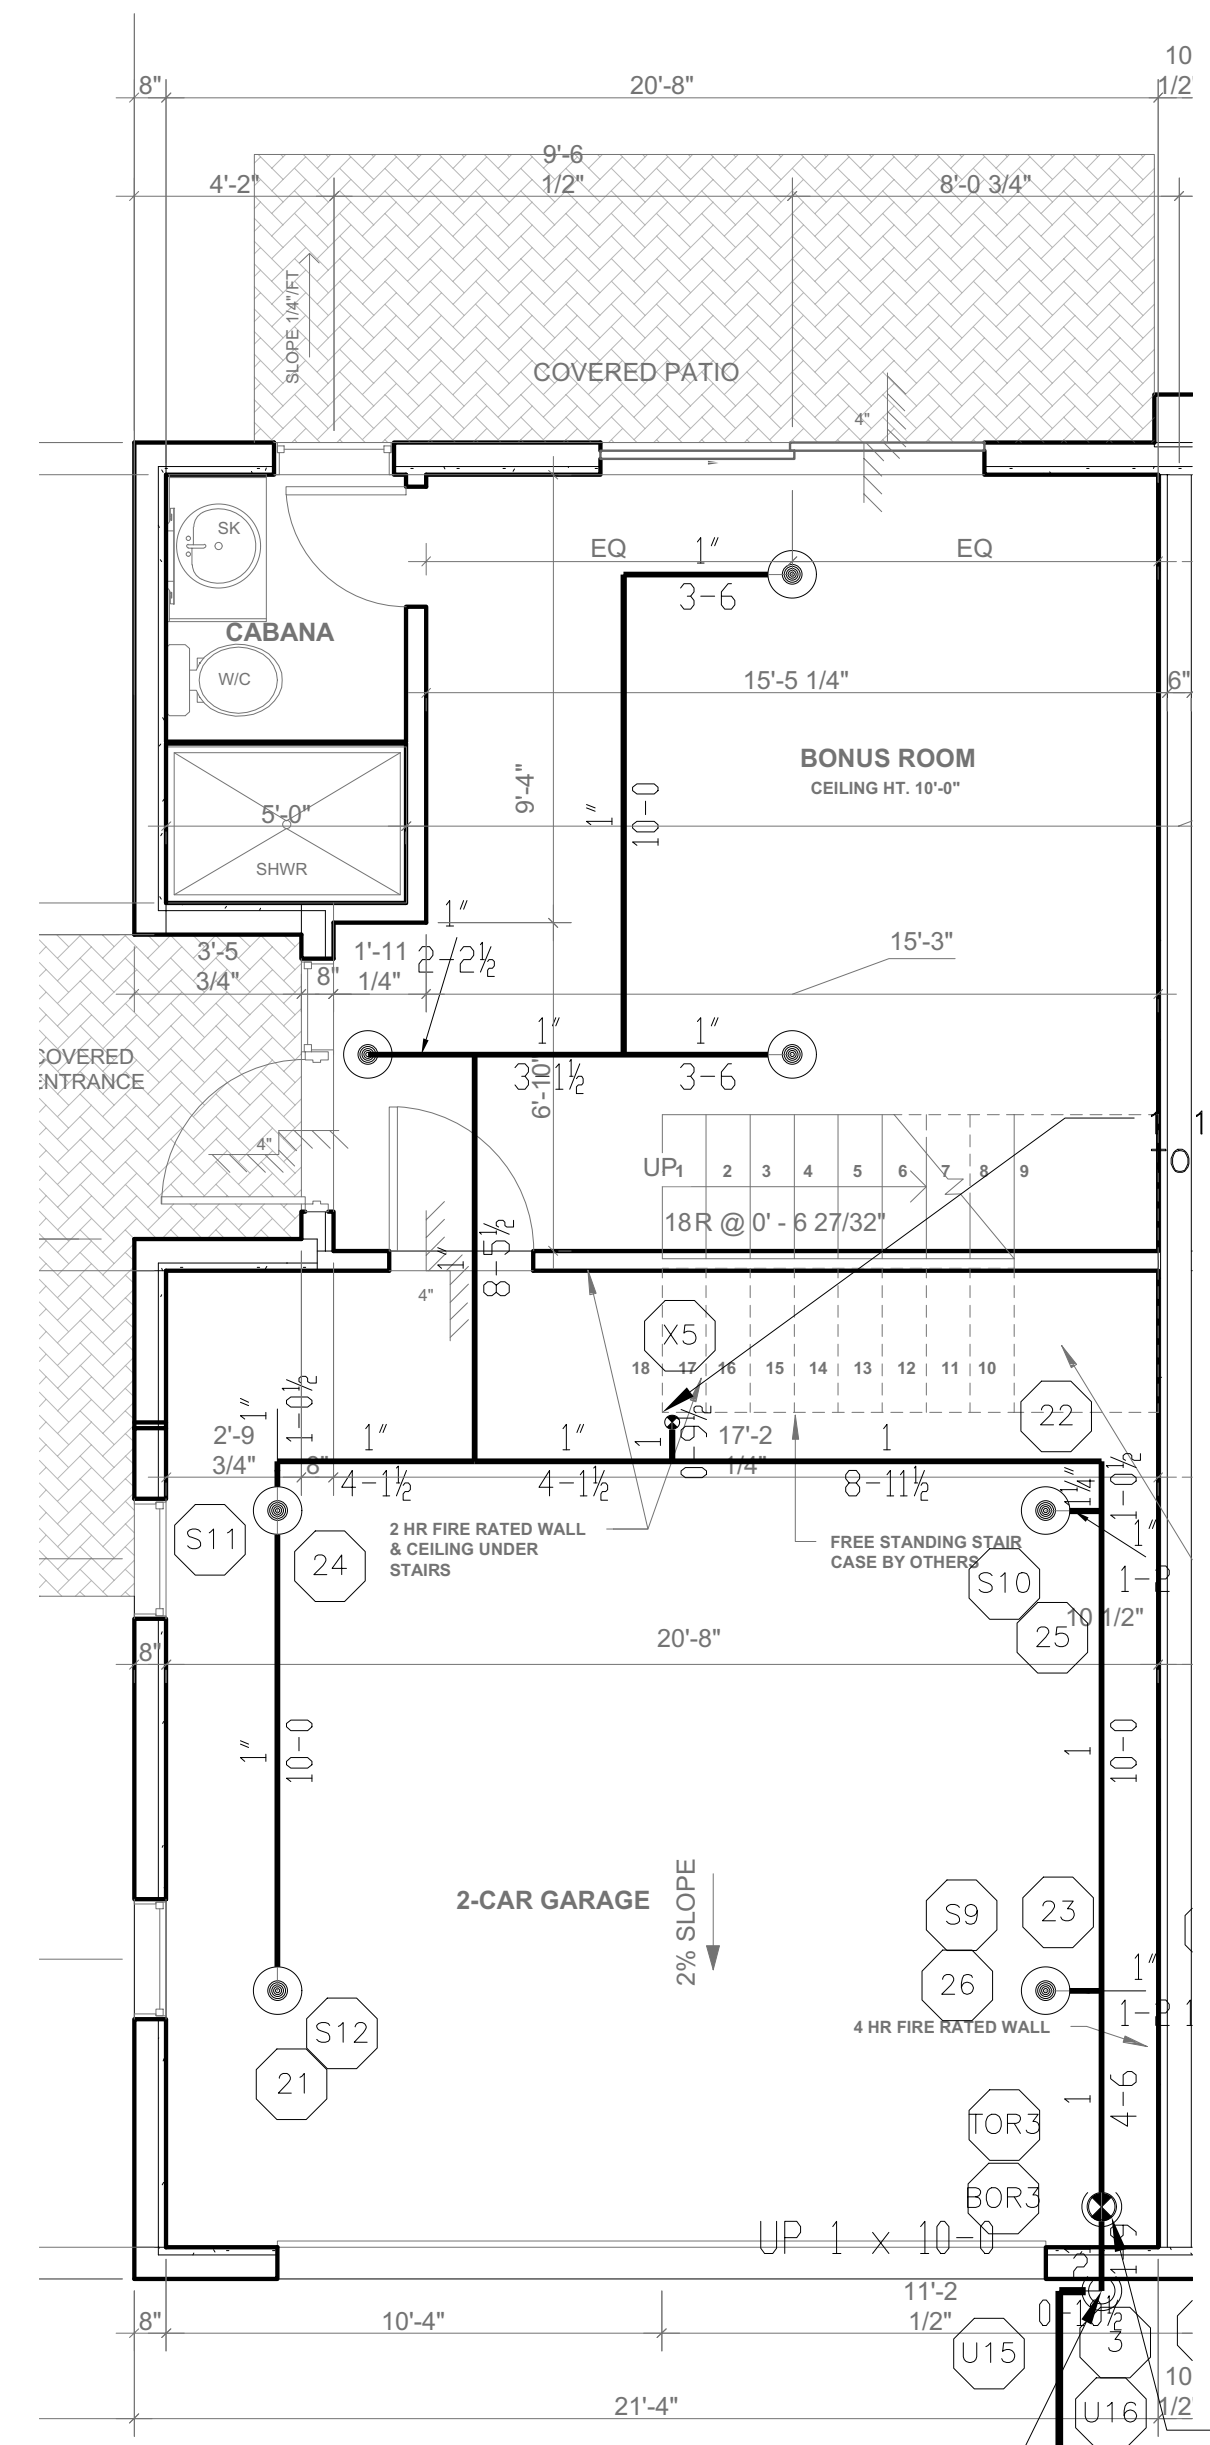

Received after DRC Meeting
to address DRC comments
prior to the submission of a
Building Permit Application.
1/27/2022

UNIT C FIRE 1ST FLOOR PLAN

SCALE: 1/4" = 1'-0"

UNIT C FIRE 2ND FLOOR PLAN

SCALE: 1/4" = 1'-0"

UNIT C FIRE 3RD FLOOR PLAN

SCALE: 1/4" = 1'-0"


UNIT C FIRE ROOF FLOOR PLAN



Digitally signed
by Michelle L.
Franklin
Date: 2022.01.26
19:42:44 -05'00'

FIRE SPRINKLER HEAD LEGEND				FIRE SPRINKLER HEAD LEGEND			
SYMBOL	TOTAL	DESCRIPTION	FINISH SIZE	TEMP	NO.	DATE	REVISION PER CITY COMMENTS
●	23	TYCO LFI CONC. RES. PEND.	1/2" 4.9	175°	1	1/19/22	
○	1	TYCO TY-FRB OR PEND.	1/2" 5.6	175°			
TOTAL THIS SHEET				24	TOTAL THIS JOB		

RIVERSIDE TOWNHOMES
BUILDING #1 UNIT C
117 SOUTH RIVERSIDE DRIVE
POMPANO BEACH, FLORIDA 33062



SHEET No.	
FP-2	
SHEET 2 OF 2	
DRAWING TITLE	
FLOOR SPRINKLER PLAN	
DATE	10/17/21
DWG BY	CD
FILE NAME	FIRE SHOP DRAWINGS-UNIT E
SCALE	AS NOTED
JOB #	BC922
A.H.J.	CITY OF
POMPANO BEACH	

HYDRAULICALLY CALCULATED SYSTEM		WATER SUPPLY	
CALC AREA:	UNIT E	FLOW TEST	
NO. OF SPRINKLERS:	2	DATE OF TEST:	10/22/21
DENSITY (psi/sq.ft):	31.02	TIME OF TEST:	9:15 AM
DESIGN AREA (sq.ft):	55.492	STATIC PRESSURE (psi):	80
FLOW RATE (gpm):		RESIDUAL PRESSURE (psi):	77
PRESSURE (psi):		GALLONS FLOWING (gpm):	1159
FLOW TEST REF. POINT:		TESTED BY:	SUMMERS