



UNIT B FIRE 1ST FLOOR PLAN  
SCALE: 1/4" = 1'-0"

UNIT B FIRE 2ND FLOOR PLAN  
SCALE: 1/4" = 1'-0"

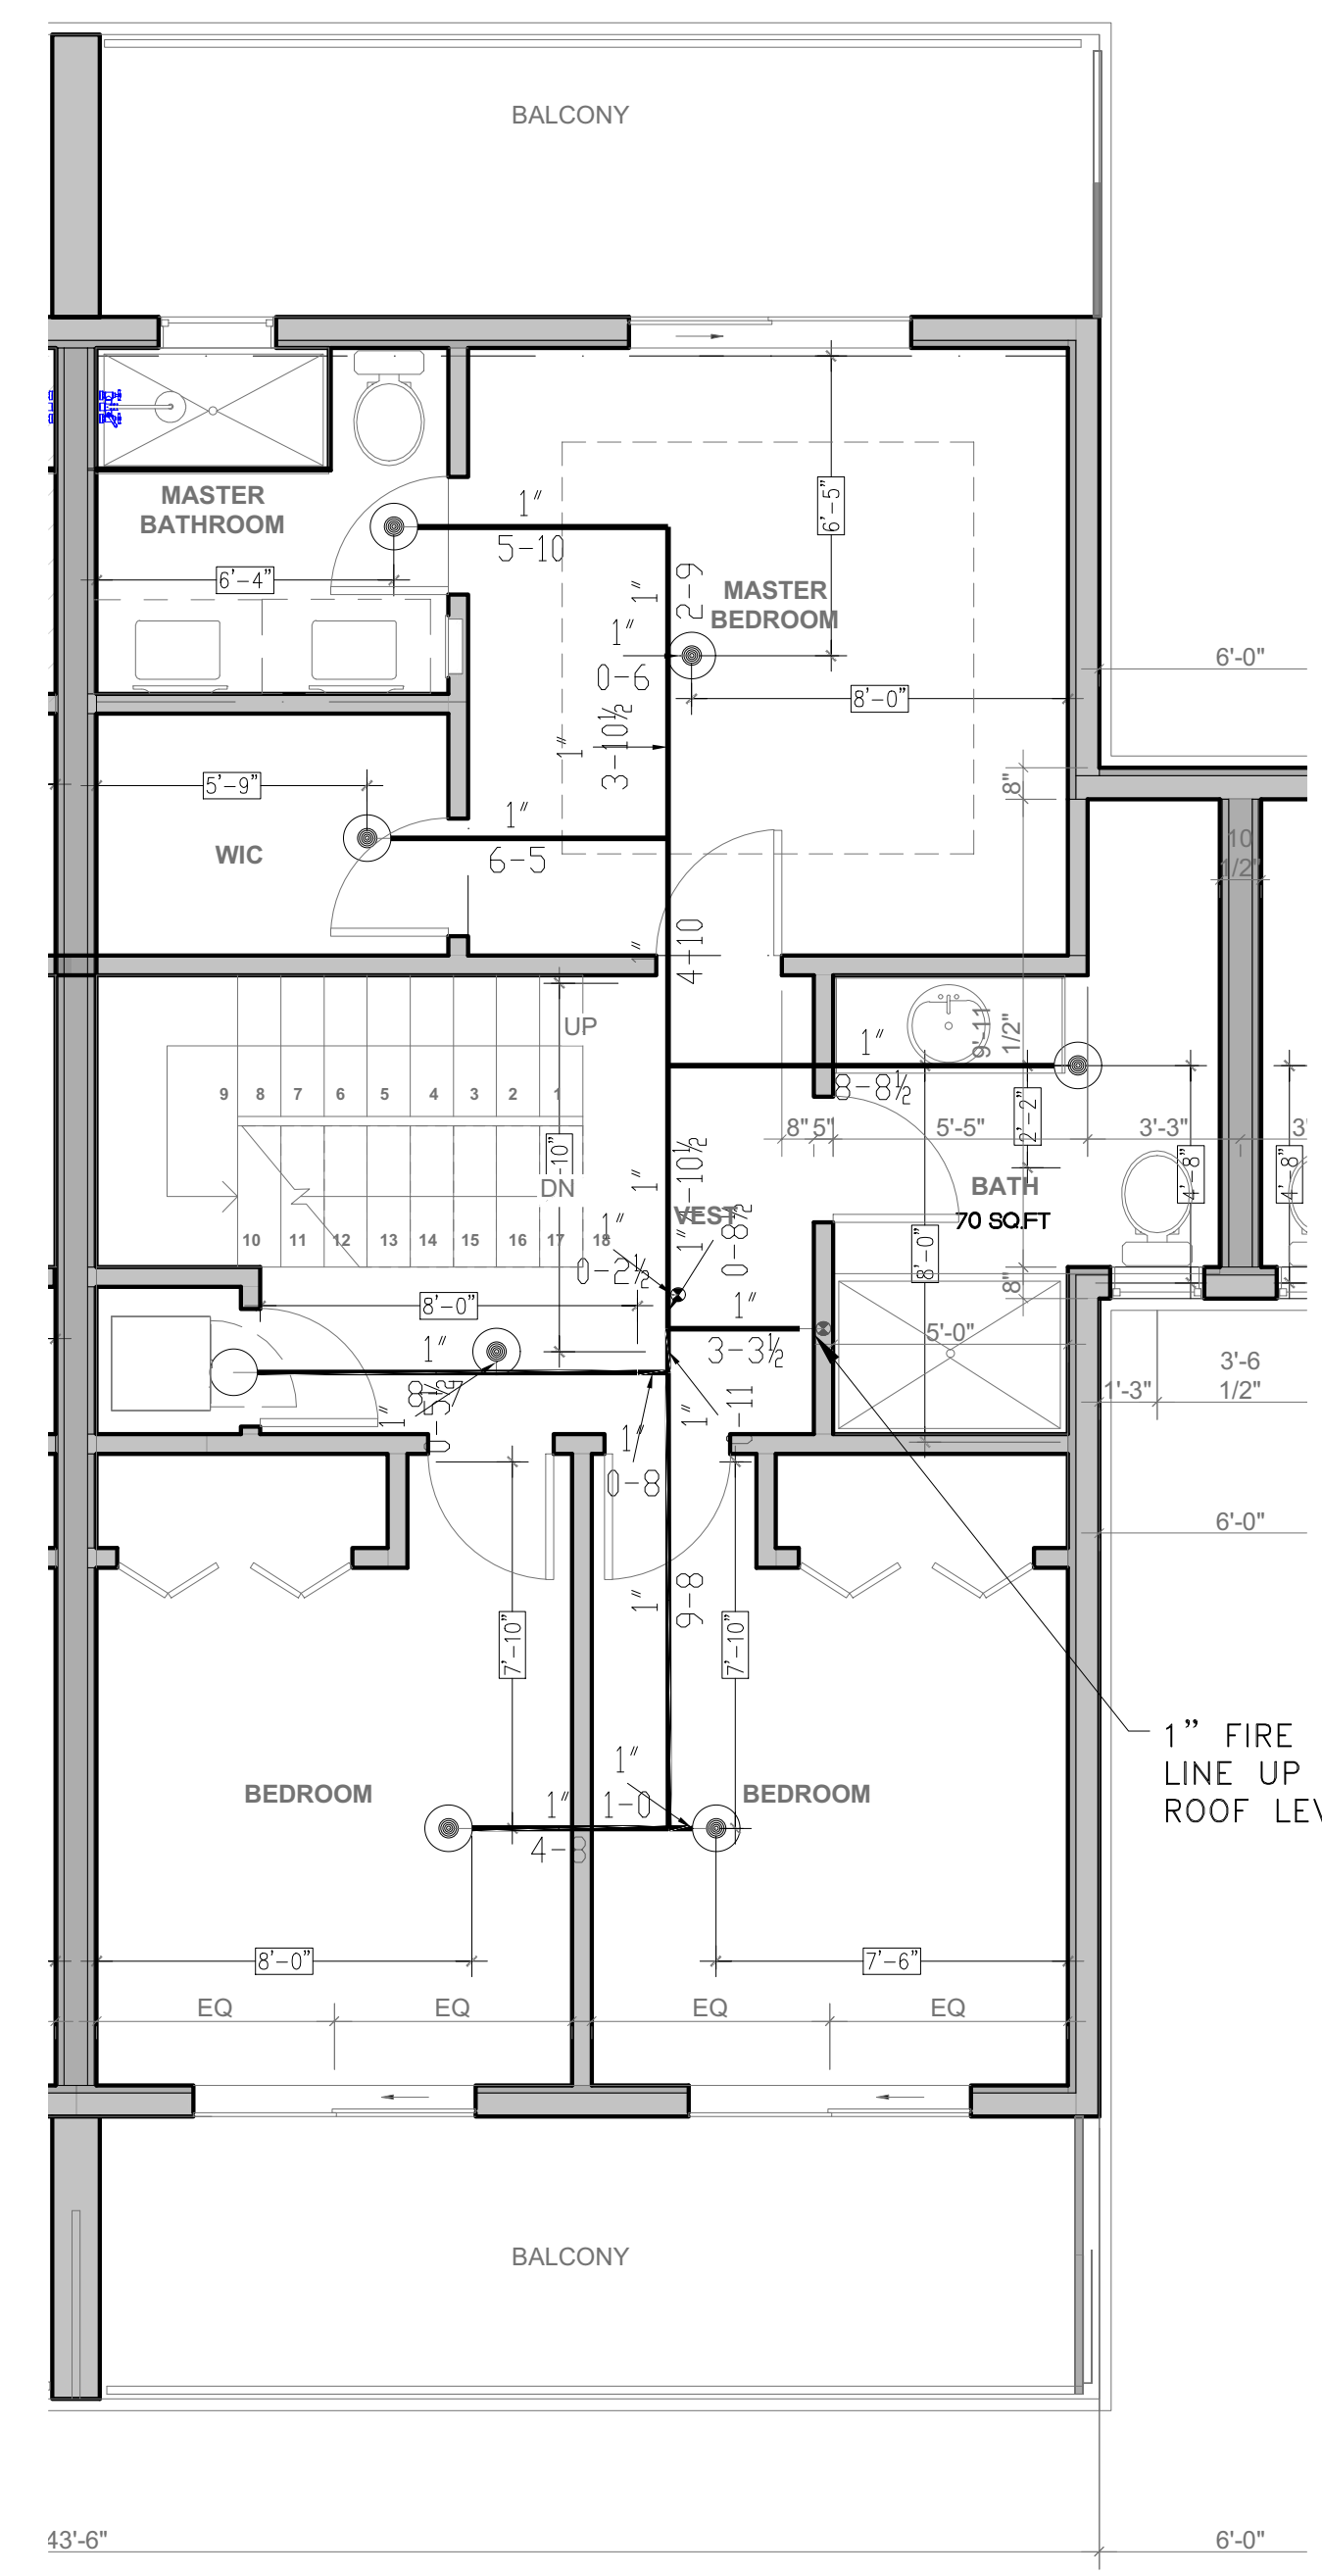


UNIT B FIRE 3RD FLOOR PLAN  
SCALE: 1/4" = 1'-0"

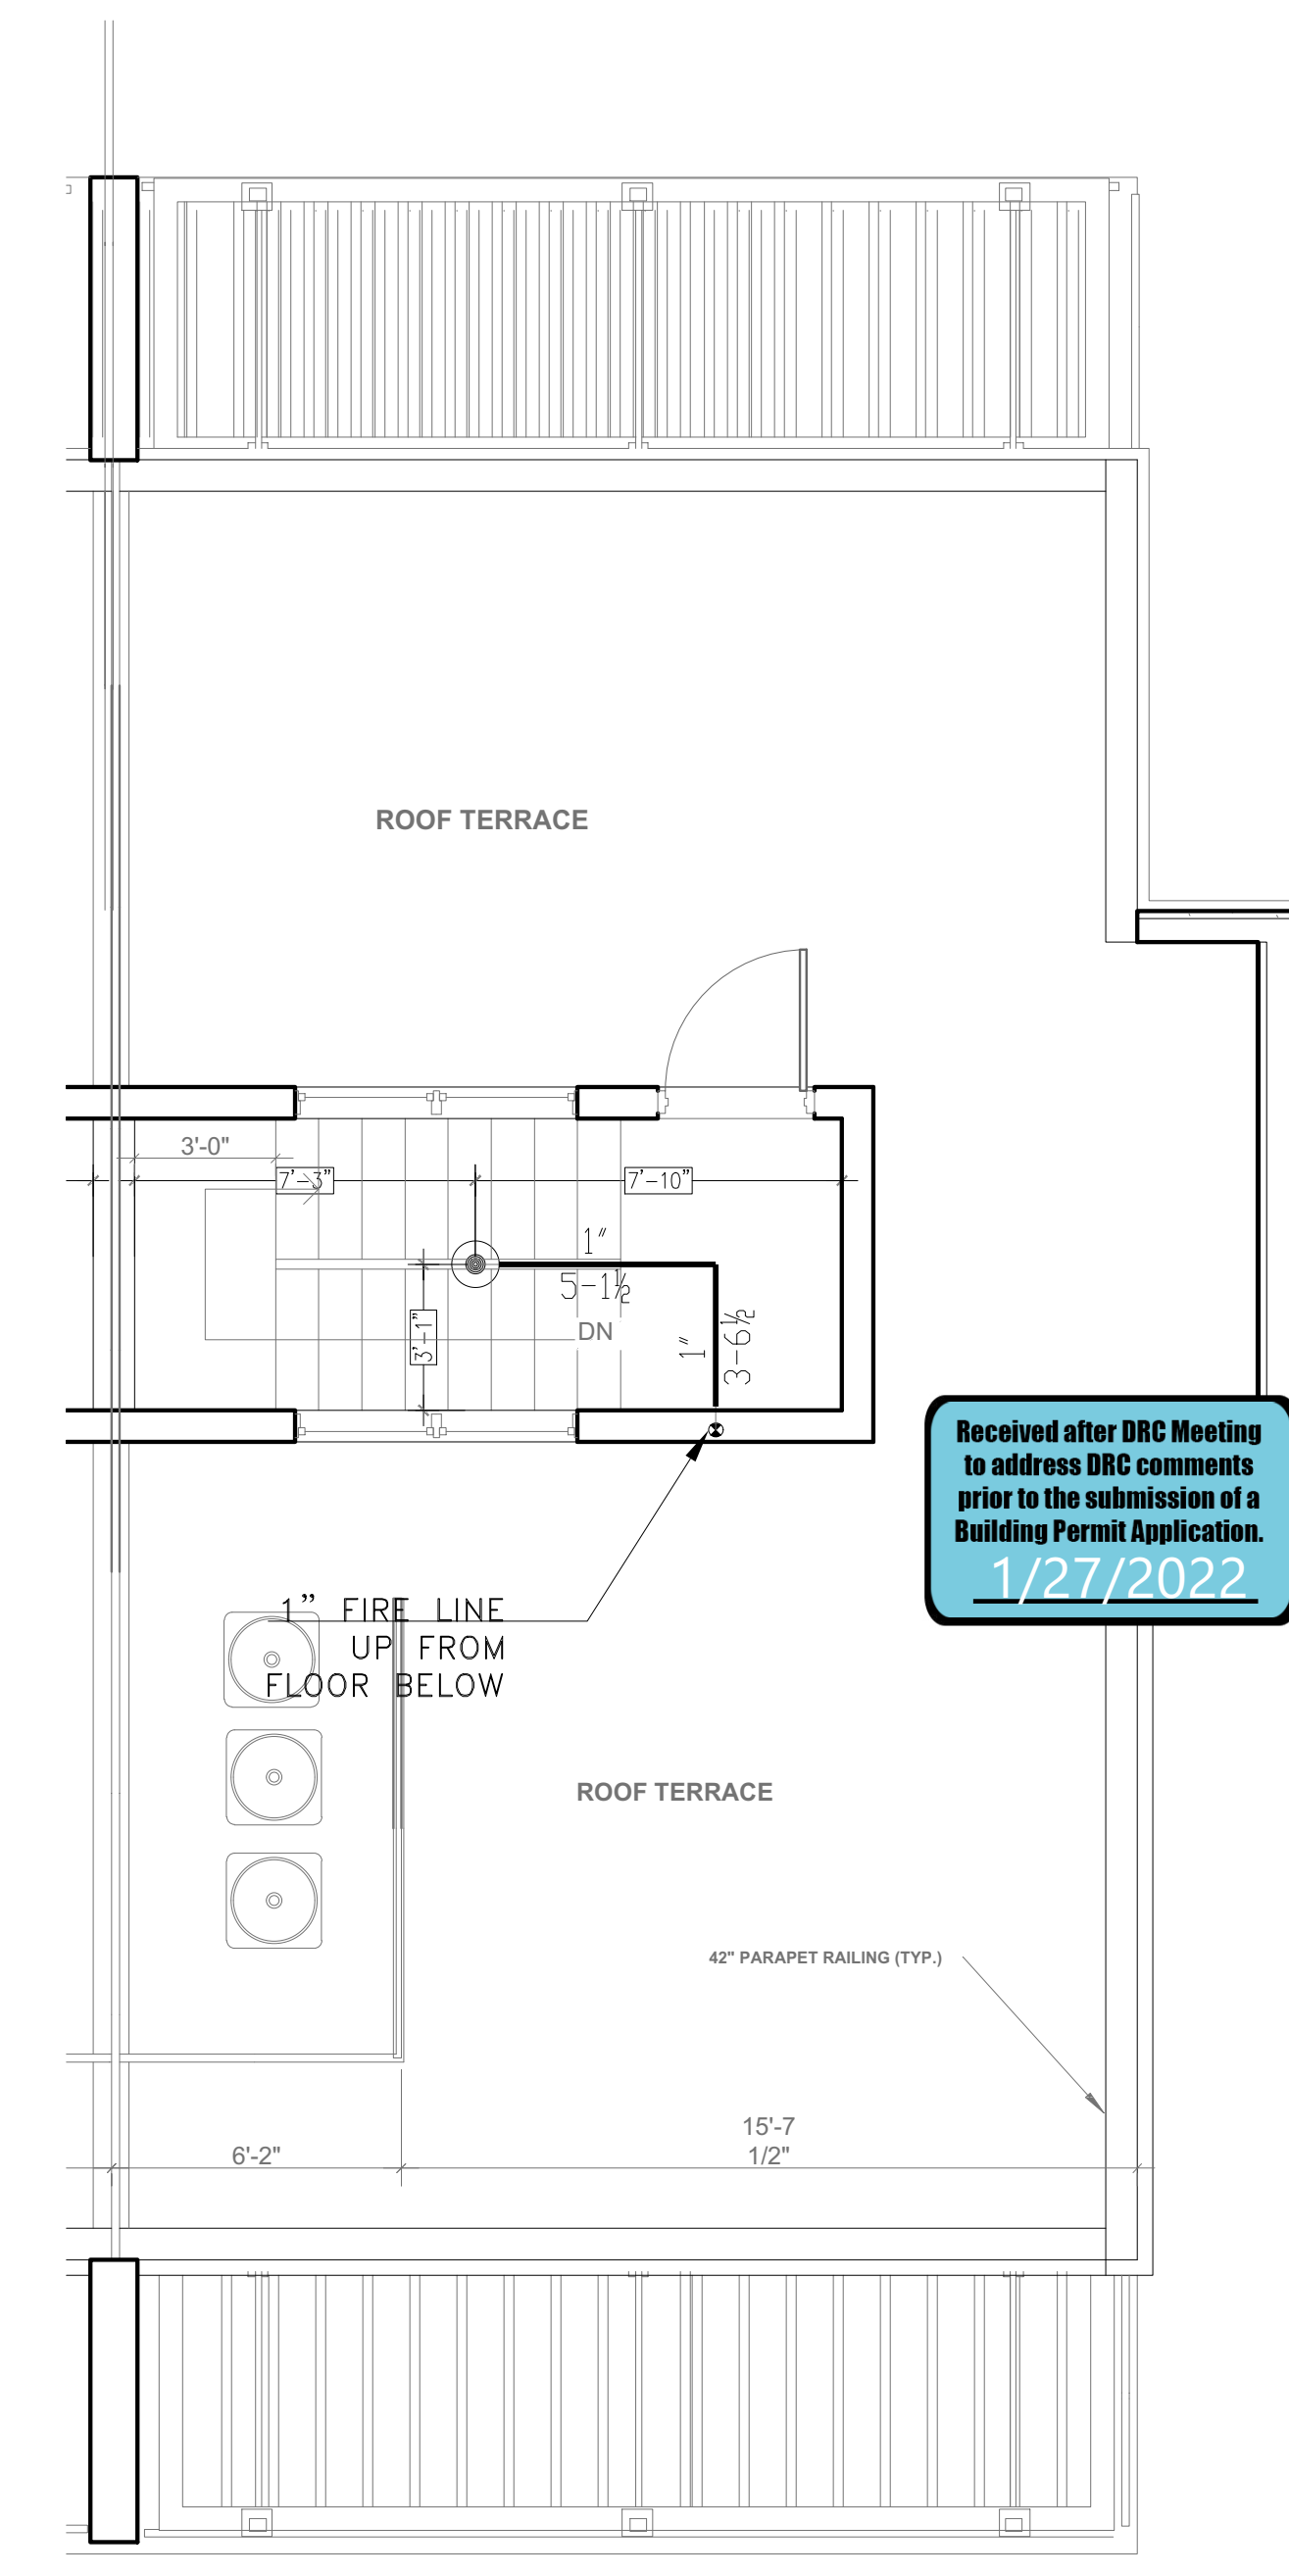

UNIT B FIRE ROOF FLOOR PLAN

Received after DRC Meeting  
to address DRC comments  
prior to the submission of a  
Building Permit Application.  
1/27/2022




Digitally signed  
by Michelle L.  
Franklin  
Date: 2022.01.26  
19:38:07 -05'00'

HYDRAULICALLY CALCULATED SYSTEM				WATER SUPPLY			
NO. OF SPRINKLERS:	2	DATE OF TEST:	10/22/21	DATE	10/17/21	DWG BY	CD
DENSITY (psi/sq.ft):	31.02	TIME OF TEST:	9:15 AM	FILE NAME	FIRE SHOP DRAWINGS-UNIT E	SCALE	AS NOTED
DESIGN AREA (sq.ft):	55.492	STATIC PRESSURE (psi):	80	JOB #	BC922	A.H.J.	CITY OF POMPANO BEACH
FLOW RATE (gpm):		RESIDUAL PRESSURE (psi):	77	GALLONS FLOWING (gpm):	1159	TESTED BY:	SUMMERS
PRESSURE (psi):							
FLOW TEST REF. POINT:							

FIRE SPRINKLER HEAD LEGEND				TOTAL THIS SHEET			
SYMBOL	TOTAL	DESCRIPTION	SIN # FINISH SIZE K	TEMP	NO.	DATE	REVISION PER CITY COMMENTS
●	23	TYCO LFI CONC. RES. PEND.	1/2" 4.9	175°	1	1/19/22	
○	1	TYCO TY-FRB OR PEND.	1/2" 5.6	175°			
				TOTAL THIS JOB			
				24			

RIVERSIDE TOWNHOMES  
BUILDING #1 UNIT B  
117 SOUTH RIVERSIDE DRIVE  
POMPANO BEACH, FLORIDA 33062



SHEET No.  
FP-2  
SHEET 2 OF 2

DRAWING TITLE			
FLOOR SPRINKLER PLAN			
DATE	10/17/21	DWG BY	CD
FILE NAME	FIRE SHOP DRAWINGS-UNIT E	SCALE	AS NOTED
JOB #	BC922	A.H.J.	CITY OF POMPANO BEACH