


NO.	DATE	REVISION DESCRIPTION	BY	CD
1	1/19/22	REVISION PER CITY COMMENTS		
2				
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				


RIVERSIDE TOWNHOMES  
BUILDING #1 UNIT A  
117 SOUTH RIVERSIDE DRIVE  
POMPANO BEACH, FLORIDA 33062




SHEET No.  
**FP-2**  
SHEET 2 OF 2

DATE	10/17/21
DWG BY	CD
FILE NAME	FIRE SHOP DRAWINGS-UNIT E
SCALE	AS NOTED
JOB #	BC922
A.H.J.	CITY OF POMPANO BEACH


HYDRAULICALLY CALCULATED SYSTEM	WATER SUPPLY
CALC AREA: UNIT E	FLOW TEST
NO. OF SPRINKLERS: 2	DATE OF TEST: 10/22/21
DENSITY (psi/sq.ft): 31.02	TIME OF TEST: 9:15 AM
DESIGN AREA (sq.ft): 55.492	STATIC PRESSURE (psi): 80
FLOW RATE (gpm):	RESIDUAL PRESSURE (psi): 77
PRESSURE (psi):	GALLONS FLOWING (gpm): 1159
FLOW TEST REF. POINT:	TESTED BY: SUMMERS




Digitally signed  
by Michelle L.  
Franklin  
Date:  
2022.01.26  
19:31:40 -05'00'

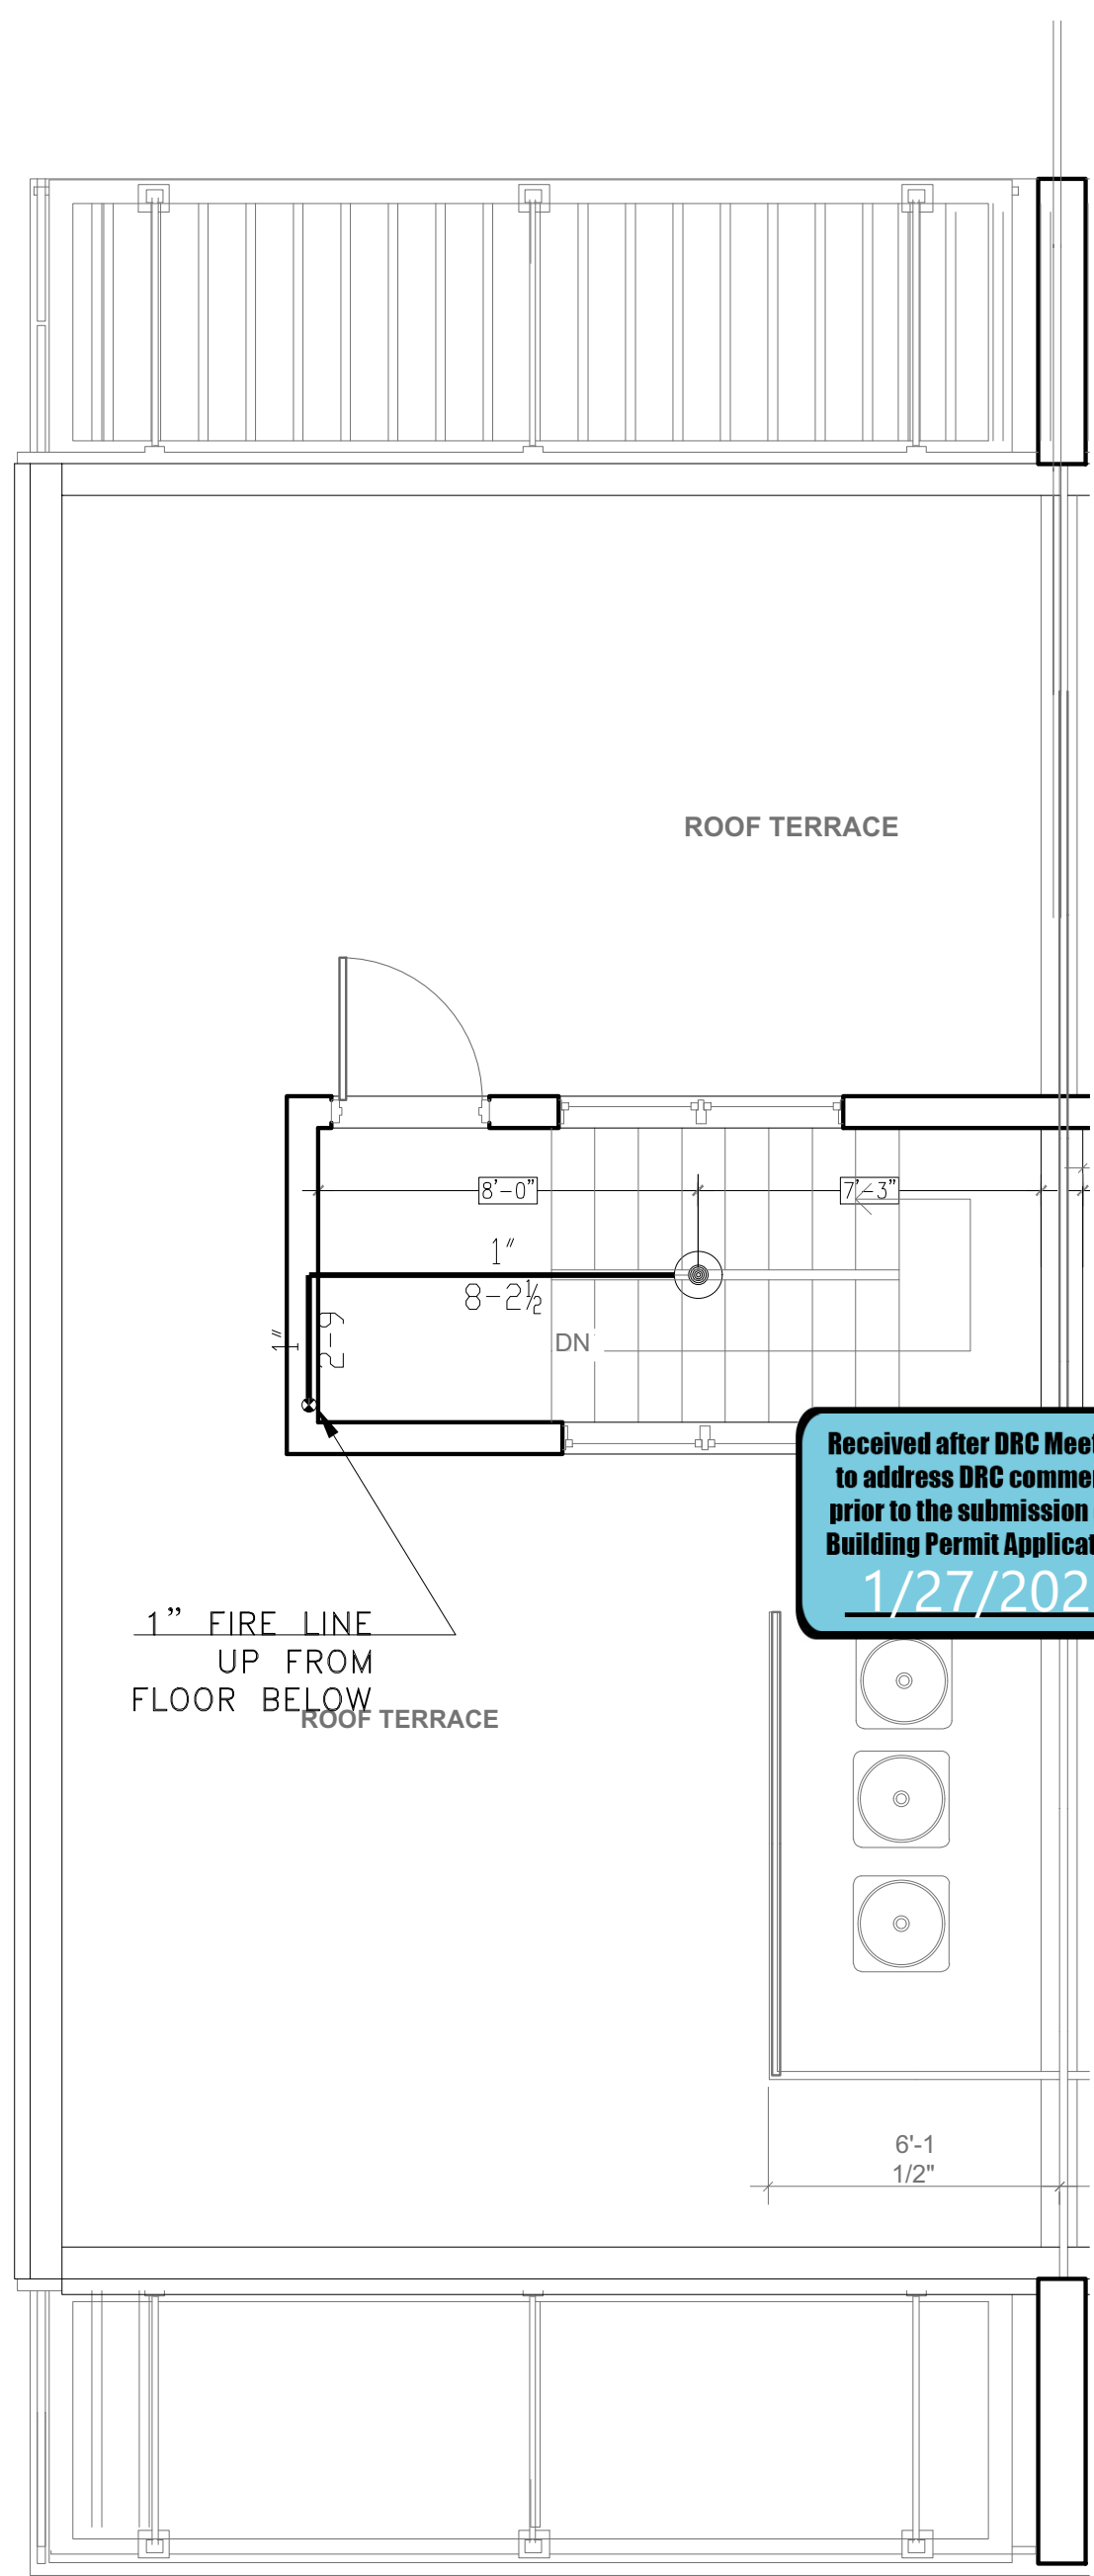


UNIT A FIRE ROOF FLOOR PLAN

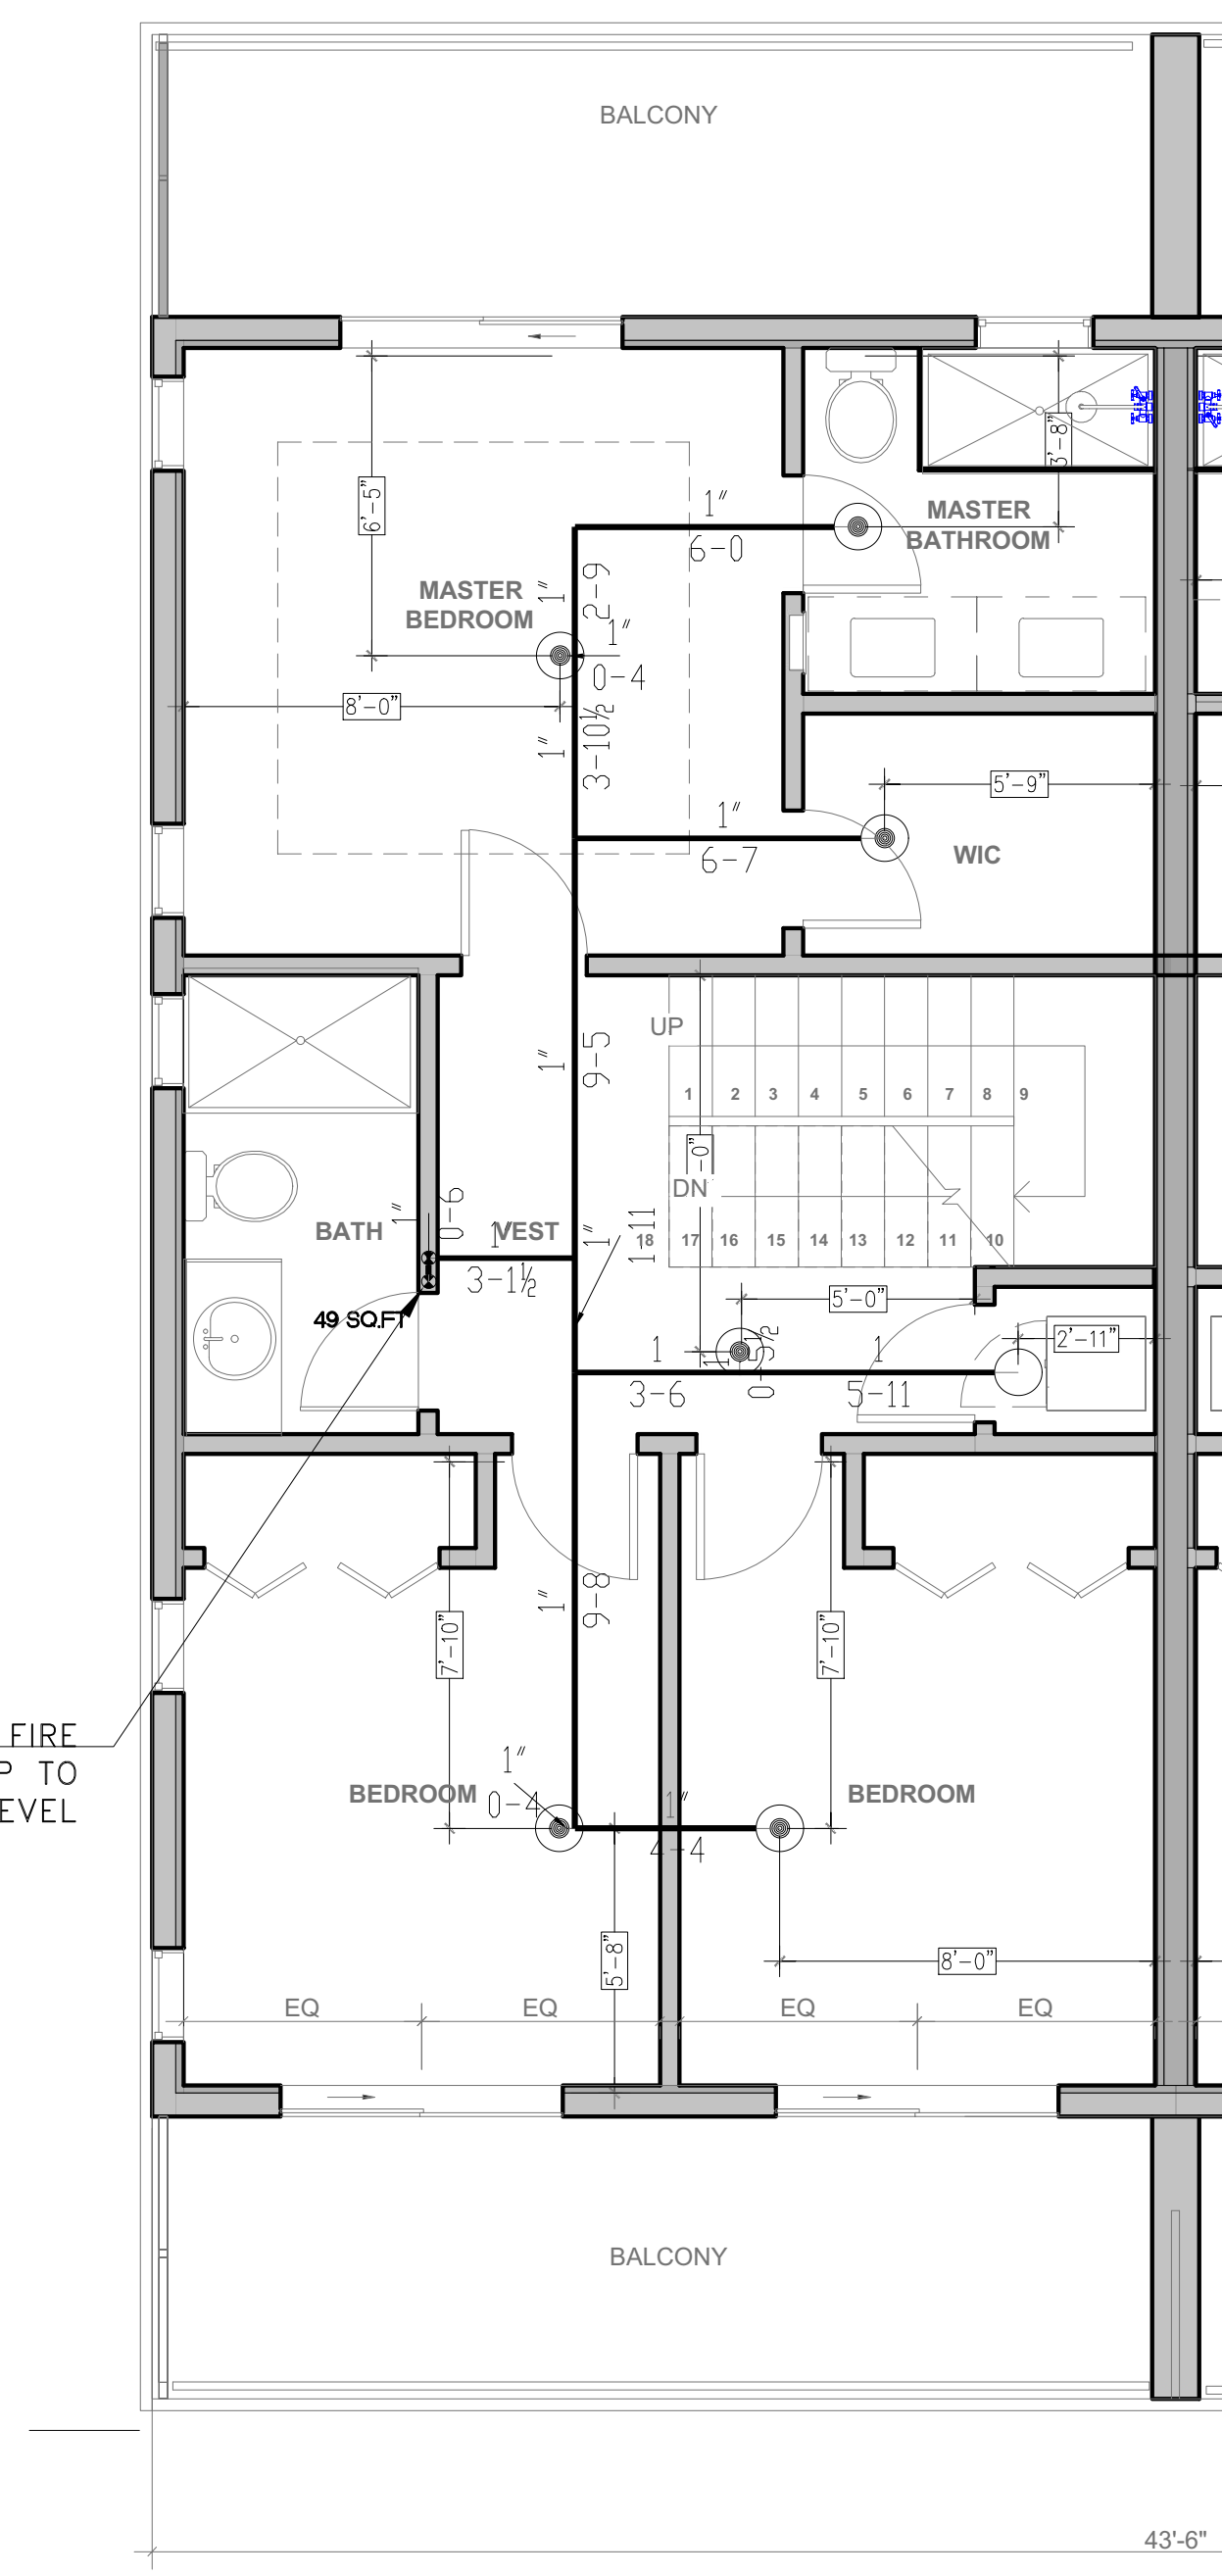

UNIT A FIRE 3RD FLOOR PLAN

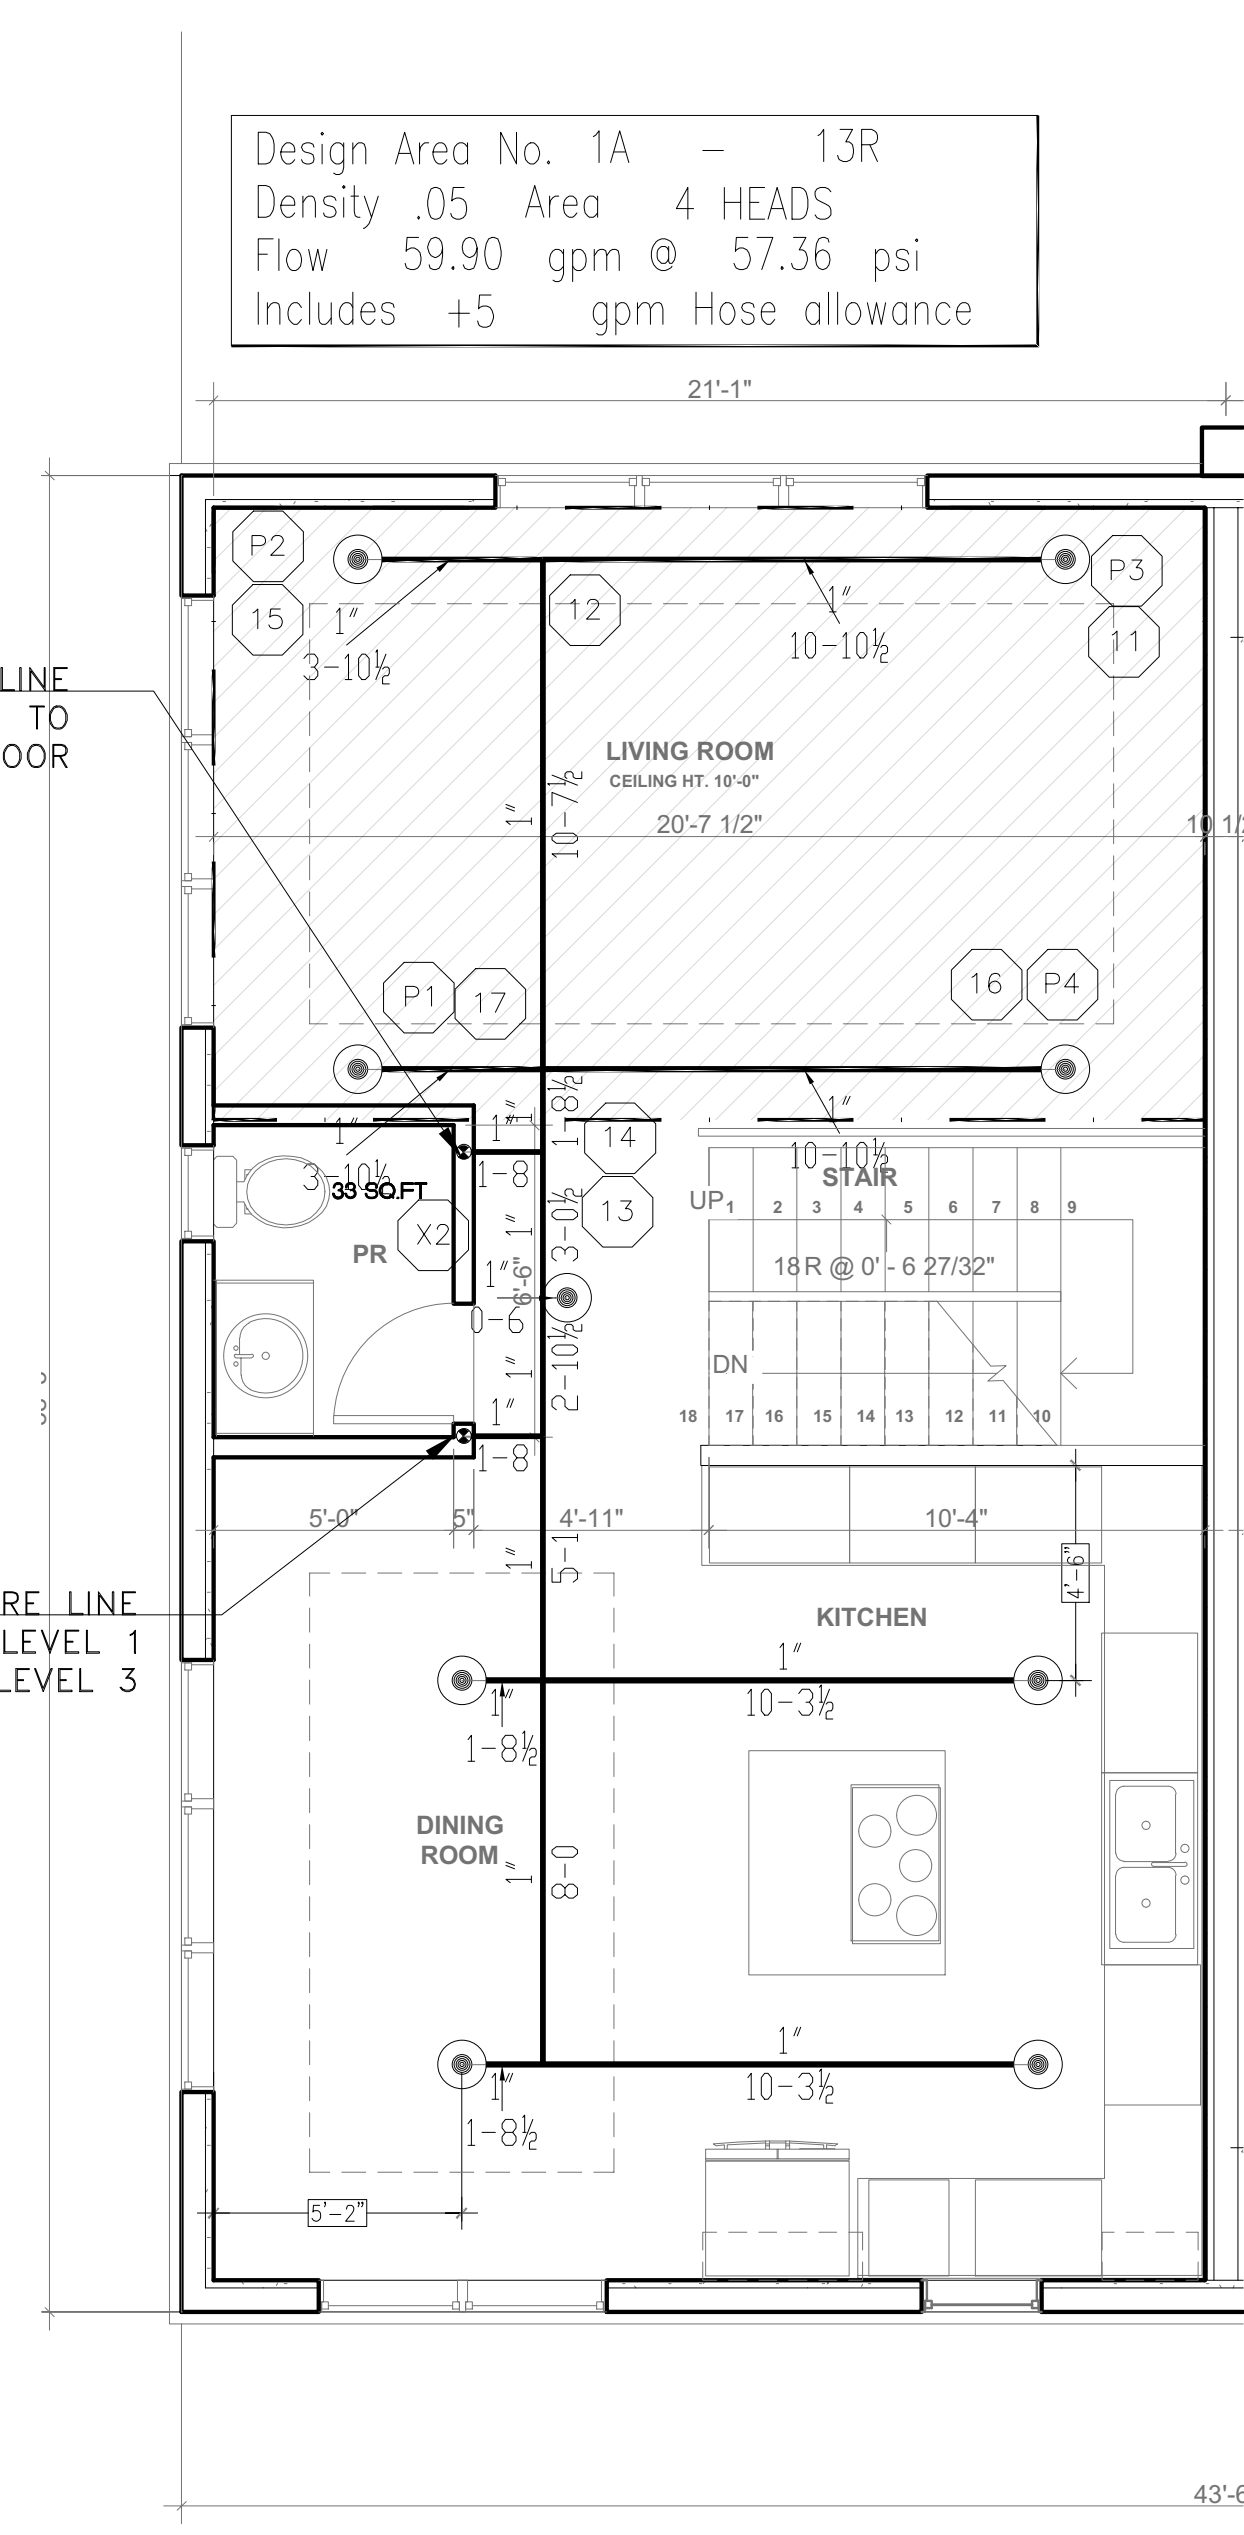

UNIT A FIRE 2ND FLOOR PLAN

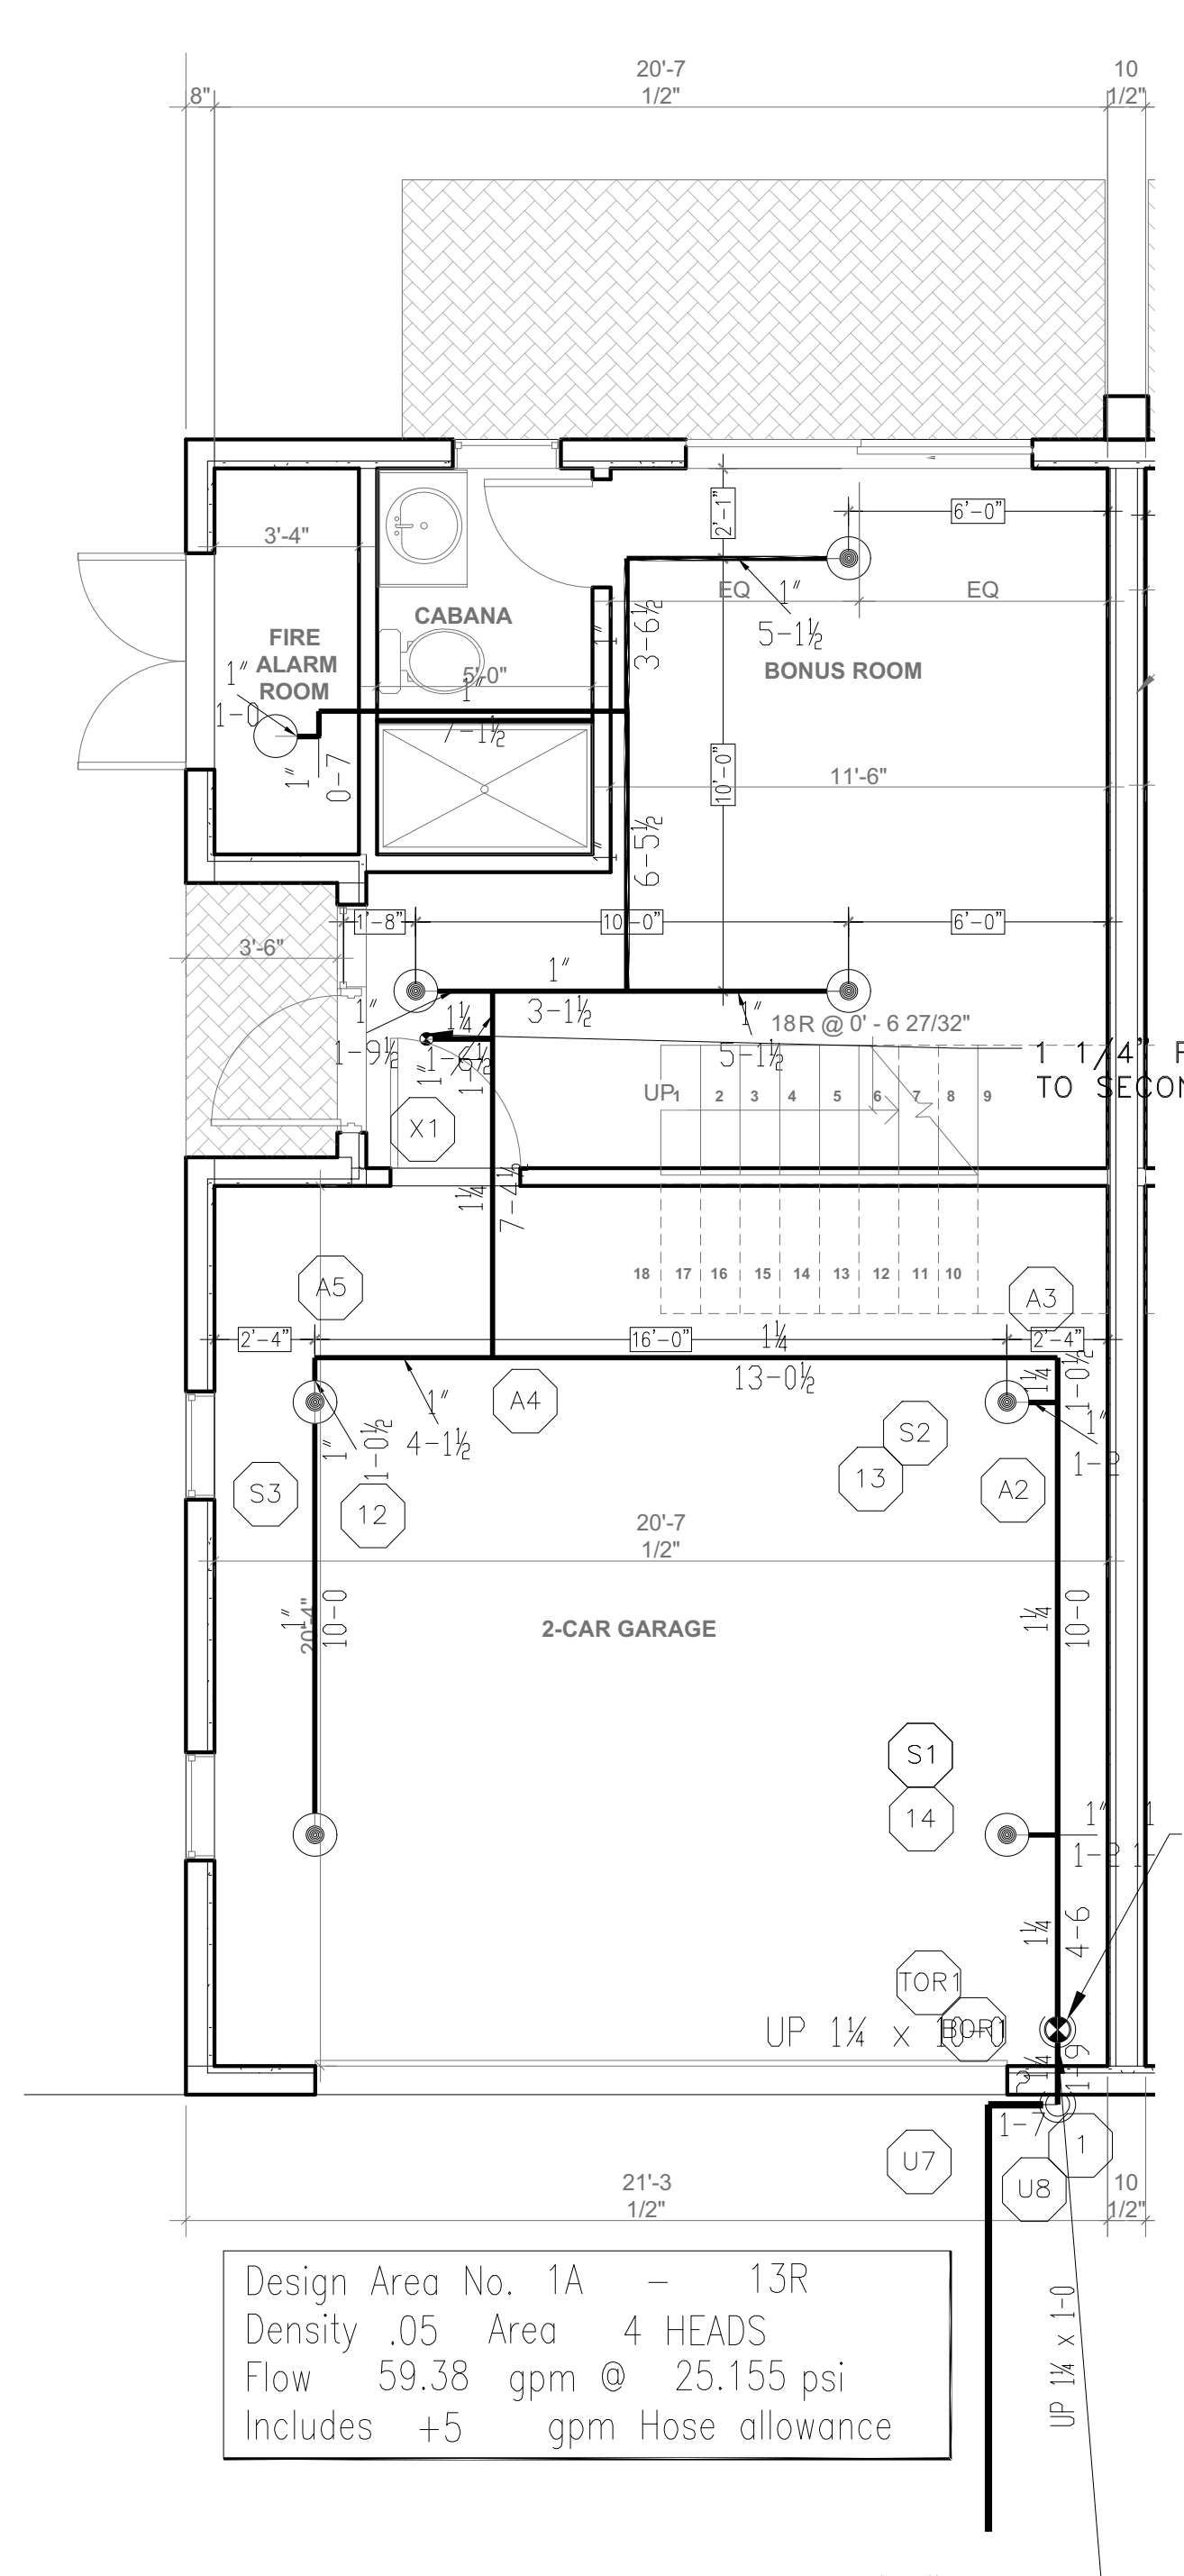

UNIT A FIRE 1ST FLOOR PLAN

SCALE: 1/4" = 1'-0"

SCALE: 1/4" = 1'-0"

SCALE: 1/4" = 1'-0"