

AirQuest Project #14545

Pre-Renovation Report of Building Material Survey, Sampling and Evaluation of Asbestos-Containing Materials

For:

Denny's

2671 North Federal Highway

Pompano Beach, Florida 33316

Prepared For:

Ms. Nadia Locke

Project Manager

E Sciences, Inc.

224 Southeast 9th Street

Fort Lauderdale, Florida 33316

October 26, 2018

AIRQUEST® ENVIRONMENTAL, INC.

Pre-Renovation Report of
Building Material Survey, Sampling and
Evaluation of Asbestos-Containing Materials

Denny's
2671 North Federal Highway
Pompano Beach, Florida 33316


AirQuest Project #14545

Prepared For:

Ms. Nadia Locke
Project Manager
E Sciences, Inc.
224 Southeast 9th Street
Fort Lauderdale, Florida 33316

Prepared By:

AirQuest Environmental, Inc.
6851 Southwest 45th Street
Fort Lauderdale, Florida 33314



Pedro Rodas
Project Manager



Traci-Anne Boyle, CIH, CSP
FL Asbestos Consultant #AX-60

October 26, 2018

TABLE OF CONTENTS

	PAGE
<u>1 EXECUTIVE SUMMARY</u>	<u>1</u>
<u>2 INTRODUCTION AND SITE DESCRIPTION</u>	<u>3</u>
<u>3 SURVEY METHODS AND LABORATORY ANALYSIS</u>	<u>4</u>
<u>4 SUSPECT ASBESTOS-CONTAINING MATERIALS</u>	<u>6</u>
<u>5 CONCLUSIONS AND RECOMMENDED RESPONSE ACTION</u>	<u>11</u>
<u>6 LIMITATIONS</u>	<u>13</u>

TABLES

Table 1 – Laboratory Analysis and Summary	6
---	---

APPENDICES

Appendix I – Certifications

Appendix II – Laboratory Reports and Chain of Custody Records

Appendix III- Photographs

1 EXECUTIVE SUMMARY

AirQuest Environmental, Inc. (“AirQuest”) performed a survey for asbestos-containing materials (ACM) at the Denny’s located at 2671 North Federal Highway, Pompano Beach, Florida 33316 (“the site”). The survey was performed on October 22 and 23, 2018, by AirQuest Project Manager, Pedro Rodas, an EPA-accredited Asbestos Hazard Emergency Response Act (AHERA) Asbestos Inspector (see Appendix I).

The purpose of the survey was to locate and identify ACM within the interior, exterior, and roof of the building prior to renovation activities.

The results of our observation and laboratory analysis identified the following ACM and presumed ACM:

Homogenous Area (HA) Material	Location	Percentage/ Type	Material Condition/ Friability	Approximate Quantity	Category
HA 6: Drywall System Ceilings	Throughout Dining Room, Bathrooms, and Back Area	Drywall: ND Joint Compound: 0.25% Chrysotile*	Fair/ Friable	950 SF	OSHA (non-ACM)
HA 7: Drywall System Walls	Throughout the Interior	Drywall: ND Joint Compound: 0.50% Chrysotile*	Fair/ Friable	Throughout	OSHA (non-ACM)
HA 29: White Mastic on Air-Conditioning Units	Northwest Area Units on Flat Roof	ND-8% Chrysotile	Fair/ Non-Friable	30 SF	Category II NESHAPs
HA 30: Black Mastic on Air-Conditioning Units	Northwest Area Units on Flat Roof	ND-10% Chrysotile	Fair/ Non-Friable	20 SF	Category II NESHAPs
Inaccessible Black Duct Mastic	Above Drywall System Ceilings	Presumed	Unknown	Unknown	Category II NESHAPs

SF-Square Feet

NESHAP– National Emissions Standard for Hazardous Air Pollutants

OSHA- Occupational Safety and Health Administration

Non-Friable- Material that, when dry, may not be crumbled, pulverized, or reduced to powder by hand pressure.

*Sample was Point Counted

National Emission Standards for Hazardous Air Pollutants (NESHAP) Category Recommendations:

- **Category I:** Category I nonfriable ACM refers to asbestos-containing packing, gaskets, resilient floor coverings, and asphalt roofing products.
- **Category II:** Category II nonfriable ACM refers to any material that is not classified under Category I.

- Renovation Activities: There is no regulatory guideline that requires removal of Category II nonfriable ACM unless they will be disturbed during renovation or demolition activities. If the Category II nonfriable ACM is to be impacted or removed, the removal must be conducted by a Florida Licensed Asbestos Abatement Contractor, with prior notification to the appropriate County and the State of Florida agencies.
- Demolition Activities: NESHAP regulations do not require that Category II nonfriable ACM be removed prior to demolition activities as long as the probability is low that the materials will not become crumbled, pulverized, or reduced to powder during demolition. However, many Category II materials (for example, transite panels) will become RACM during demolition activities and most NESHAP regulators require removal prior to demolition. Prior regulatory approval is needed if Category II nonfriable materials will remain in place during the demolition.

Category II nonfriable ACM that will remain in place during demolition must be kept wet during demolition activities, segregated from the waste stream and disposed of in a Class I landfill capable of accepting such material. The demolition crew must abide by OSHA regulations pertaining to asbestos exposure. The owner should consider removal prior to demolition as this may be more cost-effective than complying with OSHA regulations, the costs associated with segregating the waste stream and the additional disposal costs.

Prior to the removal or in-place wet demolition of Category II nonfriable material, notification to the appropriate County and the State of Florida agencies is required.

- **Occupational Safety and Health Administration (OSHA):** The results of the initial laboratory analysis for the friable drywall system walls and ceiling joint compound layer using the visual estimation method of quantification identified <1% chrysotile asbestos in the joint compound of five (5) samples. In accordance with Environmental Protection Agency (EPA) recommendations, the samples were then analyzed using the point count method of quantification. The results of the point count analysis were that the samples were <1% chrysotile asbestos. As such, the EPA does not consider these materials to be ACM. However, OSHA regulations pertaining to asbestos personnel exposure still apply to materials that contain <1% asbestos.

The rooms at the back of the building were locked and inaccessible at the time of the inspection and, therefore, were not inspected. The Client requested minimal destructive sampling procedures; therefore, the metal roof and related roofing materials at the west end of the building were not inspected due to the destructive nature of such testing. Black duct mastic above the drywall system ceiling was not accessible without being destructive and, therefore, should be assumed to be ACM.

Destructive sampling procedures were not used to access the interior of wall cavities, fire doors, or above hard ceilings. If any materials are encountered during renovation activities that were not sampled in this report, the materials should not be disturbed until they have been sampled and identified as non-ACM through laboratory analysis.

2 INTRODUCTION AND SITE DESCRIPTION

Denny's, located at 2671 North Federal Highway, Pompano Beach, Florida, was a single-story building and measured approximately 5,872 square feet. The scope of the inspection included the interior, exterior, and roof of the building.

The scope of services for this project consisted of the following five steps:

- Building Walk-Through and Observations,
- Bulk Sampling of Suspect ACM,
- Polarized Light Microscopy (PLM) Analysis of Bulk Samples,
- Hazard Assessment and Evaluation, and
- Final Report Preparation.

On October 22 and 23, 2018, AirQuest Project Manager, Pedro Rodas, conducted an asbestos sampling survey of suspect ACM associated with the pending renovations at the site.

Exterior and Roof: The building was constructed of concrete block on a concrete slab foundation and was finished with exterior stucco. The sloped wood roof deck and edge were finished with asphalt shingles. The flat wood roof deck was finished with a bituminous roofing membrane; built-up bituminous material was present at the membrane and flashing. Bituminous material was present at deck penetrations, pit pans, drains, and vent curbs. Bituminous material patches were present. Plaster and mastic were present at parapet walls. Two (2) types of mastic were present at the roof top air-conditioning units. The metal roof and related roofing materials at the west end of the building were not tested due to the destructive nature of such testing. Mastic was present at exterior louvers on the south side of the building. Exterior door and window caulk were present.

Interior: Ceilings were constructed of drywall system and select areas were finished with six (6) types of acoustic ceiling tile (including acoustic ceiling tile in the plenum). Interior walls were constructed of drywall system and select areas were finished with vinyl floor coving. Office area walls were finished with rigid fiberglass panels. Bathroom walls were finished with ceramic tile. Floors were finished with two (2) types of ceramic tile, and rolled-on floor sheeting. Tile mastic and grout, carpet glue, rigid fiberglass panel glue, and flooring glue were present. Acoustic ceiling tile and mastic, and two (2) types of air-conditioning duct mastic were present in the plenum.

3 SURVEY METHODS AND LABORATORY ANALYSIS

The sampling protocol used generally follows Asbestos Hazard Emergency Response Act (AHERA) guidelines. AHERA was promulgated by the United States Environmental Protection Agency (EPA) in 1987 and regulated public schools.

Suspect materials are differentiated into three categories: surfacing material, thermal system insulation, or miscellaneous material. Surfacing material is anything that is sprayed or troweled onto a surface; thermal system insulation is material used to insulate HVAC pipes, tanks, etc., and miscellaneous material is any other type of material. During the survey, surfacing and miscellaneous materials were observed.

A homogeneous area is defined as an area of surfacing material, thermal system insulation material, or miscellaneous material that is uniform in color and texture. A homogeneous area is not limited to only one room, but can be found in several rooms. Sample selection in the building was determined by identifying the homogeneous areas and basing sampling locations upon these areas.

In conducting the building inspection in compliance with all local, state, and federal regulations, all suspected ACM which were accessible to the inspector, were either sampled to confirm the actual presence of asbestos, or assumed to contain asbestos.

Building areas between walls, under floors, under concrete slabs and above permanent ceilings, all of which could not be accessed, were not visually inspected nor were materials therein sampled as a part of this building inspection.

Due to the fact that over 3,600 different building products are recognized as asbestos-containing building materials, it cannot be said that all such products, which may be included in the subject building, have or could be identified.

Analysis was performed using Polarized Light Microscopy (PLM) with dispersion staining. The laboratory is rated proficient through National Institute of Standards and Technology- National Voluntary Laboratory Accreditation Program (NIST-NVLAP) for bulk asbestos analysis.

It is important to note that the method of bulk sample analysis, PLM, is not 100% absolute in the identification of ACM. There are many factors which may contribute to false negatives being reported. Some of the more common factors include non-homogeneity of the building material and the optical variations of the microscopist. In order to obtain an absolute analysis of a building material, any reported negative sample suspect of being asbestos or any material not sampled should be analyzed by Transmission Electron Microscopy (TEM) with energy dispersive x-ray analysis (EDAX) for bulk sample confirmation. Interpretation of TEM results must be viewed with caution as these procedures are not presently recognized by EPA regulations. However, they are useful analytical techniques for confirmation of non-friable materials when PLM results are inconclusive.

Because of the inherent limitations of PLM Bulk Sample analysis, the Owner may elect to re-analyze the reported negative PLM samples by TEM to determine whether they may be regulated under the Asbestos National Emission Standards for Hazardous Air Pollutants (NESHAP).

This analytical technique is described in the EPA Guidance Document, EPA/600 R-93/116, July 1993, Test Method – Method for the Determination of Asbestos in Bulk Building Materials. This method, Analytical Electron Microscopy (AEM), also referred to as TEM, can often be a reliable method for the detection and positive identification of asbestos in some bulk building materials, both friable and nonfriable. The method is particularly applicable to bulk materials that contain a large amount of interfering materials that can be removed by ashing and/or dissolution and contain asbestos fibers that are not resolved by PLM techniques. Many floor tiles and plasters would be included in the type of sample. In combination with suitable specimen preparation techniques, the AEM method can also be used to quantify asbestos concentrations.

The TEM analytical methodology is also referred to in an EPA Advisory, Federal Register, Vol. 59, No. 146, August 1, 1994, Advisory Regarding Availability of an Improved Asbestos Bulk Sample Analysis Sample Test Method; Supplementary Information on Bulk Sample Collection and Analysis. The Advisory states that this approach should be considered for the following circumstances: (1) Floor tiles which may contain thin fibers and which were analyzed under the 1982 PLM method and found not to be asbestos-containing; and (2) materials such as hard wall and acoustical plaster, stucco or other similar multi-layered materials or systems which were not analyzed and reported by layers (discrete strata).

NESHAP, 40 CFR Part 763, Section 61.141, revised July 1, 1996, defines ACM as any material containing more than one (1) percent asbestos as determined using the method specified in Appendix E, Subpart E, 40 CFR Part 763, Section 1, PLM, that, when dry, can be crumbled, pulverized or reduced to a powder by hand pressure. If the asbestos content is less than ten (10) percent as determined by a method other than point counting by PLM, verify the asbestos content by point counting using PLM.

Estimates of quantities of ACM where given are based upon the identification of suspect materials. Where suspect ACM are located behind walls, above ceilings, beneath carpeting, or other concealed conditions. Where the quantities cannot be verified, the estimate is based upon the conditions present during the survey. These estimates are not to be considered absolute and should be verified when the ACM is exposed.

4 SUSPECT ASBESTOS-CONTAINING MATERIALS

Thirty-four (34) homogeneous areas (HA) of suspect material were identified and a total of seventy-eight (78) samples were collected. The laboratory split the samples into layers, resulting in the analysis of ninety-four (94) samples. Sample descriptions and laboratory results are summarized in Table 1. Sample locations and HAs identified to be ACM are described in Section 5.

A copy of the laboratory report and chain of custody record is included in Appendix II. Photographs of each HA are included in Appendix III.

Table 1 – Laboratory Analysis and Summary

Samples Collected on October 22 and 23, 2018

Sample Number	HA	Location	Description of Suspect Material	Asbestos Content %
4545-01	1	Dining Area Center	White 2' x 2' ACT with Rough Finish	ND
4545-02	1	Dining Area East End	White 2' x 2' ACT with Rough Finish	ND
4545-03	1	Dining Area West End	White 2' x 2' ACT with Rough Finish	ND
4545-04	2	Dining Area East End	White 2' x 2' ACT with Waves Pattern	ND
4545-05	2	Dining Area East End	White 2' x 2' ACT with Waves Pattern	ND
4545-06	3	Dining Area East End	White 2' x 2' ACT with Dot/Gash Pattern	ND
4545-07	3	Dining Area East End	White 2' x 2' ACT with Dot/Gash Pattern	ND
4545-08	4	Dining Area West End	Grey 8" x 8" Ceramic Floor Tile & Grout	ND
4545-09	4	Bathroom Corridor	Grey 8" x 8" Ceramic Floor Tile & Grout	ND
4545-10	5	Dining Area Center	Orange 4" x 4" Ceramic Floor Tile & Grout	ND
4545-11	5	Back Corridor	Orange 4" x 4" Ceramic Floor Tile & Grout	ND

Sample Number	HA	Location	Description of Suspect Material	Asbestos Content %
4545-12	6	Entrance Back Area	Drywall System Ceiling	Drywall: ND Joint Compound: 0.50% Chrysotile*
4545-13	6	Bathroom Corridor	Drywall System Ceiling	Drywall: ND Joint Compound: 0.50% Chrysotile*
4545-14	7	Bathroom Corridor	Drywall System Walls	Drywall: ND Joint Compound: 0.25% Chrysotile*
4545-15	7	Storage 1	Drywall System Walls	Drywall: ND Joint Compound: 0.25% Chrysotile*
4545-16	7	Storage 2	Drywall System Walls	Drywall: ND Joint Compound: 0.25% Chrysotile*
4545-17	8	Dishwasher Area	White 2' x 2' Gypsum ACT	ND
4545-18	8	Dishwasher Area	White 2' x 2' Gypsum ACT	ND
4545-19	9	Storage 1	White 2' x 2' ACT with Dot Pattern	ND
4545-20	9	Storage 1	White 2' x 2' ACT with Dot Pattern	ND
4545-21	10	Near Office Area	Rigid Fiberglass Wall Panel & Glue	ND
4545-22	10	Near Office Area	Rigid Fiberglass Wall Panel & Glue	ND
4545-23	11	Men's Restroom	Beige 3" x 3" Ceramic Wall Tile & Glue	ND
4545-24	11	Women's Restroom	Beige 3" x 3" Ceramic Wall Tile & Glue	ND
4545-25	12	Storage 2	Black 4" Vinyl Base Cove & Mastic	ND
4545-26	12	Storage 3	Black 4" Vinyl Base Cove & Mastic	ND
4545-27	13	Storage 3	Red Rolled Floor Sheeting & Glue	ND
4545-28	13	Storage 3	Red Rolled Floor Sheeting & Glue	ND

Sample Number	HA	Location	Description of Suspect Material	Asbestos Content %
4545-29	14	Dining Area Above Plenum	Tan 1' x 1' ACT	ND
4545-30	14	Dining Area Above Plenum	Tan 1' x 1' ACT	ND
4545-31	14	Dining Area Above Plenum	Tan 1' x 1' ACT	ND
4545-32	15	Dining Area Above Plenum	Brown Mastic	ND
4545-33	15	Dining Area Above Plenum	Brown Mastic	ND
4545-34	16	Dining Area Center	White Mastic at Air-Conditioning Vent	ND
4545-35	16	Dining Area East End	White Mastic at Air-Conditioning Vent	ND
4545-36	17	Dining Area West End	Yellow Carpet Glue	ND
4545-37	17	Dining Area East End	Yellow Carpet Glue	ND
4545-38	18	North Side	Exterior Stucco	ND
4545-39	18	North Side	Exterior Stucco	ND
4545-40	18	East Side	Exterior Stucco	ND
4545-41	18	East Side	Exterior Stucco	ND
4545-42	18	South Side	Exterior Stucco	ND
4545-43	18	West Side	Exterior Stucco	ND
4545-44	18	West Side	Exterior Stucco	ND
4545-45	19	East Door	Exterior Door Caulk	ND
4545-46	19	North Door	Exterior Door Caulk	ND
4545-47	20	North Window	Exterior Window Caulk	ND

Sample Number	HA	Location	Description of Suspect Material	Asbestos Content %
4545-48	20	North Window	Exterior Window Caulk	ND
4545-49	21	Flat Roof East End	Built-Up Bituminous Roofing Material at Membrane	ND
4545-50	21	Flat Roof North End	Built-Up Bituminous Roofing Material at Membrane	ND
4545-51	21	Flat Roof Northwest End	Built-Up Bituminous Roofing Material at Membrane	ND
4545-52	22	Flat Roof West Parapet Area	Built-Up Bituminous Roofing Material at Flashing	ND
4545-53	22	Flat Roof North Parapet Area	Built-Up Bituminous Roofing Material at Flashing	ND
4545-54	23	Flat Roof South Parapet Wall	Plaster	ND
4545-55	23	Flat Roof North Parapet Wall	Plaster	ND
4545-56	23	Flat Roof West Parapet Wall	Plaster	ND
4545-57	24	Flat Roof South End	Bituminous Roofing Material at Deck Penetration	ND
4545-58	24	Flat Roof Southwest End	Bituminous Roofing Material at Deck Penetration	ND
4545-59	25	Flat Roof Center Area	Pitch Pan Mastic	ND
4545-60	25	Flat Roof Center Area	Pitch Pan Mastic	ND
4545-61	26	Flat Roof Southeast Area	Bituminous Roofing Material at Drains	ND
4545-62	26	Flat Roof Southwest Area	Bituminous Roofing Material at Drains	ND
4545-63	27	Flat Roof Southeast Area	Bituminous Roofing Material Patch	ND

Sample Number	HA	Location	Description of Suspect Material	Asbestos Content %
4545-64	27	Flat Roof Southeast Area	Bituminous Roofing Material Patch	ND
4545-65	28	Flat Roof South Unit	Bituminous Roofing Material at Vent Curbs	ND
4545-66	28	Flat Roof North Unit	Bituminous Roofing Material at Vent Curbs	ND
4545-67	29	Flat Roof Northwest Area Unit	White Mastic at Air-Conditioning Unit	8% Chrysotile
4545-68	29	Flat Roof Northwest Area Unit	White Mastic at Air-Conditioning Unit	ND
4545-69	30	Flat Roof Northwest Area Unit	Black Mastic at Air-Conditioning Units	10% Chrysotile
4545-70	30	Flat Roof Northwest Area Unit	Black Mastic at Air-Conditioning Units	ND
4545-71	31	Roof South Side	Shingles	ND
4545-72	31	Roof North Side	Shingles	ND
4545-73	32	Roof Edge	Shingles	ND
4545-74	32	Roof Edge	Shingles	ND
4545-75	33	Flat Roof Northwest Top of Parapet Wall	Black Mastic	ND
4545-76	33	Flat Roof Northwest Top of Parapet Wall	Black Mastic	ND
4545-77	34	Louver South Side	Black Mastic	ND
4545-78	34	Louver South Side	Black Mastic	ND
HA- Homogenous Area ND- None Detected ACT-Acoustic Ceiling Tile *Sample was Point Counted				

5 CONCLUSIONS AND RECOMMENDED RESPONSE ACTION

The results of our observation and laboratory analysis identified the following ACM and presumed ACM:

Homogenous Area (HA) Material	Location	Percentage/ Type	Material Condition/ Friability	Approximate Quantity	Category
HA 6: Drywall System Ceilings	Throughout Dining Room, Bathrooms, and Back Area	Drywall: ND Joint Compound: 0.25% Chrysotile*	Fair/ Friable	950 SF	OSHA (non-ACM)
HA 7: Drywall System Walls	Throughout the Interior	Drywall: ND Joint Compound: 0.50% Chrysotile*	Fair/ Friable	Throughout	OSHA (non-ACM)
HA 29: White Mastic on Air-Conditioning Units	Northwest Area Units on Flat Roof	ND-8% Chrysotile	Fair/ Non-Friable	30 SF	Category II NESHAPs
HA 30: Black Mastic on Air-Conditioning Units	Northwest Area Units on Flat Roof	ND-10% Chrysotile	Fair/ Non-Friable	20 SF	Category II NESHAPs
Inaccessible Black Duct Mastic	Above Drywall System Ceilings	Presumed	Unknown	Unknown	Category II NESHAPs

SF-Square Feet

NESHAP– National Emissions Standard for Hazardous Air Pollutants

OSHA- Occupational Safety and Health Administration

Non-Friable- Material that, when dry, may not be crumbled, pulverized, or reduced to powder by hand pressure.

*Sample was Point Counted

National Emission Standards for Hazardous Air Pollutants (NESHAP) Category Recommendations:

- **Category I:** Category I nonfriable ACM refers to asbestos-containing packing, gaskets, resilient floor coverings, and asphalt roofing products.
- **Category II:** Category II nonfriable ACM refers to any material that is not classified under Category I.
 - Renovation Activities: There is no regulatory guideline that requires removal of Category II nonfriable ACM unless they will be disturbed during renovation or demolition activities. If the Category II nonfriable ACM is to be impacted or removed, the removal must be conducted by a Florida Licensed Asbestos Abatement Contractor, with prior notification to the appropriate County and the State of Florida agencies.

- Demolition Activities: NESHAP regulations do not require that Category II nonfriable ACM be removed prior to demolition activities as long as the probability is low that the materials will not become crumbled, pulverized, or reduced to powder during demolition. However, many Category II materials (for example, transite panels) will become RACM during demolition activities and most NESHAP regulators require removal prior to demolition. Prior regulatory approval is needed if Category II nonfriable materials will remain in place during the demolition.

Category II nonfriable ACM that will remain in place during demolition must be kept wet during demolition activities, segregated from the waste stream and disposed of in a Class I landfill capable of accepting such material. The demolition crew must abide by OSHA regulations pertaining to asbestos exposure. The owner should consider removal prior to demolition as this may be more cost-effective than complying with OSHA regulations, the costs associated with segregating the waste stream and the additional disposal costs.

Prior to the removal or in-place wet demolition of Category II nonfriable material, notification to the appropriate County and the State of Florida agencies is required.

- **Occupational Safety and Health Administration (OSHA):** The results of the initial laboratory analysis for the friable drywall system walls and ceiling joint compound layer using the visual estimation method of quantification identified <1% chrysotile asbestos in the joint compound of five (5) samples. In accordance with Environmental Protection Agency (EPA) recommendations, the samples were then analyzed using the point count method of quantification. The results of the point count analysis were that the samples were <1% chrysotile asbestos. As such, the EPA does not consider these materials to be ACM. However, OSHA regulations pertaining to asbestos personnel exposure still apply to materials that contain <1% asbestos.

6 LIMITATIONS

The rooms at the back of the building were locked and inaccessible at the time of the inspection and, therefore, were not inspected. The Client requested minimal destructive sampling procedures; therefore, the metal roof and related roofing materials at the west end of the building were not inspected due to the destructive nature of such testing. Black duct mastic above the drywall system ceiling was not accessible without being destructive and, therefore, should be assumed to be ACM.

Destructive sampling procedures were not used to access the interior of wall cavities, fire doors, or above hard ceilings. If any materials are encountered during renovation activities that were not sampled in this report, the materials should not be disturbed until they have been sampled and identified as non-ACM through laboratory analysis.

This report was prepared in a manner consistent with that level of care and skill ordinarily exercised by members of the profession currently practicing under similar conditions. This report was prepared for the exclusive use of the client and assigned agents and is not intended for any other purposes. Our report is based on the information available to us at the time of our investigation and limited in scope to the stated purpose and/or the area(s) inspected. Other conditions elsewhere in the site may differ from those in the inspected/ surveyed locations and such conditions are unknown, may change over time, and/or have not been considered. This report does not claim to identify all potential hazards and/or contaminants that may be present, nor does it imply any medical opinion on the relationship of potential health effects with any reported hazards and/ or contaminants. Our opinions are based on our findings and professional expertise, with no guaranty or warranty implied herein. The data obtained in this report does not establish the habitability of the site, nor does it determine if a building is safe or unsafe. Should additional information become available, we reserve the right to determine the impact, if any, of the new information on our opinions, conclusions, and recommendations if necessary as warranted by the discovery of the additional information. AirQuest accepts no responsibility for interpretation of this report by others. Its contents shall not be used or relied upon by other parties without prior written authorization by AirQuest.

Appendix I

Certifications

Certificate Of Completion

Asbestos Building Inspector Refresher Course

DOSH #:CA-015-06

Pedro Rodas

ABIR0427180002N15416

Paul Semper

Principal Instructor

4/27/2018

Course Start Date

4/27/2018

Course End Date

Michael W. Horner

Michael W. Horner

Training Director

4/27/2018

Exam Date

4/27/2019

Expiration Date

This course satisfies the education requirements for Asbestos accreditation under the Toxic Substances Control Act, Title II. This course has been approved by the Department of Industrial Relations, Division of Occupational Safety and Health of the State of California.

NATEC International, Inc.

National Association of Training and Environmental Consulting

1100 Technology Circle- Suite A, Anaheim, CA 92805 • www.natecintl.com • 800-969-3228



Important Industry Contacts

CAL-OSHA: Ph# (916) 574-2993
(916) 483-0572 Fax Notification
Web: www.dir.ca.gov or calosha.com

CDPH/CI PPR: Ph# (510) 620-5600
Web: www.cdph.ca.gov/programs/CLPPB

SCAQMD: Ph# (909) 396-1719
Fax#(909) 396-3342

BAAQMD: Ph# (415) 749-4702

NATEC International, Inc.

National Association of Training and Environmental Consulting

Anaheim, CA • Oakland, CA • Fresno, CA • Sacramento, CA

Asbestos • Lead • Mold • HAZWOPER

P.O. Box 25205 Anaheim, CA 92825-5205
(714) 678-2750, (800) 969-3228, Fax (714) 678-2757
www.natecintl.com

NATEC International, Inc.

National Association of Training and Environmental Consulting
*Note: Card is not suitable substitute for certificate and is not accepted by SCAGMD as proof of certification

This Card Acknowledges That
Pedro Rodas

Holds Training Certification For
Asbestos Building Inspector Refresher Course

(Valid for 12 months)

Training Date: **4/27/2018**
Certificate No: **ABIR0427180002N15416**

Michael W. Horner
Training Director

Appendix II

Laboratory Reports and Chain of Custody Records



EMSL Analytical, Inc.

2700 W. Cypress Creek Rd. Ste. C108 Fort Lauderdale, FL 33309

Tel/Fax: (954) 786-9331 / (954) 941-4145

<http://www.EMSL.com> / pompanobeachlab@emsl.com

EMSL Order: 561805735

Customer ID: AQE63

Customer PO:

Project ID:

Attention: Paul LeBlanc

AirQuest Environmental, Inc.

6851 Southwest 45th Street

Fort Lauderdale, FL 33314

Phone: (954) 214-2640

Fax: (954) 792-2221

Received Date: 10/23/2018 10:20 AM

Analysis Date: 10/23/2018

Collected Date: 10/22/2018

Project: 2671 N. Federal Highway, Pompano - 14545

Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
4545-01 561805735-0001	Ceiling Tile	White Fibrous Homogeneous	10% Cellulose 80% Min. Wool	10% Non-fibrous (Other)	None Detected
4545-02 561805735-0002	Ceiling Tile	White Fibrous Homogeneous	10% Cellulose 80% Min. Wool	10% Non-fibrous (Other)	None Detected
4545-03 561805735-0003	Ceiling Tile	Gray/White Fibrous Homogeneous	3% Cellulose 90% Min. Wool	7% Non-fibrous (Other)	None Detected
4545-04 561805735-0004	Ceiling Tile	Brown/White Fibrous Homogeneous	65% Cellulose 15% Min. Wool	20% Non-fibrous (Other)	None Detected
4545-05 561805735-0005	Ceiling Tile	Tan/White Fibrous Homogeneous	70% Cellulose 10% Min. Wool	20% Non-fibrous (Other)	None Detected
4545-06 561805735-0006	Ceiling Tile	Brown/White Fibrous Homogeneous	75% Cellulose 5% Min. Wool	20% Non-fibrous (Other)	None Detected
4545-07 561805735-0007	Ceiling Tile	Gray/White Fibrous Homogeneous	70% Cellulose 10% Min. Wool	20% Non-fibrous (Other)	None Detected
4545-08-Ceramic Tile 561805735-0008	Ceramic Floor Tile & Grout	Brown Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-08-Grout 561805735-0008A	Ceramic Floor Tile & Grout	Brown/Black Non-Fibrous Homogeneous	3% Cellulose	97% Non-fibrous (Other)	None Detected
4545-09-Ceramic Tile 561805735-0009	Ceramic Floor Tile & Grout	Red Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-09-Grout 561805735-0009A	Ceramic Floor Tile & Grout	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-10-Ceramic Tile 561805735-0010	Ceramic Floor Tile & Grout	Brown Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-10-Grout 561805735-0010A	Ceramic Floor Tile & Grout	Gray/Black Non-Fibrous Homogeneous	<1% Cellulose	100% Non-fibrous (Other)	None Detected
4545-11-Ceramic Tile 561805735-0011	Ceramic Floor Tile & Grout	Red Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-11-Grout 561805735-0011A	Ceramic Floor Tile & Grout	Brown Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-12-Drywall 561805735-0012	Drywall System	Brown/White Fibrous Homogeneous	12% Cellulose <1% Glass	88% Non-fibrous (Other)	None Detected

Initial report from: 10/24/2018 08:32:19



EMSL Analytical, Inc.

2700 W. Cypress Creek Rd. Ste. C108 Fort Lauderdale, FL 33309

Tel/Fax: (954) 786-9331 / (954) 941-4145

<http://www.EMSL.com> / pompanobeachlab@emsl.com

EMSL Order: 561805735

Customer ID: AQE63

Customer PO:

Project ID:

Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
4545-12-Joint Compound	Drywall System	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	<1% Chrysotile
561805735-0012A					
4545-13-Drywall	Drywall System	Brown/Beige Fibrous Homogeneous	10% Cellulose	90% Non-fibrous (Other)	None Detected
561805735-0013					
4545-13-Joint Compound	Drywall System	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	<1% Chrysotile
561805735-0013A					
4545-14-Drywall	Drywall System	Brown/White Fibrous Homogeneous	10% Cellulose 2% Glass	88% Non-fibrous (Other)	None Detected
561805735-0014					
4545-14-Joint Compound	Drywall System	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	<1% Chrysotile
561805735-0014A					
4545-15-Drywall	Drywall System	Brown/Gray Fibrous Homogeneous	10% Cellulose 2% Glass	88% Non-fibrous (Other)	None Detected
561805735-0015					
4545-15-Joint Compound	Drywall System	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	<1% Chrysotile
561805735-0015A					
4545-16-Drywall	Drywall System	Brown/Tan Fibrous Homogeneous	15% Cellulose	85% Non-fibrous (Other)	None Detected
561805735-0016					
4545-16-Joint Compound	Drywall System	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	<1% Chrysotile
561805735-0016A					
4545-17	Gypsum Ceiling Tile	White/Black Fibrous Homogeneous	10% Cellulose 5% Glass	85% Non-fibrous (Other)	None Detected
561805735-0017					
4545-18	Gypsum Ceiling Tile	Brown/White Fibrous Homogeneous	10% Cellulose 4% Glass	86% Non-fibrous (Other)	None Detected
561805735-0018					
4545-19	Ceiling Tile	Gray/White Fibrous Homogeneous	45% Cellulose 45% Min. Wool	10% Non-fibrous (Other)	None Detected
561805735-0019					
4545-20	Ceiling Tile	White/Beige Fibrous Homogeneous	70% Cellulose 15% Min. Wool	15% Non-fibrous (Other)	None Detected
561805735-0020					
4545-21-Fiber Panel	Glue	White Fibrous Homogeneous	80% Glass	20% Non-fibrous (Other)	None Detected
561805735-0021					
4545-21-Glue	Glue	Brown Non-Fibrous Homogeneous	2% Cellulose	98% Non-fibrous (Other)	None Detected
561805735-0021A					
4545-22-Fiber Panel	Glue	White Fibrous Homogeneous	70% Glass	30% Non-fibrous (Other)	None Detected
561805735-0022					
4545-22-Glue	Glue	Tan Non-Fibrous Homogeneous	2% Cellulose	98% Non-fibrous (Other)	None Detected
561805735-0022A					

Initial report from: 10/24/2018 08:32:19



EMSL Analytical, Inc.

2700 W. Cypress Creek Rd. Ste. C108 Fort Lauderdale, FL 33309

Tel/Fax: (954) 786-9331 / (954) 941-4145

<http://www.EMSL.com> / pompanobeachlab@emsl.com

EMSL Order: 561805735

Customer ID: AQE63

Customer PO:

Project ID:

Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
4545-23 561805735-0023	Ceramic Wall Tile & Grout	Gray/White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-24-Ceramic Tile 561805735-0024	Ceramic Wall Tile & Grout	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-24-Glue 561805735-0024A	Ceramic Wall Tile & Grout	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-25-Cove Base 561805735-0025	Vinyl Floor Covings & Glue	White/Black Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-25-Mastic 561805735-0025A	Vinyl Floor Covings & Glue	Tan Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-26-Cove Base 561805735-0026	Vinyl Floor Covings & Glue	Black Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-26-Mastic 561805735-0026A	Vinyl Floor Covings & Glue	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-26-Mastic 2 561805735-0026B	Vinyl Floor Covings & Glue	Brown Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-27-Roll Sheet 561805735-0027	Roll Sheet & Glue	Red Fibrous Homogeneous	5% Glass	95% Non-fibrous (Other)	None Detected
4545-27-Glue 561805735-0027A	Roll Sheet & Glue	Brown Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-28-Roll Sheet 561805735-0028	Roll Sheet & Glue	Red Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-28-Glue 561805735-0028A	Roll Sheet & Glue	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-29 561805735-0029	Ceiling Tile	Gray/White Fibrous Homogeneous	5% Cellulose 85% Min. Wool	10% Non-fibrous (Other)	None Detected
4545-30 561805735-0030	Ceiling Tile	Gray/White Fibrous Homogeneous	5% Cellulose 85% Min. Wool	10% Non-fibrous (Other)	None Detected
4545-31 561805735-0031	Ceiling Tile	Gray/Tan Fibrous Homogeneous	3% Cellulose 90% Min. Wool	7% Non-fibrous (Other)	None Detected
4545-32 561805735-0032	Mastic	Black Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-33 561805735-0033	Mastic	Brown Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-34 561805735-0034	Mastic	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-35 561805735-0035	Mastic	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected

Initial report from: 10/24/2018 08:32:19



EMSL Analytical, Inc.

2700 W. Cypress Creek Rd. Ste. C108 Fort Lauderdale, FL 33309

Tel/Fax: (954) 786-9331 / (954) 941-4145

<http://www.EMSL.com> / pompanobeachlab@emsl.com

EMSL Order: 561805735

Customer ID: AQE63

Customer PO:

Project ID:

Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
4545-36 561805735-0036	Glue	Yellow Non-Fibrous Homogeneous	3% Synthetic	97% Non-fibrous (Other)	None Detected
4545-37 561805735-0037	Glue	Yellow Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-38 561805735-0038	Stucco	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-39 561805735-0039	Stucco	Gray/White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-40 561805735-0040	Stucco	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-41 561805735-0041	Stucco	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-42 561805735-0042	Stucco	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-43 561805735-0043	Stucco	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-44 561805735-0044	Stucco	Gray/White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-45 561805735-0045	Caulk	Tan/White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-46 561805735-0046	Caulk	Gray/Tan/White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-47 561805735-0047	Caulk	Tan/White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-48 561805735-0048	Caulk	Tan/White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected

Analyst(s)

Catalina Lachowski (31)

John Polanco (34)

Catalina Lachowski, Laboratory Manager
or Other Approved Signatory

EMSL maintains liability limited to cost of analysis. The above analyses were performed in general compliance with Appendix E to Subpart E of 40 CFR (previously EPA 600/M4-82-020 "Interim Method"), but augmented with procedures outlined in the 1993 ("final") version of the method. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. All samples received in acceptable condition unless otherwise noted. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. EMSL recommends gravimetric reduction for all non-friable organically bound materials prior to analysis. Estimation of uncertainty is available on request.

Samples analyzed by EMSL Analytical, Inc. Fort Lauderdale, FL NVLAP Lab Code 500085-0

Initial report from: 10/24/2018 08:32:19

561805735

AIR QUEST ENVIRONMENTAL, INC.
 6851 Southwest 45th Street
 Fort Lauderdale, FL 33314
 Phone: 954/792-4549
 Fax: 954/792-2221

Stop at First Positive: Yes (No)
 Turnaround Time: 3 Hr. ___; 6 Hr. ___;
 24 Hr. X; 72 Hr. ___; Other ___
 Email: Labresults@airquestinc.com

Sample Date: 10/22/18
 Project Name: 2671 N Federal Hwy Pompano
 Project Number: 14545
 Surveyor: Pedro Rodes
 Signature: [Signature]

HA	Sample Number	HA Description	Sample Location	HA Location	Quantity	G/F/P	Dist. Pot.	Friable	Comments/Photo #
1	4545-01	2x2 ACT (Rough)	Dining Center	T.O. Dining Area	2000	G	L	Y	
1	02	↓	Dining East End		2000			Y	
1	03	↓	Dining West End		2000			Y	
2	04	2x2 ACT (waves)	East End		60			Y	
2	05	↓	East End		60			Y	
3	06	2x2 ACT (dots & gaps)	East End		24			Y	
3	07	↓	East End		24	↓		Y	
4	08	Gray 8"x8" CFT & grout	Dining West End	Dining, Bathroom, Galley	600	F		N	
4	09	↓	Bathroom Corridor	↓	600			N	
5	10	Orange 4"x4" CFT & grout	Dining Center Area	Dining Area, Back Area	T.O.			N	
5	11	↓	Back Corridor	↓	T.O.			N	
6	12	Drywall System @ Ceiling	Entrance Back Area	Dining, Bathroom, Back	950			Y	
6	13	↓	Bathroom Corridor	↓	950			Y	
7	14	Drywall System @ Walls	Bathroom Corridor	T.O.	T.O.			Y	
7	15	↓	Storage 1	↓	T.O.			Y	
7	16	↓	Storage 2	↓	T.O.			Y	
8	17	2x2 ACT (Gypsum)	Dishwasher Area	Dishwasher Area	200			Y	
8	↓ 18	↓	↓	↓	200	↓	↓	Y	

Relinquished by: Pedro Rodes

Received by: _____

Relinquished by: _____

Received by: AL-GMSL-Fed Ex

7955 8665 57619

Date & Time: 10/22/18

Date & Time: _____

Date & Time: _____

Date & Time: 10/23/18 @ 10:20 AM

Initial

Tracking #



FedEx:



Hand Couriered

Page 1 of 3

561805735

AIR QUEST ENVIRONMENTAL, INC.

6851 Southwest 45th Street

Fort Lauderdale, FL 33314

Phone: 954/792-4549

Fax: 954/792-2221

Stop at First Positive: Yes ☒ No

Turnaround Time: 3 Hr. ☐ 6 Hr. ☐

24 Hr. ☒ 72 Hr. ☐ Other ☐

Email: Labresults@airquestinc.com

Sample Date: 10/22/18

Project Name: 2671 N Federal Hwy Pompano

Project Number: 14545

Surveyor: Pedro Rodas

Signature: [Signature]

HA	Sample Number	HA Description	Sample Location	HA Location	Quantity	G/F/P	Dist. Pot.	Friable	Comments/Photo #
9	4545-19	2x2 ACT Dots	Storage 1	Back Area	90	G	L	Y	
9	20	↓	Storage 1	↓	90	G		Y	
10	21	Glue Behind F.R.P.	by Office area	T.O. Back Area	T.O.			N	
10	22	↓	by Office area	↓	T.O.			N	
11	23	Boiler 3"x3" CWT & gasket	Men Restroom	Bathrooms, W. Dining	200			N	
11	24	↓	Women Restroom	↓	200			N	
12	25	Black 4" UFC & glue	Storage 2	Storage 2, 3	20			N	
12	26	↓	Storage 3	↓	20			N	
13	27	Red Roll Sheet & glue	↓	Storage 3	48			N	
13	28	↓	↓	↓	48			N	
14	29	Tan 1'x1' ACT	Above Plenum Dining	Above Plenum Dining Center West	1100	F		Y	
14	30	↓	↓	↓	1100			Y	
14	31	↓	↓	↓	1100			Y	
15	32	Brown Mastix Plenum	↓	↓	1100			N	
15	33	↓	↓	↓	1100			N	
16	34	White Mastix @ Plenum	Dining Center Area	T.O. Plenum	110			N	
16	35	↓	Dining East End	↓	110			N	
17	36	Yellow Glue Carpet	Dining West End	Dining Area	2000	G		N	

Relinquished by: Pedro Rodas

Received by: _____

Relinquished by: [Signature]

Received by: [Signature]

Date & Time: 10/22/18

Date & Time: _____

Date & Time: _____

Date & Time: _____

Initial

Tracking #




FedEx:



Hand Couriered

Page 2 of 3

 AIRQUEST ENVIRONMENTAL, INC.
6851 Southwest 45th Street
Fort Lauderdale, FL 33314
Phone: 954/792-4549
Fax: 954/792-2221

Stop at First Positive: Yes No
Turnaround Time: 3 Hr. ___; 6 Hr. ___;
24 Hr. X; 72 Hr. ___; Other ___
Email: Labresults@airquestinc.com

Sample Date: 10/22/18
Project Name: 2671 N. Federal Hwy
Project Number: 14545
Surveyor: Pedro Rodas
Signature: [Signature]

[illegible]

Relinquished by: Pedro Rodas

Date & Time: 10/22/18

Initial

Tracking #

Received by: _____

Date & Time: _____

Relinquished by: A

Date & Time: _____

Received by: KL

Date & Time: _____



FedEx:

Hand Couriered

Page 3 of 3



EMSL Analytical, Inc.

2700 W. Cypress Creek Rd. Ste. C108 Fort Lauderdale, FL 33309

Phone/Fax: (954) 786-9331 / (954) 941-4145

<http://www.EMSL.com> / pompanobeachlab@emsl.com

EMSL Order: 561805746

Customer ID: AQE63

Customer PO:

Project ID:

Attention: Paul LeBlanc
AirQuest Environmental, Inc.
6851 Southwest 45th Street
Fort Lauderdale, FL 33314

Phone: (954) 214-2640
Fax: (954) 792-2221
Received: 10/24/2018 9:29 AM
Analysis Date: 10/24/2018
Collected: 10/22/2018

Project: 2671 N. Federal Highway, Pompano - 14545

Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy. Quantitation using 400 Point Count Procedure

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
4545-12 561805746-0001	Joint Compound	White Non-Fibrous Homogeneous		99.50% Non-fibrous (Other)	0.50% Chrysotile
4545-13 561805746-0002	Joint Compound	White Non-Fibrous Homogeneous		99.50% Non-fibrous (Other)	0.50% Chrysotile
4545-14 561805746-0003	Joint Compound	White Non-Fibrous Homogeneous		99.75% Non-fibrous (Other)	0.25% Chrysotile
4545-15 561805746-0004	Joint Compound	White Non-Fibrous Homogeneous		99.75% Non-fibrous (Other)	0.25% Chrysotile
4545-16 561805746-0005	Joint Compound	White Non-Fibrous Homogeneous		99.75% Non-fibrous (Other)	0.25% Chrysotile

Analyst(s)

John Polanco (5)

Catalina Lachowski, Laboratory Manager
or other approved signatory

Disclaimer: Some samples may contain asbestos fibers present in dimensions below PLM resolution limits. The limit of detection as stated in the method is 0.25%. EMSL Analytical Inc suggests that samples reported as <0.25% or none detected undergo additional analysis via TEM. The above test report relates only to the items tested. This report may not be reproduced, except in full, without written approval of EMSL Analytical Inc. This test report must not be used by the client to claim product endorsement by NVLAP or any agency of the United States Government. EMSL Analytical Inc., bears no responsibility for sample collection activities, analytical method limitations, or the accuracy of results when requested to separate layered samples. EMSL Analytical Inc., liability is limited to the cost of sample analysis. The test results contained within this report meet the requirements of NELAC unless otherwise noted. Samples received in good condition unless otherwise noted. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample.

Samples analyzed by EMSL Analytical, Inc. Fort Lauderdale, FL NVLAP Lab Code 500085-0

Initial report from: 10/24/2018 16:35:33

Point Count: 561805746

561805735

AIR QUEST ENVIRONMENTAL, INC.
 6851 Southwest 45th Street
 Fort Lauderdale, FL 33314
 Phone: 954/792-4549
 Fax: 954/792-2221

Stop at First Positive: Yes ☒ No ☐
 Turnaround Time: 3 Hr. ☐ 6 Hr. ☐
 24 Hr. ☒ 72 Hr. ☐ Other ☐
 Email: Labresults@airquestinc.com

Sample Date: 10/22/18
 Project Name: 2671 N Federal Hwy Pompano
 Project Number: 14545
 Surveyor: Pedro Rades
 Signature: [Signature]

HA	Sample Number	HA Description	Sample Location	HA Location	Quantity	G/F/P	Dist. Pot.	Friable	Comments/Photo #
1	01	2x2 ACT (Rough)	Dining. Center	To Dining Area	2000	G	L	Y	
1	02	↓	Dining East End		2000			Y	
1	03	↓	Dining West End		2000			Y	
2	04	2x2 ACT (Cubes)	East End		60			Y	
2	05	↓	East End		60			Y	
3	06	2x2 ACT (dots & Grah)	East End		24			Y	
3	07	↓	East End		24	↓		Y	
4	08	Gray 8"x8" CFT & girt	Dining West End	Dining, Bathroom, Corridor	600	F		N	
4	09	↓	Bathroom Corridor	↓	600			N	
5	10	Orange 4"x4" CFT & girt	Dining Center Area	Dining Area, Back Area	T.O.			N	
5	11	↓	Back Corridor	↓	T.O.			N	
6	(12)	Drywall System @ Ceiling	Entrance Back Area	Dining, Bathroom, Back	950			Y	
6	(13)	↓	Bathroom Corridor	↓	950			Y	
7	(14)	Drywall System @ Walls	Bathroom Corridor	T.O.	T.O.			Y	
7	(15)	↓	Storage 1	↓	T.O.			Y	
7	(16)	↓	Storage 2	↓	T.O.			Y	
8	17	2x2 ACT (Gypsum)	Dishwasher Area	Dishwasher Area	200			Y	
8	18	↓	↓	↓	200	↓	↓	Y	

Relinquished by: Pedro Rades
 Received by: _____
 Relinquished by: _____
 Received by: PL-GMSL-Fed Ex

Date & Time: 10/22/18
 Date & Time: _____
 Date & Time: _____
 Date & Time: 10/23/18 @ 10:20 AM

Initial

Tracking #

FedEx:

Hand Couried

Page 1 of 3

OrderID: 561805746

OrderID: 561805735

701805735

AIR QUEST ENVIRONMENTAL, INC.

6851 Southwest 45th Street

Fort Lauderdale, FL 33314

Phone: 954/792-4549

Fax: 954/792-2221

Stop at First Positive: Yes ☒ No ☐

Turnaround Time: 3 Hr. ☐ 6 Hr. ☐

24 Hr. ☒ 72 Hr. ☐ Other ☐


Email: Labresults@airquestinc.com

Sample Date: 10/22/18

Project Name: 2671 N. Federal Hwy Pompano

Project Number: 14545

Surveyor: Pedro Rodas

Signature: 

HA	Sample Number	HA Description	Sample Location	HA Location	Quantity	G/F/P	Dist. Pot.	Friable	Comments/Photo #
9	4545-19	2x2 ACT Dots	Storage 1	Back Area	90	G	L	Y	
9	20	↓	Storage 1	↓	90	G		Y	
10	21	Glue Behind F.R.P.	by Office area	T.O. Back Area	T.O.			N	
10	22	↓	by Office area	↓	T.O.			N	
11	23	Boiler 3"x3" CWT & glue	Men Restroom	Bathrooms, W. Dining	700			N	
11	24	↓	Women Restroom	↓	700			N	
12	25	Black 4" UFC & glue	Storage 2	Storage 2, 3	20			N	
12	26	↓	Storage 3	↓	20			N	
13	27	Red Roll Sheet & glue	↓	Storage 3	48			N	
13	28	↓	↓	↓	48			N	
14	29	Tan 1'x1' ACT	Above Plenum, Dining	Above Plenum, Dining	1100	F		Y	
14	30	↓	↓	↓	1100			Y	
14	31	↓	↓	↓	1100			Y	
15	32	Brown Moist. Plenum	↓	↓	1100			N	
15	33	↓	↓	↓	1100			N	
16	34	White Moist. @ A/C Unit	Dining Center Area	T.O. Plenum	110			N	
16	35	↓	Dining East End	↓	110			N	
17	36	Yellow Glue @ carpet	Dining West End	Dining Area	2000	G	↓	N	

Relinquished by: Pedro Rodas

Received by: _____

Relinquished by: 

Received by: _____

Date & Time: 10/22/18

Date & Time: _____

Date & Time: _____

Date & Time: _____

Initial

Tracking #



Page 2 of 3

OrderID: 561805746

OrderID: 561805735

6851 Southwest 45th Street
Fort Lauderdale, FL 33314
Phone: 954/792-4549
Fax: 954/792-2221

Stop at First Positive: Yes No
Turnaround Time: 3 Hr. ; 6 Hr. ;
24 Hr. X; 72 Hr. ; Other
Email: Labresults@airquestinc.com

Sample Date: 10/22/18
Project Name: 2671 N. Federal Hwy Pompano
Project Number: 14545
Surveyor: Pedro Rodas
Signature: [Signature]

[illegible]

Relinquished by: Radwa Radwan
Received by: _____
Relinquished by: (M)
Received by: (M)

Date & Time: 10/22/18
Date & Time: _____
Date & Time: _____
Date & Time: _____

Tracking #

☒ FedEx:
☐ Hand Couriered

Page 3 of 3



EMSL Analytical, Inc.

2700 W. Cypress Creek Rd. Ste. C108 Fort Lauderdale, FL 33309

Tel/Fax: (954) 786-9331 / (954) 941-4145

<http://www.EMSL.com> / pompanobeachlab@emsl.com

EMSL Order: 561805751

Customer ID: AQE63

Customer PO:

Project ID:

Attention: Paul LeBlanc

AirQuest Environmental, Inc.

6851 Southwest 45th Street

Fort Lauderdale, FL 33314

Phone: (954) 214-2640

Fax: (954) 792-2221

Received Date: 10/24/2018 10:25 AM

Analysis Date: 10/24/2018 - 10/25/2018

Collected Date: 10/23/2018

Project: 2671 N. Federal Highway, Pompano - 14545

Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
4545-49 561805751-0001	BUR	Tan/White Fibrous Homogeneous	40% Cellulose 20% Synthetic 20% Glass	20% Non-fibrous (Other)	None Detected
4545-50 561805751-0002	BUR	Tan/Black Fibrous Homogeneous	40% Cellulose 20% Synthetic 20% Glass	20% Non-fibrous (Other)	None Detected
4545-51 561805751-0003	BUR	Brown/Black Fibrous Homogeneous	50% Cellulose 20% Synthetic 20% Glass	10% Non-fibrous (Other)	None Detected
4545-52 561805751-0004	BUR	Black Fibrous Homogeneous	5% Cellulose 15% Synthetic	80% Non-fibrous (Other)	None Detected
4545-53 561805751-0005	BUR	Black Fibrous Homogeneous	10% Cellulose 25% Synthetic	65% Non-fibrous (Other)	None Detected
4545-54 561805751-0006	Plaster	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-55 561805751-0007	Plaster	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-56 561805751-0008	Plaster	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-57 561805751-0009	BUR	White/Black Fibrous Homogeneous	15% Cellulose 20% Synthetic	65% Non-fibrous (Other)	None Detected
4545-58 561805751-0010	BUR	Black Fibrous Homogeneous	25% Cellulose 15% Synthetic 10% Glass	50% Non-fibrous (Other)	None Detected
4545-59 561805751-0011	Pitch Pan	Gray Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-60 561805751-0012	Pitch Pan	Gray/Black Non-Fibrous Homogeneous	3% Wollastonite	97% Non-fibrous (Other)	None Detected
4545-61 561805751-0013	BUR	Black Fibrous Homogeneous	15% Synthetic	85% Non-fibrous (Other)	None Detected
4545-62 561805751-0014	BUR	Black Fibrous Homogeneous	15% Synthetic	85% Non-fibrous (Other)	None Detected
4545-63 561805751-0015	Patch BUR	Tan/Black Fibrous Homogeneous	40% Cellulose 15% Synthetic	45% Non-fibrous (Other)	None Detected
4545-64 561805751-0016	Patch BUR	Black Fibrous Homogeneous	50% Cellulose 20% Synthetic	30% Non-fibrous (Other)	None Detected

Initial report from: 10/25/2018 09:37:25



EMSL Analytical, Inc.

2700 W. Cypress Creek Rd. Ste. C108 Fort Lauderdale, FL 33309

Tel/Fax: (954) 786-9331 / (954) 941-4145

<http://www.EMSL.com> / pompanobeachlab@emsl.com

EMSL Order: 561805751

Customer ID: AQE63

Customer PO:

Project ID:

Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 Method using Polarized Light Microscopy

Sample	Description	Appearance	Non-Asbestos		Asbestos
			% Fibrous	% Non-Fibrous	% Type
4545-65 561805751-0017	BUR	White/Black Fibrous Homogeneous	25% Synthetic	75% Non-fibrous (Other)	None Detected
4545-66 561805751-0018	BUR	Black Fibrous Homogeneous	20% Synthetic	80% Non-fibrous (Other)	None Detected
4545-67 561805751-0019	Mastic	White/Black Non-Fibrous Homogeneous		92% Non-fibrous (Other)	8% Chrysotile
4545-68 561805751-0020	Mastic	White Non-Fibrous Homogeneous		100% Non-fibrous (Other)	None Detected
4545-69 561805751-0021	Mastic	Gray/Black Non-Fibrous Homogeneous	15% Cellulose	75% Non-fibrous (Other)	10% Chrysotile
4545-70 561805751-0022	Mastic	Black Non-Fibrous Homogeneous	15% Cellulose	85% Non-fibrous (Other)	None Detected
4545-71 561805751-0023	Shingle	Black Fibrous Homogeneous	30% Cellulose 30% Glass	40% Non-fibrous (Other)	None Detected
4545-72 561805751-0024	Shingle	Black Fibrous Homogeneous	30% Cellulose 30% Glass	40% Non-fibrous (Other)	None Detected
4545-73 561805751-0025	Shingle	Black Fibrous Homogeneous	30% Cellulose 30% Glass	40% Non-fibrous (Other)	None Detected
4545-74 561805751-0026	Shingle	Black Non-Fibrous Homogeneous	30% Cellulose 20% Glass	50% Non-fibrous (Other)	None Detected
4545-75 561805751-0027	Mastic	Black Fibrous Homogeneous	30% Cellulose	70% Non-fibrous (Other)	None Detected
4545-76 561805751-0028	Mastic	Black Fibrous Homogeneous	30% Cellulose	70% Non-fibrous (Other)	None Detected
4545-77 561805751-0029	Mastic	Black Fibrous Homogeneous	40% Cellulose	60% Non-fibrous (Other)	None Detected
4545-78 561805751-0030	Mastic	Black Non-Fibrous Homogeneous	30% Cellulose	70% Non-fibrous (Other)	None Detected

Analyst(s)

Catalina Lachowski (16)

John Polanco (14)

Catalina Lachowski, Laboratory Manager
or Other Approved Signatory

EMSL maintains liability limited to cost of analysis. The above analyses were performed in general compliance with Appendix E to Subpart E of 40 CFR (previously EPA 600/M4-82-020 "Interim Method"), but augmented with procedures outlined in the 1993 ("final") version of the method. This report relates only to the samples reported above, and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. All samples received in acceptable condition unless otherwise noted. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. EMSL recommends gravimetric reduction for all non-friable organically bound materials prior to analysis. Estimation of uncertainty is available on request.

Samples analyzed by EMSL Analytical, Inc. Fort Lauderdale, FL NVLAP Lab Code 500085-0

Initial report from: 10/25/2018 09:37:25

AIR QUEST ENVIRONMENTAL, INC.
 6851 Southwest 45th Street
 Fort Lauderdale, FL 33314
 Phone: 954/792-4549
 Fax: 954/792-2221

Stop at First Positive: Yes ☒ No ☐
 Turnaround Time: 3 Hr. ☐ 6 Hr. ☐
 24 Hr. ☒ 72 Hr. ☐ Other ☐
 Email: Labresults@airquestinc.com

Sample Date: 10/23/18
 Project Name: 2671 N. Federal Hwy Portpana
 Project Number: 14545
 Surveyor: Pedro R. / Nico N.
 Signature: [Signature]

HA	Sample Number	HA Description	Sample Location	HA Location	Quantity	G/F/P	Dist. Pot.	Friable	Comments/Photo #
21	4545-49	BUR @ HUP Bituminous @ Manhole	East End.	T.O. Center Flat Roof	1320	F	L	N	
21	50	↓	North End.		1520			N	
21	51	↓	NW End.		1520			N	
22	52	BUR @ Bituminous @ Flashing	West Parapet Area.		384			N	
22	53	↓	North Parapet Area.		384			N	
23	54	Plaster @ Parapet Wall	South Parapet.		1200			N	
23	55	↓	North Parapet.		1200			N	
23	56	↓	West Parapet.		1200			N	
24	57	BUR @ Deck Parapet	South End.		16			N	
24	58	↓	SW End.		16			N	
25	59	Pitch Pan	Center Area.		3			N	
25	60	↓	Center Area.		3			N	
26	61	BUR @ Drains	South. East.		3			N	
26	62	↓	South. West.		3			N	
27	63	Path. BUR. Bituminous	South. East		105			N	
27	64	↓	South East		105			N	
28	65	BUR @ Vent Curbs	South. Unit.		200			N	
28	66	↓	North. Unit.		200	V	V	N	

Relinquished by: Pedro Rodon
 Received by: _____
 Relinquished by: _____
 Received by: AL GMSL-Fed Ex
7955 8465 5950

Date & Time: 10/23/18
 Date & Time: _____
 Date & Time: _____
 Date & Time: 10/24/18 @ 10:29 AM

Initial _____ Tracking # _____
☒ FedEx:
☐ Hand Couriered
 Page 1 of 2

OrderID: 561805751

561805751

AIR QUEST ENVIRONMENTAL, INC.

6851 Southwest 45th Street

Fort Lauderdale, FL 33314

Phone: 954/792-4549

Fax: 954/792-2221

Stop at First Positive: Yes ☒ No ☐Turnaround Time: 3 Hr. ☐ 6 Hr. ☐24 Hr. ☒ 72 Hr. ☐ Other ☐

Email: Labresults@airquestinc.com

Sample Date: 10/23/18

Project Name: 2671 N. Federal Hwy Pompano

Project Number: 14545

Surveyor: Pedro R. / Nico N.

Signature: 

HA	Sample Number	HA Description	Sample Location	HA Location	Quantity	G/F/P	Dist. Pot.	Friable	Comments/Photo #
29	4545-67	White Mastix @ Alc unit	NW Area Units	T.O. Center Flat Roof	30	F	L	N	
29	68	↓	↓	↓	30	↓	↓	N	
30	69	Black Mastix @ Alc unit	↓	↓	20	↓	↓	N	
30	70	↓	↓	↓	20	↓	↓	N	
31	71	Shingle @ Sides Roof	South. Side.	T.O. Sides Roofs	4500	G		N	
31	72	↓	North Side.	↓	4500	↓	↓	N	
32	73	Shingle @ side Roof Edge	South Side	↓	220	↓	↓	N	
32	74	↓	North Side	↓	220	↓	↓	N	
33	75	Black Mastix Top parapet	NW Top Parapet	T.O. Center Flat Roof	192	F		N	
33	76	↓	↓	↓	192	↓	↓	N	
34	77	Black Mastix @ Lower	South Side Lower	↓	100	↓	↓	N	
34	78	↓	↓	↓	100	↓	↓	N	

Relinquished by: Pedro Rodas

Received by: _____

Date & Time: 10/23/18

Date & Time: _____

Date & Time: _____

Date & Time: _____

Initial

Tracking #

Relinquished by: _____

Received by: 

FedEx:



Hand Couriered

Page 2 of 2

OrderID: 561805751

Appendix III

Photographs

Denny's
2671 North Federal Highway
Pompano Beach, Florida 33316

AirQuest Environmental, Inc.
Project #14545
October 2018



Exterior



**HA 1- White 2' x 2' ACT
with Rough Finish**



**HA 2- White 2' x 2' ACT
with Waves Pattern**



**HA 3- White 2' x 2' ACT
with Dot/Gash Pattern**



**HA 4- Gray 8' x 8' Ceramic Floor Tile
and Grout**



**HA 5- Orange 4' x 4' Ceramic Floor Tile
and Grout**

Denny's
2671 North Federal Highway
Pompano Beach, Florida 33316

AirQuest Environmental, Inc.
Project #14545
October 2018



HA 6- Drywall System Ceilings



HA 7- Drywall System Walls




HA 8- White 2' x 2' Gypsum ACT



**HA 9- White 2' x 2' ACT
with Dot Pattern**



HA 10- Fiberglass Rigid Wall Panel and Glue

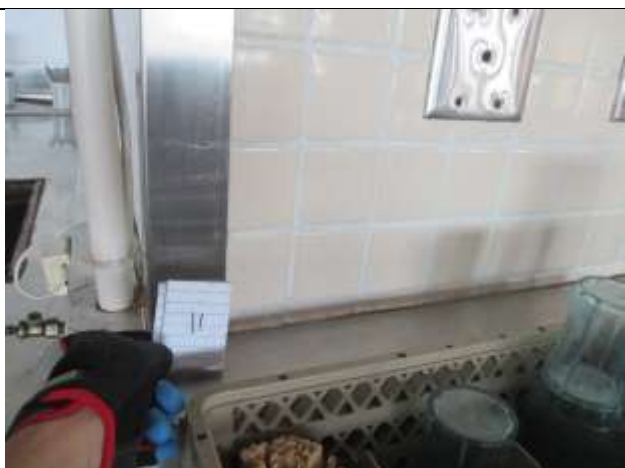

HA 11- Beige 3' x 3' Ceramic Wall Tile and Glue

Denny's
2671 North Federal Highway
Pompano Beach, Florida 33316

AirQuest Environmental, Inc.
Project #14545
October 2018



HA 12- Black 4" Vinyl Floor Cove and Mastic



HA 13- Red Rolled Sheet Flooring and Glue



HA 14- Tan 1' x 1" ACT Above Plenum



HA 15- Brown Mastic Above Plenum



HA 16- White Mastic at Air-Conditioner Vent



HA 17- Yellow Carpet Glue

Denny's
2671 North Federal Highway
Pompano Beach, Florida 33316

AirQuest Environmental, Inc.
Project #14545
October 2018



HA 18- Exterior Stucco



HA 19- Exterior Door Caulk



HA 20- Exterior Window Caulk



**HA 21- Built-Up Bituminous Roofing Material
at Membrane**



**HA 22- Built-Up Bituminous Roofing Material
at Flashing**



HA 23- Plaster at Parapet Walls

Denny's
2671 North Federal Highway
Pompano Beach, Florida 33316

AirQuest Environmental, Inc.
Project #14545
October 2018



**HA 24- Built-Up Bituminous Roofing Material
at Deck Penetrations**



HA 25- Pitch Pan Mastic



**HA 26- Built-Up Bituminous Roofing Material
at Drains**



**HA 27- Built-Up Bituminous Roofing Material
Patch**



**HA 28- Built-Up Bituminous Roofing Material
at Vent Curbs**



**HA 29- White Mastic on Air-Conditioning Unit
Asbestos Containing Material**

Denny's
2671 North Federal Highway
Pompano Beach, Florida 33316


AirQuest Environmental, Inc.
Project #14545
October 2018



HA 30- Black Mastic on Air-Conditioning Unit
Asbestos Containing Material



HA 31- Shingles at Roof Sides

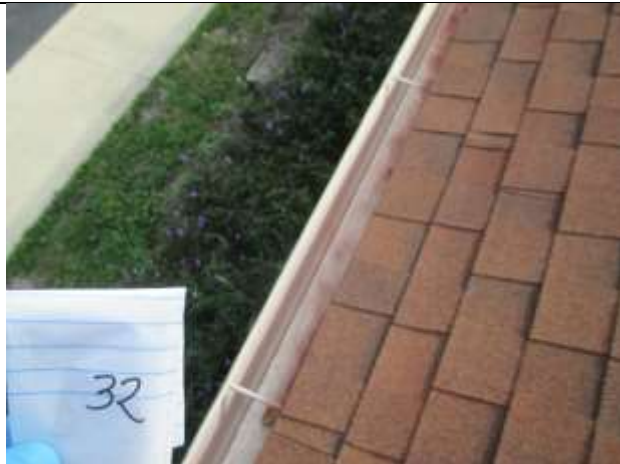

HA 32- Shingles at Side Roof Edges



HA 33- Black Mastic at Top of
Parapet Wall



HA 34- Black Mastic at Louvers



Black Mastic Above Drywall System Ceiling
Assumed Asbestos Containing Material