


Font: HelveticaNeue


ALL PENETRATIONS WILL BE SEALED WITH CLEAR SILICONES

C3 | SPECS: 11.7 sq. ft.  
Scale: 1/4"=1'-0"

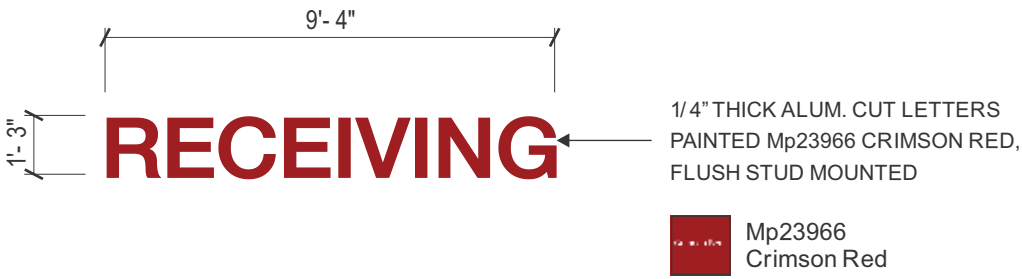


1. Design, fabrication and construction to the following codes and specifications:
- A. The Florida Building Code (2017)
  - B. American Welding Society AWS D1.1-04 & D1.2
  - C. Specifications for aluminum structures by the Aluminum Association (Current Edition)
2. Structural requirements:
- A. All bolted connections shall be made with ASTM A307 bolt or equal
  - B. All anchors bolts shall be ASTM A307 or equal ( flat washers at nut)
  - C. All welds shall be made with E70XX electrodes or equal
  - D. The electrical installation shall be in compliance with the National Electric Code (NEC 2014) grounding and bonding as per NEC 250 600-7
  - E. H.V.H.Z., section 1620 F.B.C., ASCE 7-10 170 MPH, exposure C, Category 2, Chapter 16

C2 | ELEVATION: West  
Scale: 1/16"=1'-0"

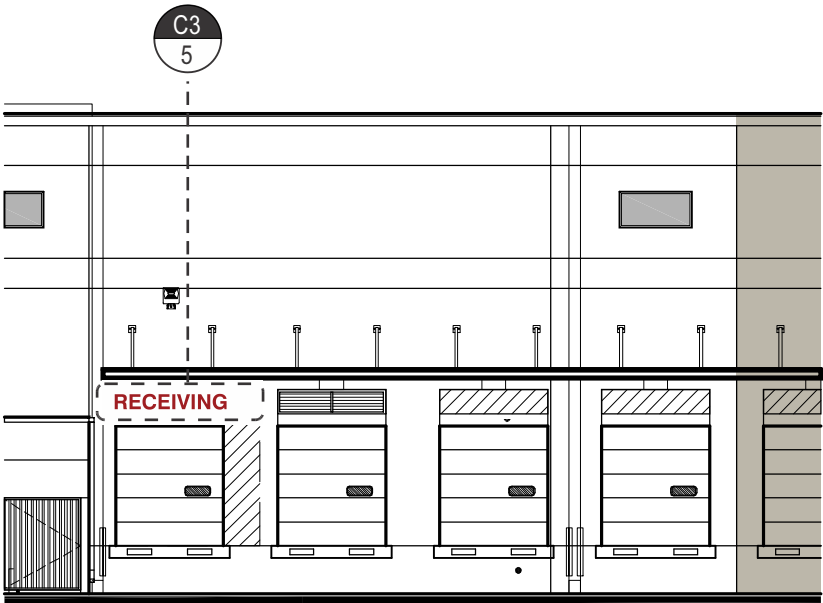

C4 | DETAIL: Mounting  
Scale: 3"=1'-0"

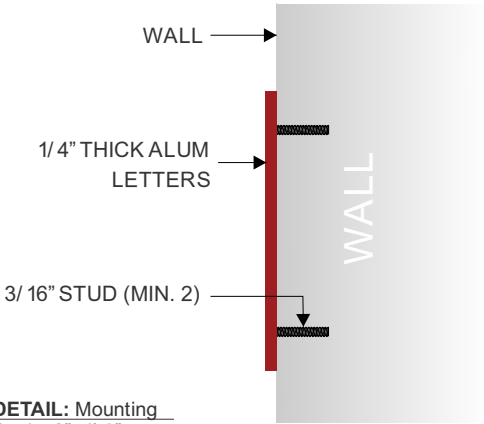

C1 | ELEVATION: Partial West (Right)  
Scale: 1/32"=1'-0"

